

J.C. Broderick & Associates, Inc.

Environmental / Construction Consulting & Testing



April 29, 2020

Mr. Tom Szajkowski
Roslyn Union Free School District
PO Box 367
Roslyn, New York 11576

Re: **Lead Testing in School Drinking Water
2020 Compliance 10 NYCRR Subpart 67-4**

JCB#: **19-45006**

Dear Mr. Szajkowski:

J.C. Broderick & Associates, Inc. (JCB) was retained to perform lead testing and analysis of the outlets which service the above referenced school district in accordance with 10 NYCRR Subpart 67-4 (Subpart 67-4).

The outlets servicing each of the school buildings were inventoried and assigned unique identification numbers. The use and location of each outlet was reviewed to determine its applicability for testing under Subpart 67-4.

An initial first-draw sample was collected from each applicable outlet after the minimum 8-hour stagnation period. Samples were logged into a chain of custody document and delivered to an Environmental Laboratory Approval Program (ELAP) accredited laboratory for analysis.

Results from the laboratory analysis were compared with the Action Level as defined by Subpart 67-4 of 15 parts per billion (ppb). Any outlet which exceeded this level requires a remediation action plan be implemented (i.e. removal from service, placarding for non-drinking uses). Outlets which did not exceed the action level do not require further testing or remediation.

Please see the following attachments which detail the sampling and analysis performed and remediation actions taken to date.

Attachment 1: Lead Testing Results for Applicable Outlets

Attachment 2: Laboratory Analytical Reports

Attachment 3: Laboratory Certifications

If you have any questions, or if more information is needed, please contact our office.


Sincerely,

A handwritten signature in black ink, appearing to read 'Anthony Lombardo', is written over a light blue horizontal line.

Anthony Lombardo
J C Broderick & Associates, Inc.

Attachment 1:

Lead Testing Results
for Applicable Outlets

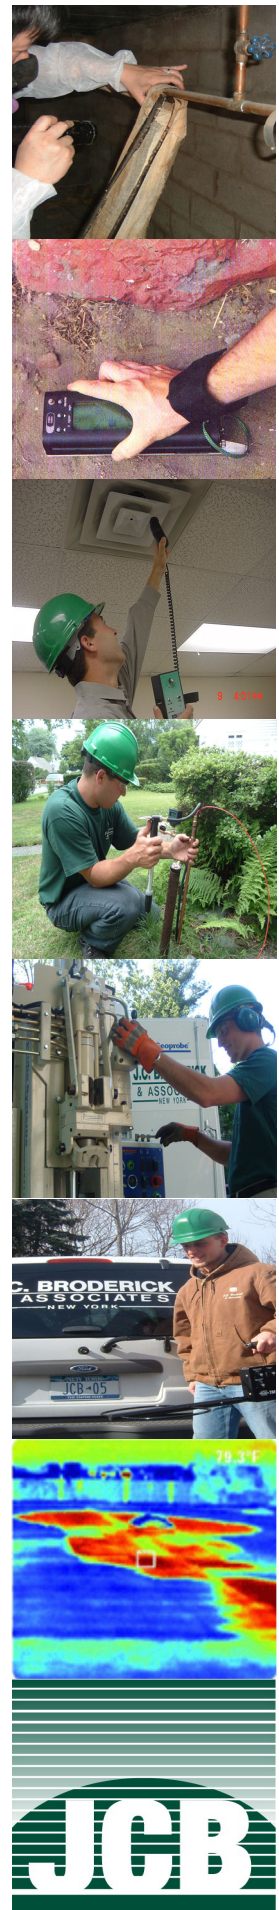

J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395



Outlet #	Building Name	AHERA ID	Common Room Name	Outlet Type	Potable/Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status2
RSLN0002	East Hills Elementary School	00011	Room 65	Classroom Faucet	Non-Potable	1/7/2020	1.5	Samples Passed, No Action Needed
RSLN0003	East Hills Elementary School	0012	Room 64	Classroom Faucet	Non-Potable	1/7/2020	4.9	Samples Passed, No Action Needed
RSLN0004	East Hills Elementary School	1000	Room 45	Fountain	Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0005	East Hills Elementary School	1000	Room 45	Classroom Faucet	Non-Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0007	East Hills Elementary School	1001	Room 44	Fountain	Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0006	East Hills Elementary School	1001	Room 44	Classroom Faucet	Non-Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0008	East Hills Elementary School	1002	Student Bathroom Outside Room 44	Bathroom Faucet	Non-Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0009	East Hills Elementary School	1003	Student Bathroom Outside Room 45	Bathroom Faucet	Non-Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0010	East Hills Elementary School	1004	Student Bathroom Outside Room 43	Bathroom Faucet	Non-Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0011	East Hills Elementary School	1005	Student Bathroom Outside Room 46	Bathroom Faucet	Non-Potable	1/7/2020	1.5	Samples Passed, No Action Needed
RSLN0012	East Hills Elementary School	1006	Room 43	Fountain	Potable	1/7/2020	1.1	Samples Passed, No Action Needed
RSLN0013	East Hills Elementary School	1006	Room 43	Classroom Faucet	Non-Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0015	East Hills Elementary School	1007	Room 46	Fountain	Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0014	East Hills Elementary School	1007	Room 46	Classroom Faucet	Non-Potable	1/7/2020	1.4	Samples Passed, No Action Needed
RSLN0016	East Hills Elementary School	1009	Room 47	Fountain	Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0017	East Hills Elementary School	1009	Room 47	Classroom Faucet	Non-Potable	1/7/2020	3.7	Samples Passed, No Action Needed
RSLN0018	East Hills Elementary School	1010	Room 41	Fountain	Potable	1/7/2020	1.6	Samples Passed, No Action Needed
RSLN0019	East Hills Elementary School	1010	Room 41	Classroom Faucet	Non-Potable	1/7/2020	3.3	Samples Passed, No Action Needed
RSLN0020	East Hills Elementary School	1011	Room 48	Fountain	Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0021	East Hills Elementary School	1011	Room 48	Classroom Faucet	Non-Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0022	East Hills Elementary School	1012	Room 40	Fountain	Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0023	East Hills Elementary School	1012	Room 40	Classroom Faucet	Non-Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0024	East Hills Elementary School	1013	Room 49	Fountain	Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0025	East Hills Elementary School	1013	Room 49	Classroom Faucet	Non-Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0026	East Hills Elementary School	1014	Room 39	Fountain	Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0027	East Hills Elementary School	1014	Room 39	Classroom Faucet	Non-Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0028	East Hills Elementary School	1015	Room 50	Fountain	Potable	1/7/2020	1.0	Samples Passed, No Action Needed
RSLN0029	East Hills Elementary School	1015	Room 50	Water Cooler	Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0030	East Hills Elementary School	1015	Room 50	Classroom Faucet	Non-Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0031	East Hills Elementary School	1016	Handicap Bathroom	Bathroom Faucet	Non-Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0032	East Hills Elementary School	1019	Boy's Bathroom	Tempered Outlet	Non-Potable	1/7/2020	1.6	Samples Passed, No Action Needed
RSLN0033	East Hills Elementary School	1019	Boy's Bathroom	Tempered Outlet	Non-Potable	1/7/2020	2.3	Samples Passed, No Action Needed
RSLN0035	East Hills Elementary School	1021	Girl's Bathroom	Bathroom Faucet	Non-Potable	1/7/2020	4.0	Samples Passed, No Action Needed
RSLN0036	East Hills Elementary School	1021	Girl's Bathroom	Bathroom Faucet	Non-Potable	1/7/2020	3.5	Samples Passed, No Action Needed
RSLN0037	East Hills Elementary School	1024	Room 36 Library	Classroom Faucet	Non-Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0038	East Hills Elementary School	1026C2	Principal's Office Bathroom	Bathroom Faucet	Non-Potable	1/7/2020	4.1	Samples Passed, No Action Needed
RSLN0039	East Hills Elementary School	1031A	Room 5 Health Office	Nurse's Faucet	Potable	1/7/2020	1.2	Samples Passed, No Action Needed
RSLN0040	East Hills Elementary School	1031B4	Room 5 Health Office Hallway Bathroom	Bathroom Faucet	Non-Potable	1/7/2020	2.5	Samples Passed, No Action Needed
RSLN0041	East Hills Elementary School	1035	Gymnasium	Water Cooler	Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0042	East Hills Elementary School	1037	Staff Bathroom	Bathroom Faucet	Non-Potable	1/7/2020	3.3	Samples Passed, No Action Needed
RSLN0043	East Hills Elementary School	1042A	Room 17 Faculty Lounge Bathroom	Bathroom Faucet	Non-Potable	1/7/2020	3.6	Samples Passed, No Action Needed
RSLN0044	East Hills Elementary School	1042	Room 17 Faculty Lounge	Kitchen-Food Prep	Potable	1/7/2020	5.0	Samples Passed, No Action Needed
RSLN0045	East Hills Elementary School	1043	Girl's Bathroom	Bathroom Faucet	Non-Potable	1/7/2020	4.6	Samples Passed, No Action Needed
RSLN0046	East Hills Elementary School	1043	Girl's Bathroom	Bathroom Faucet	Non-Potable	1/7/2020	1.5	Samples Passed, No Action Needed
RSLN0047	East Hills Elementary School	1044	Boy's Bathroom	Tempered Outlet	Non-Potable	1/7/2020	2.8	Samples Passed, No Action Needed
RSLN0048	East Hills Elementary School	1044	Boy's Bathroom	Tempered Outlet	Non-Potable	1/7/2020	3.1	Samples Passed, No Action Needed
RSLN0049	East Hills Elementary School	1046	Room 18	Fountain	Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0050	East Hills Elementary School	1046	Room 18	Classroom Faucet	Non-Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0054	East Hills Elementary School	1048	Room 20	Fountain	Potable	1/7/2020	1.6	Samples Passed, No Action Needed
RSLN0055	East Hills Elementary School	1048	Room 20	Classroom Faucet	Non-Potable	1/7/2020	1.5	Samples Passed, No Action Needed
RSLN0056	East Hills Elementary School	1048B	Room 20 Bathroom	Bathroom Faucet	Non-Potable	1/7/2020	10.0	Samples Passed, No Action Needed
RSLN0057	East Hills Elementary School	1049	Room 21	Fountain	Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0058	East Hills Elementary School	1049	Room 21	Classroom Faucet	Non-Potable	1/7/2020	1.6	Samples Passed, No Action Needed
RSLN0059	East Hills Elementary School	1049B	Room 21 Bathroom	Bathroom Faucet	Non-Potable	1/7/2020	1.9	Samples Passed, No Action Needed
RSLN0060	East Hills Elementary School	1050	Room 22	Fountain	Potable	1/7/2020	1.2	Samples Passed, No Action Needed
RSLN0061	East Hills Elementary School	1050	Room 22	Classroom Faucet	Non-Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed

RSLN0062	East Hills Elementary School	1050	Room 22 Bathroom	Bathroom Faucet	Non-Potable	1/7/2020	6	Samples Passed, No Action Needed
RSLN0064	East Hills Elementary School	1056	Room 23	Fountain	Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0065	East Hills Elementary School	1056	Room 23	Classroom Faucet	Non-Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0066	East Hills Elementary School	1056A	Room 23 Bathroom	Bathroom Faucet	Non-Potable	1/7/2020	5.4	Samples Passed, No Action Needed
RSLN0067	East Hills Elementary School	1057	Room 24	Fountain	Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0068	East Hills Elementary School	1057	Room 24	Classroom Faucet	Non-Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0069	East Hills Elementary School	1057A	Room 24 Bathroom	Bathroom Faucet	Non-Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0072	East Hills Elementary School	1058	Room 25	Fountain	Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0071	East Hills Elementary School	1058B	Room 25 Bathroom	Bathroom Faucet	Non-Potable	1/7/2020	4.6	Samples Passed, No Action Needed
RSLN0070	East Hills Elementary School	1058	Room 25	Classroom Faucet	Non-Potable	1/7/2020	2.5	Samples Passed, No Action Needed
RSLN0073	East Hills Elementary School	1061A	Cafeteria Kitchen	Kitchen-Food Prep	Potable	1/7/2020	1.9	Samples Passed, No Action Needed
RSLN0074	East Hills Elementary School	1061A	Cafeteria Kitchen	Kitchen-Food Prep	Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0075	East Hills Elementary School	1061A	Cafeteria Kitchen	Kitchen-Food Prep	Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0076	East Hills Elementary School	1061A	Cafeteria Kitchen	Kitchen-Food Prep	Potable	1/7/2020	8.1	Samples Passed, No Action Needed
RSLN0077	East Hills Elementary School	1061A	Cafeteria Kitchen	Kitchen-Food Prep	Potable	1/7/2020	2.4	Samples Passed, No Action Needed
RSLN0078	East Hills Elementary School	1061A	Cafeteria Kitchen	Spray Nozzle	Potable	1/7/2020	2.8	Samples Passed, No Action Needed
RSLN0079	East Hills Elementary School	1061A	Cafeteria Kitchen	Spray Nozzle	Potable	1/7/2020	5.4	Samples Passed, No Action Needed
RSLN0080	East Hills Elementary School	1062	Room 27	Water Cooler	Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0081	East Hills Elementary School	1062	Room 27	Water Cooler	Potable	1/7/2020	1	Samples Passed, No Action Needed
RSLN0082	East Hills Elementary School	1062	Room 27	Fountain	Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0083	East Hills Elementary School	1062	Room 27	Classroom Faucet	Non-Potable	1/7/2020	1.6	Samples Passed, No Action Needed
RSLN0084	East Hills Elementary School	1062	Room 28	Fountain	Potable	1/7/2020	1.1	Samples Passed, No Action Needed
RSLN0085	East Hills Elementary School	1062B	Room 27 Bathroom	Bathroom Faucet	Non-Potable	1/7/2020	1.1	Samples Passed, No Action Needed
RSLN0087	East Hills Elementary School	1062B	Room 28 Bathroom	Bathroom Faucet	Non-Potable	1/7/2020	1.6	Samples Passed, No Action Needed
RSLN0086	East Hills Elementary School	1063	Room 28	Classroom Faucet	Non-Potable	1/7/2020	2.6	Samples Passed, No Action Needed
RSLN0088	East Hills Elementary School	1064	Room 29	Fountain	Potable		N/A	Outlet Permanently Removed
RSLN0089	East Hills Elementary School	1064	Room 29	Fountain	Potable	1/7/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0090	East Hills Elementary School	1064	Room 29	Classroom Faucet	Non-Potable	1/7/2020	2.1	Samples Passed, No Action Needed
RSLN0091	East Hills Elementary School	1064B	Room 29 Bathroom	Bathroom Faucet	Non-Potable	1/7/2020	3.3	Samples Passed, No Action Needed
RSLN0092	East Hills Elementary School	1068	Women's Bathroom	Bathroom Faucet	Non-Potable	1/7/2020	3	Samples Passed, No Action Needed
RSLN0093	East Hills Elementary School	1069	Men's Bathroom	Bathroom Faucet	Non-Potable	1/7/2020	1.6	Samples Passed, No Action Needed
RSLN0095	East Hills Elementary School	2001	Room 58	Fountain	Potable	1/7/2020	3.2	Samples Passed, No Action Needed
RSLN0096	East Hills Elementary School	2001	Room 58	Classroom Faucet	Non-Potable	1/7/2020	3.9	Samples Passed, No Action Needed
RSLN0097	East Hills Elementary School	2002	Room 57	Fountain	Potable	1/7/2020	2.5	Samples Passed, No Action Needed
RSLN0098	East Hills Elementary School	2002	Room 57	Classroom Faucet	Non-Potable	1/7/2020	2.1	Samples Passed, No Action Needed
RSLN0099	East Hills Elementary School	2003A	Room 56 Bathroom	Bathroom Faucet	Non-Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0100	East Hills Elementary School	2005	Room 59	Fountain	Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0101	East Hills Elementary School	2005	Room 59	Classroom Faucet	Non-Potable	1/8/2020	1.1	Samples Passed, No Action Needed
RSLN0102	East Hills Elementary School	2006	Room 55	Fountain	Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0103	East Hills Elementary School	2006	Room 55	Classroom Faucet	Non-Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0104	East Hills Elementary School	2007	Room 60	Fountain	Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0105	East Hills Elementary School	2007	Room 60	Classroom Faucet	Non-Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0106	East Hills Elementary School	2008	Room 54	Fountain	Potable	1/8/2020	1.2	Samples Passed, No Action Needed
RSLN0107	East Hills Elementary School	2008	Room 54	Classroom Faucet	Non-Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0108	East Hills Elementary School	2009	Room 61	Fountain	Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0109	East Hills Elementary School	2009	Room 61	Classroom Faucet	Non-Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0110	East Hills Elementary School	2010	Room 53	Fountain	Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0111	East Hills Elementary School	2010	Room 53	Classroom Faucet	Non-Potable	1/8/2020	5.7	Samples Passed, No Action Needed
RSLN0112	East Hills Elementary School	2011	Room 62	Fountain	Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0113	East Hills Elementary School	2011	Room 62	Classroom Faucet	Non-Potable	1/8/2020	1.5	Samples Passed, No Action Needed
RSLN0114	East Hills Elementary School	2012	Room 52	Fountain	Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0115	East Hills Elementary School	2012	Room 52	Classroom Faucet	Non-Potable	1/8/2020	1.6	Samples Passed, No Action Needed
RSLN0116	East Hills Elementary School	2015	Girls's Bathroom	Bathroom Faucet	Non-Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0117	East Hills Elementary School	2015	Girl's Bathroom	Bathroom Faucet	Non-Potable	1/8/2020	2.8	Samples Passed, No Action Needed
RSLN0119	East Hills Elementary School	2013	Boy's Bathroom	Tempered Outlet	Non-Potable	1/8/2020	2.3	Samples Passed, No Action Needed
RSLN0120	East Hills Elementary School	2013	Boy's Bathroom	Tempered Outlet	Non-Potable	1/8/2020	2.2	Samples Passed, No Action Needed
RSLN0121	East Hills Elementary School	2016	Room 51	Water Cooler	Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed

RSLN0122	Harbor Hill Elementary School	1036C	Custodial Office	Classroom Faucet	Non-Potable	1/8/2020	1.7	Samples Passed, No Action Needed
RSLN0129	Harbor Hill Elementary School	1002	Boy's Bathroom	Water Cooler	Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0133	Harbor Hill Elementary School	1003	Room 25	Fountain	Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0134	Harbor Hill Elementary School	1003	Room 25	Classroom Faucet	Non-Potable	1/8/2020	1.2	Samples Passed, No Action Needed
RSLN0135	Harbor Hill Elementary School	1004	Room 24	Fountain	Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0136	Harbor Hill Elementary School	1004	Room 24	Classroom Faucet	Non-Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0137	Harbor Hill Elementary School	1005	Room 27	Fountain	Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0138	Harbor Hill Elementary School	1005	Room 27	Classroom Faucet	Non-Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0139	Harbor Hill Elementary School	1006	Room 26	Fountain	Potable	1/8/2020	2.7	Samples Passed, No Action Needed
RSLN0140	Harbor Hill Elementary School	1006	Room 26	Classroom Faucet	Non-Potable	3/10/2020	14	Remediated, Tested Below Action Level
RSLN0141	Harbor Hill Elementary School	1006A	Room 26 South Bathroom	Bathroom Faucet	Non-Potable	3/10/2020	41	Placarded for Non-Drinking Use
RSLN0142	Harbor Hill Elementary School	1007	Room 29	Fountain	Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0143	Harbor Hill Elementary School	1007	Room 29	Classroom Faucet	Non-Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0144	Harbor Hill Elementary School	1009	Room 31	Fountain	Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0145	Harbor Hill Elementary School	1009	Room 31	Classroom Faucet	Non-Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0146	Harbor Hill Elementary School	1010	Room 32 Library	Classroom Faucet	Non-Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0147	Harbor Hill Elementary School	1011	Room 33	Fountain	Potable	1/8/2020	1	Samples Passed, No Action Needed
RSLN0148	Harbor Hill Elementary School	1011	Room 33	Classroom Faucet	Non-Potable	1/8/2020	1.1	Samples Passed, No Action Needed
RSLN0153	Harbor Hill Elementary School	1017A1	Gym South Office Bathroom	Bathroom Faucet	Non-Potable	1/8/2020	2.1	Samples Passed, No Action Needed
RSLN0154	Harbor Hill Elementary School	1017C1	Gym North Office Bathroom	Bathroom Faucet	Non-Potable	2/4/2020	<3.0 ND	Remediated, Tested Below Action Level
RSLN0155	Harbor Hill Elementary School	1018	Gym Vestibule	Fountain	Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0157	Harbor Hill Elementary School	1021	Room 42 Art Room	Fountain	Potable		Not Functioning	Testing Required Prior to Return to Service
RSLN0161	Harbor Hill Elementary School	1029	Nurse's Office	Nurse's Faucet	Non-Potable	3/10/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0162	Harbor Hill Elementary School	1029C	Nurse's Office Bathroom	Bathroom Faucet	Non-Potable	1/8/2020	4.2	Samples Passed, No Action Needed
RSLN0163	Harbor Hill Elementary School	1030	Cafeteria/Auditorium	Fountain	Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0164	Harbor Hill Elementary School	1031A	Kitchen	Kitchen-Food Prep	Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0165	Harbor Hill Elementary School	1031A	Kitchen	Kitchen-Food Prep	Potable	1/8/2020	5.5	Samples Passed, No Action Needed
RSLN0166	Harbor Hill Elementary School	1031A	Kitchen	Kitchen-Food Prep	Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0167	Harbor Hill Elementary School	1031A	Kitchen	Kitchen-Food Prep	Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0168	Harbor Hill Elementary School	1031A	Kitchen	Kitchen-Food Prep	Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0170	Harbor Hill Elementary School	1031A3	Kitchen Bathroom	Bathroom Faucet	Non-Potable	1/8/2020	2	Samples Passed, No Action Needed
RSLN0171	Harbor Hill Elementary School	1034	Bathroom	Bathroom Faucet	Non-Potable	1/8/2020	2.6	Samples Passed, No Action Needed
RSLN0175	Harbor Hill Elementary School	1041	Faculty Room	Kitchen-Food Prep	Potable	1/8/2020	1.3	Samples Passed, No Action Needed
RSLN0176	Harbor Hill Elementary School	1041A1	Faculty Room Bathroom	Bathroom Faucet	Non-Potable	1/8/2020	1.6	Samples Passed, No Action Needed
RSLN0177	Harbor Hill Elementary School	1043B	Principal's Office Bathroom	Bathroom Faucet	Non-Potable	1/8/2020	4.2	Samples Passed, No Action Needed
RSLN0179	Harbor Hill Elementary School	1053	Room 10	Fountain	Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0180	Harbor Hill Elementary School	1053	Room 10	Fountain	Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0181	Harbor Hill Elementary School	1053	Room 10	Classroom Faucet	Non-Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0182	Harbor Hill Elementary School	1053A	Room 10 Bathroom	Bathroom Faucet	Non-Potable	1/9/2020	2.6	Samples Passed, No Action Needed
RSLN0183	Harbor Hill Elementary School	1054	Room 11	Fountain	Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0184	Harbor Hill Elementary School	1054	Room 11	Classroom Faucet	Non-Potable	1/9/2020	1.6	Samples Passed, No Action Needed
RSLN0185	Harbor Hill Elementary School	1054B	Room 11 Bathroom	Bathroom Faucet	Non-Potable	1/9/2020	2.7	Samples Passed, No Action Needed
RSLN0186	Harbor Hill Elementary School	1055	Room 12	Fountain	Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0187	Harbor Hill Elementary School	1055	Room 12	Classroom Faucet	Non-Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0188	Harbor Hill Elementary School	1055A	Room 12 Bathroom	Bathroom Faucet	Non-Potable	1/9/2020	1.6	Samples Passed, No Action Needed
RSLN0189	Harbor Hill Elementary School	1056	Room 13	Fountain	Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0190	Harbor Hill Elementary School	1056	Room 13	Classroom Faucet	Non-Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0191	Harbor Hill Elementary School	1056B	Room 13 Bathroom	Bathroom Faucet	Non-Potable	1/9/2020	1.6	Samples Passed, No Action Needed
RSLN0192	Harbor Hill Elementary School	1057	Room 14	Fountain	Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0193	Harbor Hill Elementary School	1057	Room 14	Classroom Faucet	Non-Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0194	Harbor Hill Elementary School	1057B	Room 14 Bathroom	Bathroom Faucet	Non-Potable	1/9/2020	2.2	Samples Passed, No Action Needed
RSLN0195	Harbor Hill Elementary School	1058	Room 15	Fountain	Potable	1/9/2020	1.5	Samples Passed, No Action Needed
RSLN0196	Harbor Hill Elementary School	1058	Room 15	Classroom Faucet	Non-Potable	1/9/2020	2.5	Samples Passed, No Action Needed
RSLN0197	Harbor Hill Elementary School	1058A	Room 15 Bathroom	Bathroom Faucet	Non-Potable	1/9/2020	1.9	Samples Passed, No Action Needed
RSLN0198	Harbor Hill Elementary School	1060	Room 18	Fountain	Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0199	Harbor Hill Elementary School	1060	Room 18	Classroom Faucet	Non-Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0200	Harbor Hill Elementary School	1060A	Room 18 Bathroom	Bathroom Faucet	Non-Potable	1/9/2020	11	Samples Passed, No Action Needed

RSLN0201	Harbor Hill Elementary School	1061	Room 17	Fountain	Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0202	Harbor Hill Elementary School	1061	Room 17	Classroom Faucet	Non-Potable	1/9/2020	1	Samples Passed, No Action Needed
RSLN0203	Harbor Hill Elementary School	1061B	Room 17 Bathroom	Bathroom Faucet	Non-Potable	1/9/2020	4	Samples Passed, No Action Needed
RSLN0204	Harbor Hill Elementary School	A (New Constructi	Room 19	Fountain	Potable	1/9/2020	1	Samples Passed, No Action Needed
RSLN0205	Harbor Hill Elementary School	A (New Constructi	Room 20	Fountain	Potable	1/9/2020	3.6	Samples Passed, No Action Needed
RSLN0206	Harbor Hill Elementary School	A (New Constructi	Room 21	Fountain	Potable	1/9/2020	1	Samples Passed, No Action Needed
RSLN0207	Harbor Hill Elementary School	A (New Constructi	Room 22	Fountain	Potable	1/9/2020	8.3	Samples Passed, No Action Needed
RSLN0208	Harbor Hill Elementary School	A (New Constructi	Room 23	Fountain	Potable	1/9/2020	1.8	Samples Passed, No Action Needed
RSLN0209	Harbor Hill Elementary School	A (New Constructi	Room 19	Classroom Faucet	Non-Potable	1/9/2020	1.1	Samples Passed, No Action Needed
RSLN0210	Harbor Hill Elementary School	A (New Constructi	Room 20	Classroom Faucet	Non-Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0211	Harbor Hill Elementary School	A (New Constructi	Room 21	Classroom Faucet	Non-Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0212	Harbor Hill Elementary School	A (New Constructi	Room 22	Classroom Faucet	Non-Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0213	Harbor Hill Elementary School	A (New Constructi	Room 23	Classroom Faucet	Non-Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0219	Harbor Hill Elementary School	A (New Constructi	Multipurpose Room	Fountain	Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0220	Harbor Hill Elementary School	A (New Constructi	Multipurpose Room	Classroom Faucet	Non-Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0221	Harbor Hill Elementary School	A (New Constructi	Multipurpose Room	Classroom Faucet	Non-Potable	1/9/2020	1.4	Samples Passed, No Action Needed
RSLN0222	Harbor Hill Elementary School	2000	Room 50 Computer Lab	Fountain	Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0223	Harbor Hill Elementary School	2000	Room 50 Computer Lab	Classroom Faucet	Non-Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0224	Harbor Hill Elementary School	2001	Room 51	Fountain	Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0225	Harbor Hill Elementary School	2001	Room 51	Classroom Faucet	Non-Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0226	Harbor Hill Elementary School	2002	Room 52	Fountain	Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0227	Harbor Hill Elementary School	2002	Room 52	Classroom Faucet	Non-Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0228	Harbor Hill Elementary School	2003	Room 53	Fountain	Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0229	Harbor Hill Elementary School	2003	Room 53	Classroom Faucet	Non-Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0230	Harbor Hill Elementary School	2004	Room 54	Fountain	Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0231	Harbor Hill Elementary School	2004	Room 54	Classroom Faucet	Non-Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0232	Harbor Hill Elementary School	2005	Room 55	Fountain	Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0233	Harbor Hill Elementary School	2005	Room 55	Classroom Faucet	Non-Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0234	Harbor Hill Elementary School	2006	Room 56	Fountain	Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0235	Harbor Hill Elementary School	2006	Room 56	Classroom Faucet	Non-Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0236	Harbor Hill Elementary School	2007	Room 57	Fountain	Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0237	Harbor Hill Elementary School	2007	Room 57	Classroom Faucet	Non-Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0238	Harbor Hill Elementary School	2008	Room 58	Fountain	Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0239	Harbor Hill Elementary School	2008	Room 58	Fountain	Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0240	Harbor Hill Elementary School	2008	Room 58	Classroom Faucet	Non-Potable	1/9/2020	1.1	Samples Passed, No Action Needed
RSLN0248	The Heights School	7	Science & Art Room	Kitchen-Food Prep	Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0249	The Heights School	7	Science & Art Room	Kitchen-Food Prep	Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0251	The Heights School	11	Library	Water Cooler	Potable	1/14/2020	1.2	Samples Passed, No Action Needed
RSLN0254	The Heights School	16	Staff Lounge	Kitchen-Food Prep	Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0255	The Heights School	0016A	Staff Lounge Bathroom	Bathroom Faucet	Non-Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0256	The Heights School	17	Room 2	Fountain	Potable	1/14/2020	1.1	Samples Passed, No Action Needed
RSLN0257	The Heights School	17	Room 2	Classroom Faucet	Non-Potable	1/14/2020	2.5	Samples Passed, No Action Needed
RSLN0258	The Heights School	18	Room 1	Fountain	Potable	1/14/2020	5.6	Samples Passed, No Action Needed
RSLN0259	The Heights School	18	Room 1	Classroom Faucet	Non-Potable	1/14/2020	4.3	Samples Passed, No Action Needed
RSLN0260	The Heights School	1000	Room 11	Fountain	Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0261	The Heights School	1000	Room 11	Classroom Faucet	Non-Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0262	The Heights School	1001	Room 12	Fountain	Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0263	The Heights School	1001	Room 12	Classroom Faucet	Non-Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0269	The Heights School	1004	Room 13	Water Cooler	Potable	1/14/2020	1.9	Samples Passed, No Action Needed
RSLN0270	The Heights School	1004	Room 13	Fountain	Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0271	The Heights School	1004	Room 13	Classroom Faucet	Non-Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0272	The Heights School	1006A	Cafeteria Kitchen	Kitchen-Food Prep	Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0273	The Heights School	1006A	Cafeteria Kitchen	Kitchen-Food Prep	Potable	1/14/2020	1.6	Samples Passed, No Action Needed
RSLN0274	The Heights School	1006A	Cafeteria Kitchen	Kitchen-Food Prep	Potable	1/10/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0275	The Heights School	1006B	Cafeteria Bathroom	Bathroom Faucet	Non-Potable	1/10/2020	1.7	Samples Passed, No Action Needed
RSLN0276	The Heights School	1013	Principal Office	Fountain	Potable	1/10/2020	1.3	Samples Passed, No Action Needed
RSLN0279	The Heights School	1016	Nurse's Office	Ice Machine	Potable	1/10/2020	<3.0 ND	Samples Passed, No Action Needed

RSLN0280	The Heights School	1016A	Nurse's Office Bathroom	Bathroom Faucet	Non-Potable	2/4/2020	1.6	Samples Passed, No Action Needed
RSLN0281	The Heights School	1017	Room 15	Fountain	Potable	1/10/2020	2.3	Samples Passed, No Action Needed
RSLN0282	The Heights School	1017	Room 15	Classroom Faucet	Non-Potable	1/10/2020	1	Samples Passed, No Action Needed
RSLN0283	The Heights School	1018	Room 14	Fountain	Potable	1/10/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0284	The Heights School	1018	Room 14	Classroom Faucet	Non-Potable	1/10/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0285	The Heights School	1021	Breezeway o/s Office 41	Fountain	Potable	1/10/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0286	The Heights School	1021	Breezeway o/s Office 41	Fountain	Potable	1/10/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0287	The Heights School	1021	Handicap Bathroom	Bathroom Faucet	Non-Potable	1/10/2020	2.8	Samples Passed, No Action Needed
RSLN0288	The Heights School	1024	Room 32	Fountain	Potable	1/10/2020	2.4	Samples Passed, No Action Needed
RSLN0289	The Heights School	1024	Room 32	Classroom Faucet	Non-Potable	1/10/2020	1.3	Samples Passed, No Action Needed
RSLN0290	The Heights School	1024A	Room 32 Bathroom	Bathroom Faucet	Non-Potable	1/10/2020	1.2	Samples Passed, No Action Needed
RSLN0291	The Heights School	1025B	Room 28 Bathroom	Bathroom Faucet	Non-Potable	1/10/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0292	The Heights School	1025	Room 28	Fountain	Potable	1/10/2020	1.4	Samples Passed, No Action Needed
RSLN0293	The Heights School	1025	Room 28	Classroom Faucet	Non-Potable	1/10/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0294	The Heights School	1028	Room 29	Fountain	Potable	1/14/2020	2	Samples Passed, No Action Needed
RSLN0295	The Heights School	1028A	Room 29 Bathroom	Bathroom Faucet	Non-Potable	1/14/2020	2	Samples Passed, No Action Needed
RSLN0296	The Heights School	1030	Room 33	Fountain	Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0297	The Heights School	1030	Room 33	Classroom Faucet	Non-Potable	1/14/2020	1.1	Samples Passed, No Action Needed
RSLN0298	The Heights School	1030A	Room 33 Bathroom	Bathroom Faucet	Non-Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0299	The Heights School	1032	Room 34	Fountain	Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0300	The Heights School	1032	Room 34	Classroom Faucet	Non-Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0301	The Heights School	1032B	Room 34 Bathroom	Bathroom Faucet	Non-Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0302	The Heights School	1034	Room 30	Fountain	Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0303	The Heights School	1034	Room 30	Classroom Faucet	Non-Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0304	The Heights School	1034B	Room 30 Bathroom	Bathroom Faucet	Non-Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0306	The Heights School	1037	Room 31	Fountain	Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0307	The Heights School	1037A	Room 31 Bathroom	Bathroom Faucet	Non-Potable	1/10/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0308	The Heights School	A (New Constructio	Library Storage Room	Kitchen-Food Prep	Potable	1/10/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0309	The Heights School	A (New Constructio	Main Office 41 Bathroom	Bathroom Faucet	Non-Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0310	The Heights School	2000	Room 27	Fountain	Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0311	The Heights School	2000	Room 27	Classroom Faucet	Non-Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0312	The Heights School	2001	Room 24	Fountain	Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0313	The Heights School	2001	Room 24	Classroom Faucet	Non-Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0317	The Heights School	2006	Room 25	Fountain	Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0318	The Heights School	2006	Room 25	Fountain	Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0319	The Heights School	2006	Room 25	Classroom Faucet	Non-Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0320	The Heights School	2009	Room 23	Fountain	Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0321	The Heights School	2009	Room 23	Classroom Faucet	Non-Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0326	The Heights School	2014	Room 22	Fountain	Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0327	The Heights School	2014	Room 22	Classroom Faucet	Non-Potable	1/14/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0328	The Heights School	2015	Room 21	Fountain	Potable	1/14/2020	1.7	Samples Passed, No Action Needed
RSLN0329	The Heights School	2015	Room 21	Classroom Faucet	Non-Potable	1/14/2020	2.7	Samples Passed, No Action Needed
RSLN0332	Roslyn Middle School	4	Custodial Storage/Lounge	Classroom Faucet	Non-Potable	1/15/2020	1.4	Samples Passed, No Action Needed
RSLN0352	Roslyn Middle School	1011A	Room 107 Bathroom	Bathroom Faucet	Non-Potable	1/15/2020	3.2	Samples Passed, No Action Needed
RSLN0353	Roslyn Middle School	1014	Room 112	Kitchen-Food Prep	Potable	1/15/2020	7.8	Samples Passed, No Action Needed
RSLN0354	Roslyn Middle School	1014A	Room 112 Bathroom	Bathroom Faucet	Non-Potable	1/15/2020	3.7	Samples Passed, No Action Needed
RSLN0362	Roslyn Middle School	1021	Corridor (Girls BR-Elevator Vestibule)	Water Cooler	Potable	1/15/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0363	Roslyn Middle School	1022	Library	Classroom Faucet	Non-Potable	1/15/2020	3.7	Samples Passed, No Action Needed
RSLN0366	Roslyn Middle School	1027A	Conference Room 118 Bathroom	Bathroom Faucet	Non-Potable	1/15/2020	6.4	Samples Passed, No Action Needed
RSLN0367	Roslyn Middle School	1028	Corridor (Library-Room 118)	Fountain	Potable	1/15/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0368	Roslyn Middle School	1028	Corridor (Library-Room 118)	Fountain	Potable	1/15/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0376	Roslyn Middle School	1035	Room 611	Home Eco. Faucet	Potable	1/15/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0377	Roslyn Middle School	1035	Room 611	Home Eco. Faucet	Potable	1/15/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0378	Roslyn Middle School	1035	Room 611	Home Eco. Faucet	Potable	1/15/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0379	Roslyn Middle School	1035	Room 611	Home Eco. Faucet	Potable	1/15/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0380	Roslyn Middle School	1036	Girls Locker Room	Fountain	Potable	1/15/2020	1.1	Samples Passed, No Action Needed
RSLN0381	Roslyn Middle School	1036	Girls Locker Room	Fountain	Potable	1/15/2020	2	Samples Passed, No Action Needed

RSLN0382	Roslyn Middle School	1042	Boys Locker Room Bathroom	Bathroom Faucet	Non-Potable	1/15/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0383	Roslyn Middle School	1042	Boys Locker Room Bathroom	Bathroom Faucet	Non-Potable	1/15/2020	5.4	Samples Passed, No Action Needed
RSLN0384	Roslyn Middle School	1042	Boys Locker Room Bathroom	Bathroom Faucet	Non-Potable	3/10/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0385	Roslyn Middle School	1036B1	Girls Locker Room Coach's Office Bathroom	Bathroom Faucet	Non-Potable	1/15/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0386	Roslyn Middle School	1037	Gymnasium	Water Cooler	Potable	1/15/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0387	Roslyn Middle School	1037	Gymnasium	Water Cooler	Potable	1/15/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0388	Roslyn Middle School	1038	Corridor (Room 611-Corridor 1031)	Fountain	Potable	1/15/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0389	Roslyn Middle School	1038	Corridor (Room 611-Corridor 1031)	Fountain	Potable	1/15/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0392	Roslyn Middle School	1040B2	Kitchen	Kitchen-Food Prep	Potable	1/15/2020	2.2	Samples Passed, No Action Needed
RSLN0393	Roslyn Middle School	1040B2	Kitchen	Kitchen-Food Prep	Potable	1/15/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0394	Roslyn Middle School	1040B2	Kitchen	Kitchen-Food Prep	Potable	1/15/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0395	Roslyn Middle School	1040B2	Kitchen	Kitchen-Food Prep	Potable	1/15/2020	1.5	Samples Passed, No Action Needed
RSLN0396	Roslyn Middle School	1040B2	Kitchen	Kitchen-Food Prep	Potable	1/15/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0397	Roslyn Middle School	1040B2C	Kitchen Locker Room/Bathroom	Bathroom Faucet	Non-Potable	1/15/2020	1	Samples Passed, No Action Needed
RSLN0399	Roslyn Middle School	1041	Cafeteria South	Water Cooler	Potable	1/15/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0400	Roslyn Middle School	1036A1	Girls Locker Room Bathroom	Bathroom Faucet	Non-Potable	1/15/2020	1.4	Samples Passed, No Action Needed
RSLN0401	Roslyn Middle School	1036A1	Girls Locker Room Bathroom	Bathroom Faucet	Non-Potable	1/15/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0402	Roslyn Middle School	1036A1	Girls Locker Room Bathroom	Bathroom Faucet	Non-Potable	1/15/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0403	Roslyn Middle School	1042A	Boys Locker Room	Fountain	Potable	1/15/2020	1.3	Samples Passed, No Action Needed
RSLN0404	Roslyn Middle School	1042A	Boys Locker Room	Fountain	Potable		Not Functioning	Testing Required Prior to Return to Service
RSLN0405	Roslyn Middle School	1042A2A	Boys Locker Room Coach's Office Bathroom	Bathroom Faucet	Non-Potable	1/15/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0407	Roslyn Middle School	1046A	Boiler Room Stairwell Bathroom	Bathroom Faucet	Non-Potable	1/16/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0408	Roslyn Middle School	1047	Handicap Bathroom	Bathroom Faucet	Non-Potable	1/16/2020	1.4	Samples Passed, No Action Needed
RSLN0409	Roslyn Middle School	1048	Faculty Room	Kitchen-Food Prep	Potable	1/16/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0410	Roslyn Middle School	1048A	Faculty Room Men's Bathroom	Bathroom Faucet	Non-Potable	1/16/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0411	Roslyn Middle School	1048B	Faculty Room Women's Bathroom	Bathroom Faucet	Non-Potable	1/16/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0414	Roslyn Middle School	1056	Custodial Closet	Bathroom Faucet	Non-Potable	1/16/2020	5.3	Samples Passed, No Action Needed
RSLN0417	Roslyn Middle School	1060	Tech A PPS	Kitchen-Food Prep	Potable	1/16/2020	10	Samples Passed, No Action Needed
RSLN0418	Roslyn Middle School	1061	Corridor (Tech A-Boys Bathroom)	Water Cooler	Potable	1/16/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0419	Roslyn Middle School	1068	Corridor (Room 129-Exit)	Water Cooler	Potable	1/16/2020	2	Samples Passed, No Action Needed
RSLN0420	Roslyn Middle School	1070	Health Office	Ice Machine	Potable	1/16/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0421	Roslyn Middle School	1070	Health Office	Nurse's Faucet	Potable	1/16/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0422	Roslyn Middle School	1070A	Health Office Exam Room	Nurse's Faucet	Potable	1/16/2020	1.4	Samples Passed, No Action Needed
RSLN0423	Roslyn Middle School	1070B	Health Office Bathroom	Bathroom Faucet	Non-Potable	1/16/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0424	Roslyn Middle School	A (New Constructio	Trainers Room	Ice Machine	Potable	1/16/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0425	Roslyn Middle School	A (New Constructio	Trainers Room	Classroom Faucet	Non-Potable	1/16/2020	11	Samples Passed, No Action Needed
RSLN0426	Roslyn Middle School	A (New Constructio	Main Office Bathroom	Bathroom Faucet	Non-Potable	1/16/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0427	Roslyn Middle School	A (New Constructio	New Gym Boys Locker Room Bathroom	Bathroom Faucet	Non-Potable	1/16/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0428	Roslyn Middle School	A (New Constructio	New Gym Boys Locker Room Bathroom	Bathroom Faucet	Non-Potable	1/16/2020	2	Samples Passed, No Action Needed
RSLN0429	Roslyn Middle School	A (New Constructio	New Gym Boys Locker Room Bathroom	Bathroom Faucet	Non-Potable	1/16/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0430	Roslyn Middle School	A (New Constructio	New Gym Girls Locker Room Bathroom	Bathroom Faucet	Non-Potable	1/16/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0431	Roslyn Middle School	A (New Constructio	New Gym Girls Locker Room Bathroom	Bathroom Faucet	Non-Potable	1/16/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0432	Roslyn Middle School	A (New Constructio	New Gym Girls Locker Room Bathroom	Bathroom Faucet	Non-Potable	1/16/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0433	Roslyn Middle School	A (New Constructio	New Gym PE Office Bathroom	Bathroom Faucet	Non-Potable	1/16/2020	1.5	Samples Passed, No Action Needed
RSLN0457	Roslyn Middle School	2003	Custodial Closet	Water Cooler	Potable	1/16/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0481	Roslyn Middle School	A (New Constructio	Exterior o/s New Gym	Hose Bib	Potable	1/16/2020	9.3	Samples Passed, No Action Needed
RSLN0482	Roslyn Middle School	A (New Constructio	Exterior o/s New Gym	Hose Bib	Potable	1/16/2020	2.7	Samples Passed, No Action Needed
RSLN0483	Harbor Hill Elementary School	1018	Gym Vestibule	Fountain	Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0484	Harbor Hill Elementary School	A (New Constructio	Multipurpose Room	Classroom Faucet	Non-Potable	1/9/2020	1.3	Samples Passed, No Action Needed
RSLN0485	Roslyn High School	4	Girls Bathroom	Water Cooler	Potable	1/17/2020	<3.0	Samples Passed, No Action Needed
RSLN0486	Roslyn High School	4	Girls Bathroom	Bathroom Faucet	Non-Potable	3/10/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0487	Roslyn High School	4	Girls Bathroom	Bathroom Faucet	Non-Potable	1/17/2020	2.6	Samples Passed, No Action Needed
RSLN0489	Roslyn High School	6	Boys Bathroom	Bathroom Faucet	Non-Potable	3/10/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0490	Roslyn High School	6	Boys Bathroom	Bathroom Faucet	Non-Potable	1/17/2020	1.9	Samples Passed, No Action Needed
RSLN0492	Roslyn High School	16	Bathroom	Bathroom Faucet	Non-Potable	1/17/2020	2.8	Samples Passed, No Action Needed
RSLN0493	Roslyn High School	1000	Men's Bathroom	Water Cooler	Potable	1/17/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0494	Roslyn High School	1000	Men's Bathroom	Water Cooler	Potable	1/17/2020	1	Samples Passed, No Action Needed

RSLN0498	Roslyn High School	1002	Women's Faculty Bathroom	Bathroom Faucet	Non-Potable	1/17/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0501	Roslyn High School	1006	Room 138	Classroom Faucet	Non-Potable	1/17/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0502	Roslyn High School	1016	Foreign Language Study Center	Bottled Water	Potable	1/17/2020	1.5	Samples Passed, No Action Needed
RSLN0503	Roslyn High School	1016	Foreign Language Study Center	Classroom Faucet	Non-Potable	1/17/2020	2.7	Samples Passed, No Action Needed
RSLN0551	Roslyn High School	1030	Men's Bathroom	Water Cooler	Potable	1/17/2020	2.5	Samples Passed, No Action Needed
RSLN0552	Roslyn High School	1031	Room 125 & 124 Science Offices	Classroom Faucet	Non-Potable	1/17/2020	1.3	Samples Passed, No Action Needed
RSLN0553	Roslyn High School	1032	Room 123	Classroom Faucet	Non-Potable	1/17/2020	1.5	Samples Passed, No Action Needed
RSLN0554	Roslyn High School	1037B	Librarian Office	Kitchen-Food Prep	Potable	1/17/2020	1.1	Samples Passed, No Action Needed
RSLN0555	Roslyn High School	1040	Women's Bathroom	Fountain	Potable	1/17/2020	1.3	Samples Passed, No Action Needed
RSLN0556	Roslyn High School	1102	Kitchen	Kitchen-Food Prep	Potable	1/17/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0557	Roslyn High School	1040	Women's Bathroom	Bathroom Faucet	Non-Potable	1/11/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0558	Roslyn High School	1040	Women's Bathroom	Bathroom Faucet	Non-Potable	1/11/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0559	Roslyn High School	1041	Men's Bathroom	Bathroom Faucet	Non-Potable	1/11/2020	1.4	Samples Passed, No Action Needed
RSLN0560	Roslyn High School	1041	Men's Bathroom	Bathroom Faucet	Non-Potable	1/11/2020	1	Samples Passed, No Action Needed
RSLN0562	Roslyn High School	1048A	Girls Coach's Locker Room Bathroom	Bathroom Faucet	Non-Potable	1/11/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0563	Roslyn High School	1048B	Girls Locker Room	Water Cooler	Potable		Not Functioning	Testing Required Prior to Return to Service
RSLN0564	Roslyn High School	1048B1	Girls Locker Room Bathroom/Shower	Bathroom Faucet	Non-Potable	1/11/2020	2.2	Samples Passed, No Action Needed
RSLN0565	Roslyn High School	1048B1	Girls Locker Room Bathroom/Shower	Bathroom Faucet	Non-Potable	1/11/2020	1.2	Samples Passed, No Action Needed
RSLN0566	Roslyn High School	1048B1	Girls Locker Room Bathroom/Shower	Bathroom Faucet	Non-Potable	1/11/2020	4.6	Samples Passed, No Action Needed
RSLN0567	Roslyn High School	1051	Men's Locker Room	Water Cooler	Potable	1/11/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0579	Roslyn High School	1062	Men's Bathroom	Water Cooler	Potable	1/11/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0583	Roslyn High School	1064	Faculty Women's Bathroom	Bathroom Faucet	Non-Potable	1/11/2020	1	Samples Passed, No Action Needed
RSLN0586	Roslyn High School	1071B	English Prep Room Kitchen	Kitchen-Food Prep	Potable	1/11/2020	1.7	Samples Passed, No Action Needed
RSLN0588	Roslyn High School	1083A	Room 112 Computer Room Storage	Kitchen-Food Prep	Non-Potable	1/11/2020	12	Samples Passed, No Action Needed
RSLN0591	Roslyn High School	1088	Guidance Reception	Bottled Water	Potable	1/11/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0596	Roslyn High School	1092	Nurse's Office	Water Cooler	Potable	1/11/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0597	Roslyn High School	1092	Nurse's Office	Nurse's Faucet	Potable	1/11/2020	1.3	Samples Passed, No Action Needed
RSLN0598	Roslyn High School	1092C	Nurse's Office Bathroom	Nurse's Faucet	Potable	1/11/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0599	Roslyn High School	1093A	Faculty Lounge Bathroom	Bathroom Faucet	Non-Potable	1/11/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0600	Roslyn High School	1093C1	Faculty Lounge Vestibule Bathroom	Bathroom Faucet	Non-Potable	1/11/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0601	Roslyn High School	1093	Faculty Lounge	Kitchen-Food Prep	Potable	1/11/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0603	Roslyn High School	1099G	Main Office Men's Bathroom	Bathroom Faucet	Non-Potable	1/11/2020	1.9	Samples Passed, No Action Needed
RSLN0604	Roslyn High School	1099J	Main Office Women's Bathroom	Bathroom Faucet	Non-Potable	1/11/2020	3.1	Samples Passed, No Action Needed
RSLN0605	Roslyn High School	1099K	Main Office Conference Room	Classroom Faucet	Non-Potable	1/11/2020	2.6	Samples Passed, No Action Needed
RSLN0606	Roslyn High School	1099M	Main Office Hallway	Water Cooler	Potable	1/11/2020	1.8	Samples Passed, No Action Needed
RSLN0607	Roslyn High School	1101	Cafeteria	Fountain	Potable	1/11/2020	1.3	Samples Passed, No Action Needed
RSLN0608	Roslyn High School	1101	Cafeteria	Fountain	Potable	1/11/2020	1.7	Samples Passed, No Action Needed
RSLN0609	Roslyn High School	1102	Kitchen	Kitchen-Food Prep	Potable	1/11/2020	2.9	Samples Passed, No Action Needed
RSLN0610	Roslyn High School	1102	Kitchen	Kitchen-Food Prep	Potable	1/11/2020	2.5	Samples Passed, No Action Needed
RSLN0611	Roslyn High School	1102	Kitchen	Kitchen-Food Prep	Potable	1/11/2020	2.7	Samples Passed, No Action Needed
RSLN0612	Roslyn High School	1102	kitchen	Kitchen-Food Prep	Potable	1/11/2020	1.7	Samples Passed, No Action Needed
RSLN0613	Roslyn High School	1102	Kitchen	Kitchen-Food Prep	Potable	1/11/2020	3.9	Samples Passed, No Action Needed
RSLN0614	Roslyn High School	1102	Kitchen	Kitchen-Food Prep	Potable	1/11/2020	<3.0	Samples Passed, No Action Needed
RSLN0615	Roslyn High School	1102	Kitchen	Kitchen-Food Prep	Potable	1/11/2020	1.1	Samples Passed, No Action Needed
RSLN0616	Roslyn High School	1102A	Kitchen Sevring Line	Kitchen-Food Prep	Potable	1/11/2020	3.5	Samples Passed, No Action Needed
RSLN0617	Roslyn High School	1102A	Kitchen Sevring Line	Kitchen-Food Prep	Potable	1/17/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0618	Roslyn High School	1102A	Kitchen Sevring Line	Kitchen-Food Prep	Potable	1/17/2020	1.4	Samples Passed, No Action Needed
RSLN0619	Roslyn High School	1102A	Kitchen Sevring Line	Kitchen-Food Prep	Potable	1/17/2020	1.2	Samples Passed, No Action Needed
RSLN0621	Roslyn High School	1102H	Kitchen Women's Bathroom	Bathroom Faucet	Non-Potable	1/17/2020	1.6	Samples Passed, No Action Needed
RSLN0622	Roslyn High School	1104	Unisex Bathroom	Bathroom Faucet	Non-Potable	1/17/2020	11	Samples Passed, No Action Needed
RSLN0623	Roslyn High School	1105	Unisex Bathroom	Bathroom Faucet	Non-Potable	1/17/2020	14	Samples Passed, No Action Needed
RSLN0624	Roslyn High School	A (New Constructio	North Gym	Water Cooler	Potable	1/17/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0625	Roslyn High School	A (New Constructio	North Gym	Water Cooler	Potable	1/17/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0627	Roslyn High School	1048B	Girl's Locker Room	Fountain	Potable	1/17/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0628	Roslyn High School	2001	Men's Bathroom	Fountain	Potable	1/17/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0632	Roslyn High School	2004	Staff Bathroom	Bathroom Faucet	Non-Potable	1/18/2020	1	Samples Passed, No Action Needed
RSLN0635	Roslyn High School	2008	Social Studies Offices	Classroom Faucet	Non-Potable	1/17/2020	1.1	Samples Passed, No Action Needed
RSLN0636	Roslyn High School	2023	Team Locker Room	Bathroom Faucet	Non-Potable	1/17/2020	4.2	Samples Passed, No Action Needed

RSLN0637	Roslyn High School	2023	Team Locker Room	Bathroom Faucet	Non-Potable	1/17/2020	7.1	Samples Passed, No Action Needed
RSLN0638	Roslyn High School	2024B	Training Vestibule	Ice Machine	Potable	1/17/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0639	Roslyn High School	2024	Training Vestibule	Bathroom Faucet	Non-Potable	1/17/2020	1.5	Samples Passed, No Action Needed
RSLN0640	Roslyn High School	2024	Training Vestibule	Bathroom Faucet	Non-Potable	1/17/2020	8.8	Samples Passed, No Action Needed
RSLN0641	Roslyn High School	2024	Training Vestibule	Bathroom Faucet	Non-Potable	1/17/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0643	Roslyn High School	2026	Physical Education & Athletics Room	Water Cooler	Potable	1/17/2020	2	Samples Passed, No Action Needed
RSLN0648	Roslyn High School	2032	Women's Bathroom	Fountain	Potable	1/17/2020	1.2	Samples Passed, No Action Needed
RSLN0689	Roslyn High School	2046	Math Offices	Classroom Faucet	Non-Potable	1/17/2020	1	Samples Passed, No Action Needed
RSLN0690	Roslyn High School	2046	Math Offices	Bottled Water	Potable	1/17/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0691	Roslyn High School	2057	Room 242	Kitchen-Food Prep	Potable	1/17/2020	4.3	Samples Passed, No Action Needed
RSLN0696	Roslyn High School	2067	Men's Bathroom	Bathroom Faucet	Non-Potable	1/17/2020	1.5	Samples Passed, No Action Needed
RSLN0697	Roslyn High School	2067	Men's Bathroom	Bathroom Faucet	Non-Potable	1/17/2020	2.5	Samples Passed, No Action Needed
RSLN0698	Roslyn High School	2068	Corridor	Water Cooler	Potable	1/17/2020	1.3	Samples Passed, No Action Needed
RSLN0700	Roslyn High School	N/A	Field House	Fountain	Potable		Not Functioning	Testing Required Prior to Return to Service
RSLN0701	Hilltop Academy	1002	Classroom	Classroom Faucet	Non-Potable	01/17/20	2.6	Samples Passed, No Action Needed
RSLN0702	Hilltop Academy	1002	Classroom	Classroom Faucet	Non-Potable	01/17/20	4.8	Samples Passed, No Action Needed
RSLN0703	Hilltop Academy	1003A	East Stairwell Men's Bathroom	Bathroom Faucet	Non-Potable	01/17/20	5	Samples Passed, No Action Needed
RSLN0704	Hilltop Academy	2000	Women's Bathroom in Stairwell	Bathroom Faucet	Non-Potable	01/17/20	2.3	Samples Passed, No Action Needed
RSLN0705	Hilltop Academy	2001	2nd Floor Common Area	Water Cooler	Potable	01/17/20	1.2	Samples Passed, No Action Needed
RSLN0706	Roslyn Administration Building	1006	Women's Bathroom	Bathroom Faucet	Non-Potable	3/10/2020	6.9	Samples Passed, No Action Needed
RSLN0707	Roslyn Administration Building	1007	Break & Print Room	Bottled Water	Potable	1/18/2020	1.2	Samples Passed, No Action Needed
RSLN0708	Roslyn Administration Building	1007	Break & Print Room	Kitchen-Food Prep	Potable	1/18/2020	3	Samples Passed, No Action Needed
RSLN0709	Roslyn Administration Building	1008	Men's Bathroom	Bathroom Faucet	Non-Potable	1/18/2020	9	Samples Passed, No Action Needed
RSLN0711	Roslyn Administration Building	2000	Women's Bathroom	Bathroom Faucet	Non-Potable	1/18/2020	3.9	Samples Passed, No Action Needed
RSLN0712	Roslyn Administration Building	2000	Women's Bathroom	Bathroom Faucet	Non-Potable	1/18/2020	4.8	Samples Passed, No Action Needed
RSLN0713	Roslyn Administration Building	2001A2	Superintendent Office Bathroom	Bathroom Faucet	Non-Potable	3/10/2020	24	Placarded for Non-Drinking Use
RSLN0714	Roslyn Administration Building	2004	Assist. Superintendent of Curriculum	Bottled Water	Potable	1/18/2020	1	Samples Passed, No Action Needed
RSLN0715	Roslyn Administration Building	2006	Kitchen	Classroom Faucet	Non-Potable	1/18/2020	2.7	Samples Passed, No Action Needed
RSLN0716	Roslyn Administration Building	2006B	Kitchen Bathroom	Bathroom Faucet	Non-Potable	1/18/2020	1.5	Samples Passed, No Action Needed
RSLN0717	East Hills Elementary School	1015	Room 50	Fountain	Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0718	East Hills Elementary School	1035	Gymnasium	Fountain	Potable	1/8/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0719	The Heights School	1037	Room 31	Classroom Faucet	Non-Potable	1/16/2020	1.7	Samples Passed, No Action Needed
RSLN0720	The Heights School	1028	Room 29	Classroom Faucet	Non-Potable	2/4/2020	4.1	Samples Passed, No Action Needed
RSLN0721	The Heights School	1025	Room 28	Fountain	Potable	1/14/2020	2.8	Samples Passed, No Action Needed
RSLN0722	The Heights School	1006A	Kitchen	Kitchen-Food Prep	Potable	1/14/2020	1.8	Samples Passed, No Action Needed
RSLN0728	Roslyn High School	1048B1	Girls Locker Room Bathroom/Shower	Bathroom Faucet	Non-Potable	1/17/2020	3.7	Samples Passed, No Action Needed
RSLN0729	Harbor Hill Elementary School	1030	Cafeteria/Auditorium	Water Cooler	Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0730	Harbor Hill Elementary School	1018	Gym Vestibule	Water Cooler	Potable	1/9/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0731	The Heights School	1028	Room 29	Fountain	Potable	1/16/2020	1.7	Samples Passed, No Action Needed
RSLN0741	Roslyn Middle School	1028	Corridor (Library-Room 118)	Water Cooler	Potable	1/16/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0742	Roslyn Middle School	1041	Cafeteria South	Fountain	Potable	1/16/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0732	Roslyn Maintenance Building	1011	Shop Room	Water Cooler	Potable	1/18/2020	1.7	Samples Passed, No Action Needed
RSLN0733	Roslyn Maintenance Building	1013A	Bathroom	Bathroom Faucet	Non-Potable	1/18/2020	1.1	Samples Passed, No Action Needed
RSLN0734	Roslyn Maintenance Building	1013A	Bathroom	Bathroom Faucet	Non-Potable	1/18/2020	1.7	Samples Passed, No Action Needed
RSLN0735	Roslyn Maintenance Building	1014	Lounge	Kitchen-Food Prep	Potable	1/18/2020	1.1	Samples Passed, No Action Needed
RSLN0736	Roslyn Maintenance Building	1015C	Main Office Bathroom	Bathroom Faucet	Non-Potable	1/18/2020	2.6	Samples Passed, No Action Needed
RSLN0737	Roslyn Maintenance Building	A (New Constructi	Bus Garage	Kitchen-Food Prep	Potable	1/18/2020	2	Samples Passed, No Action Needed
RSLN0738	Roslyn Maintenance Building	A (New Constructi	Bus Garage	Kitchen-Food Prep	Potable	1/18/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0739	Roslyn Maintenance Building	A (New Constructi	Bus Garage Bathroom	Bathroom Faucet	Non-Potable	3/10/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0743	Roslyn Middle School	1060	Tech A PPS	Water Cooler	Potable	1/16/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0744	Roslyn High School	1040	Women's Bathroom	Water Cooler	Potable	1/17/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0745	Roslyn High School	A (New Constructi	North Gym	Water Cooler	Potable	1/17/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0746	Roslyn High School	2001	Men's Bathroom	Water Cooler	Potable	1/17/2020	<3.0 ND	Samples Passed, No Action Needed
RSLN0747	Roslyn High School	2032	Women's Bathroom	Water Cooler	Potable	1/17/2020	1.2	Samples Passed, No Action Needed
RSLN0748	Hilltop Academy	2001	2nd Floor Common Area	Water Cooler	Potable	01/17/20	<3.0 ND	Samples Passed, No Action Needed
RSLN0749	Roslyn Administration Building	2001	Superintendent Office	Kitchen-Food Prep	Potable	1/18/2020	2.9	Samples Passed, No Action Needed
RSLN0750	Roslyn High School	N/A	Field House	Ice Machine	Potable	1/18/2020	<3.0 ND	Samples Passed, No Action Needed

RSLN0751	Roslyn High School	N/A	Field House	Kitchen-Food Prep	Potable	1/18/2020	5.9	Samples Passed, No Action Needed
RSLN0752	Roslyn High School	N/A	Field House	Fountain	Potable		Not Functioning	Testing Required Prior to Return to Service
RSLN0758	Roslyn High School	1101	Cafeteria	Water Cooler	Potable		Not Functioning	Testing Required Prior to Return to Service
RSLN0765	Roslyn High School	1048B	Girl's Locker Room	Water Cooler	Potable		Not Functioning	Testing Required Prior to Return to Service

Attachment 2:

Chain of Custody
&
Laboratory Analysis


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

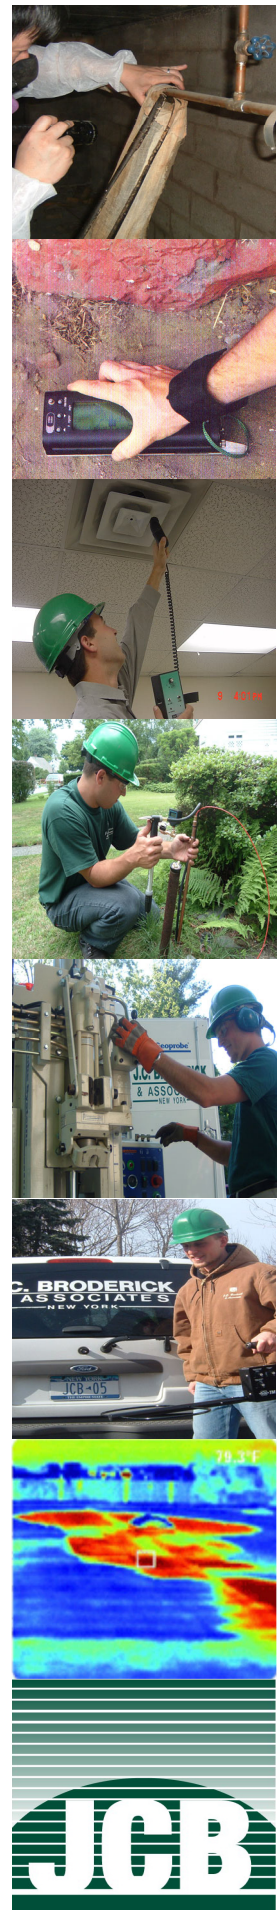



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: EHS

Client:

Roslyn UFSD

Turn Around: Normal (twk) Rush

Page 1 of 7

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN-0002	CR	CF	11	Room 65	1/7/20	4:51 AM
RSLYN-0003	CR	CF	12	Room 64	1/7/20	4:48 AM
RSLYN-0004	CR	DW	1000	Room 45	1/7/20	4:51 AM 5:01 AM
RSLYN-0005	CR	CF	1000	Room 45	1/7/20	5:01 AM
RSLYN-0006	0007 CR	DW	1001	Room 44	1/7/20	5:03 AM
RSLYN-0007	0006 CR	CF	1001	Room 44	1/7/20	5:04 AM
RSLYN-0008	BR	BF	1002	Student Bathroom Outside Room 44	1/7/20	5:07 AM
RSLYN-0009	BR	BF	1003	Student Bathroom Outside Room 45	1/7/20	5:07 AM
RSLYN-0010	BR	BF	1004	Student Bathroom Outside Room 43	1/7/20	5:08 AM
RSLYN-0011	BR	BF	1005	Student Bathroom Outside Room 46	1/7/20	5:09 AM
RSLYN-0012	CR	DW	1006	Room 43	1/7/20	5:10 AM
RSLYN-0013	CR	CF	1006	Room 43	1/7/20	5:11 AM
RSLYN-0014	0015 CR	DW	1007	Room 46	1/7/20	5:14 AM
RSLYN-0015	0014 CR	CF	1007	Room 46	1/7/20	5:13 AM
RSLYN-0016	CR	DW	1009	Room 47	1/7/20	5:16 AM
RSLYN-0017	CR	CF	1009	Room 47	1/7/20	5:16 AM
RSLYN-0018	CR	DW	1010	Room 41	1/7/20	5:18 AM
RSLYN-0019	CR	CF	1010	Room 41	1/7/20	5:19 AM

Building Address

East Hills Elementary School

400 Round Hill Road

Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: NICHOLAS SALERNO

Samplers Signature: N. Salerno

JCB Project Manager:

Anthony Lombardo
Alexa McDonald 1/13/20 for 1/9/20

062000335

1/7/20 12:11 PM

ANALYTICAL INC.
CARLE PLACE, NY



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006
Building: EHS

Client:
Roslyn UFSD

Turn Around: Normal (twk) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN-0020	CR	DW	1011	Room 48	1/7/20	5:20 AM
RSLYN-0021	CR	CF	1011	Room 48	1/7/20	5:21 AM
RSLYN-0022	CR	DW	1012	Room 40	1/7/20	5:22 AM
RSLYN-0023	CR	CF	1012	Room 40	1/7/20	5:23 AM
RSLYN-0024	CR	DW	1013	Room 49	1/7/20	5:26 AM
RSLYN-0025	CR	CF	1013	Room 49	1/7/20	5:26 AM
RSLYN-0026	CR	DW	1014	Room 39	1/7/20	5:29 AM
RSLYN-0027	CR	CF	1014	Room 39	1/7/20	5:29 AM
RSLYN-0028	CR	DW	1015	Room 50	1/7/20	5:31 AM
RSLYN-0029	HA	WC	1015	Room 50	1/7/20	5:33 AM
RSLYN-0030	CR	CF	1015	Room 50	1/7/20	5:32 AM
RSLYN-0031	BR	BF	1016	Handicap Bathroom	1/7/20	5:36 AM
RSLYN-0032	BB	BF	1019	Boy's Bathroom	1/7/20	5:37 AM
RSLYN-0033	BB	BF	1019	Boy's Bathroom	1/7/20	5:38 AM
RSLYN-0035	GB	BF	1021	Girl's Bathroom	1/7/20	5:39 AM
RSLYN-0036	GB	BF	1021	Girl's Bathroom	1/7/20	5:40 AM
RSLYN-0037	LI	CF	1024	Room 36 Library	1/7/20	5:41 AM
RSLYN-0038	OF	BF	1026C2	Principal's Office Bathroom	1/7/20	5:42 AM

Building Address

East Hills Elementary School
400 Round Hill Road
Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Michelle DeLia
1/7/20 12:11 PM

Samplers Name: *NICHOLAS SALERNO*

Samplers Signature:

JCB Project Manager:

Anthony Lombardo
Auppa m. Lombardo 1/9/20

ADDITIONAL NO.
SAMPLES IN

062000335



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: EHS

Client:

Roslyn UFSD

Turn Around: Normal (twk) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN-0039	NO	NS	1031A	Room 5 Health Office	1/7/20	5:45 AM
RSLYN-0040	NO	BF	1031B4	Room 5 Health Office Hallway Bathroom	1/7/20	5:44 AM
RSLYN-0041	CR	WC	1035	Gymnasium	1/7/20	5:48 AM
RSLYN-0042	FBR	BF	1037	Staff Bathroom	1/7/20	5:51 AM
RSLYN-0043	FL	BF	1042A	Room 17 Faculty Lounge Bathroom	1/7/20	5:54 AM
RSLYN-0044	FL	KC	1042	Room 17 Faculty Lounge	1/7/20	5:53 AM
RSLYN-0045	GB	BF	1043	Girl's Bathroom	1/7/20	5:56 AM
RSLYN-0046	GB	BF	1043	Girl's Bathroom	1/7/20	5:56 AM
RSLYN-0047	BB	BF	1044	Boy's Bathroom	1/7/20	5:57 AM
RSLYN-0048	BB	BF	1044	Boy's Bathroom	1/7/20	5:57 AM
RSLYN-0049	CR	DW	1046	Room 18	1/7/20	5:59 AM
RSLYN-0050	CR	CF	1046	Room 18	1/7/20	5:59 AM
RSLYN-0054	CR	DW	1048	Room 20	1/7/20	6:03 AM
RSLYN-0055	CR	CF	1048	Room 20	1/7/20	6:03 AM
RSLYN-0056	CR	BF	1048B	Room 20 Bathroom	1/7/20	6:04 AM
RSLYN-0057	CR	DW	1049	Room 21	1/7/20	6:01 AM
RSLYN-0058	CR	CF	1049	Room 21	1/7/20	6:01 AM
RSLYN-0059	CR	BF	1049B	Room 21 Bathroom	1/7/20	6:02 AM

Building Address

East Hills Elementary School

400 Round Hill Road

Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5

Lab Received:

Signature:

1/7/20 12:11 PM

Samplers Name:

Samplers Signature:

JCB Project Manager:

Super m. on 1/9/20



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006
Building: EHS

Client:
Roslyn UFSD

Turn Around: Normal (7-10) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN-0060	CR	DW	1050	Room 22	1/7/20	6:07 AM
RSLYN-0061	CR	CF	1050	Room 22	1/7/20	6:07 AM
RSLYN-0062	CR	BF	1050	Room 22 Bathroom	1/7/20	6:08 AM
RSLYN-0064	CR	DW	1056	Room 23	1/7/20	6:12 AM
RSLYN-0065	CR	CF	1056	Room 23	1/7/20	6:12 AM
RSLYN-0066	CR	BF	1056A	Room 23 Bathroom	1/7/20	6:13 AM
RSLYN-0067	CR	DW	1057	Room 24	1/7/20	6:15 AM
RSLYN-0068	CR	CF	1057	Room 24	1/7/20	6:15 AM
RSLYN-0069	CR	BF	1057A	Room 24 Bathroom	1/7/20	6:15 AM
RSLYN-0070	CR	DW	1058	Room 25	1/7/20	6:18 AM
RSLYN-0071	CR	BF	1058B	Room 25 Bathroom	1/7/20	6:18 AM
RSLYN-0072	CR	CF	1058	Room 25	1/7/20	6:18 AM
RSLYN-0073	KI	KC	1061A	Cafeteria Kitchen	1/7/20	6:24 AM
RSLYN-0074	KI	KC	1061A	Cafeteria Kitchen	1/7/20	6:24 AM
RSLYN-0075	KI	KC	1061A	Cafeteria Kitchen	1/7/20	6:25 AM
RSLYN-0076	KI	KC	1061A	Cafeteria Kitchen	1/7/20	6:25 AM
RSLYN-0077	KI	KC	1061A	Cafeteria Kitchen	1/7/20	6:25 AM
RSLYN-0078	KI	SN	1061A	Cafeteria Kitchen	1/7/20	6:26 AM

Building Address

East Hills Elementary School
400 Round Hill Road
Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5

Lab Received:

Signature:

1/7/20 12:11 PM

Samplers Name: Nicholas Salerno

Samplers Signature:

JCB Project Manager:

Super m. paid 1/9/20



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: EHS

Client: Roslyn UFSD

Turn Around: Normal (4wks) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN-0079	KI	SN	1061A	Cafeteria Kitchen	1/7/20	6:27 am
RSLYN-0080	HA	WC	1062	Room 27	1/7/20	6:29 am
RSLYN-0081	HA	WC	1062	Room 27	1/7/20	6:29 am
RSLYN-0082	CR	DW	1062	Room 27	1/7/20	6:34 am
RSLYN-0083	CR	CF	1062	Room 27	1/7/20	6:34 am
RSLYN-0084	CR	DW	1062	Room 28	1/7/20	6:37 am
RSLYN-0085	CR	BF	1062B	Room 27 Bathroom	1/7/20	6:35 am
RSLYN-0086	0087 CR	BF	1062B	Room 28 Bathroom	1/7/20	6:36 am
RSLYN-0087	0086 CR	CF	1063	Room 28	1/7/20	6:37 am
RSLYN-0089	CR	DW	1064	Room 29	1/7/20	6:41 am
RSLYN-0090	CR	CF	1064	Room 29	1/7/20	6:42 am
RSLYN-0091	CR	BF	1064B	Room 29 Bathroom	1/7/20	6:42 am
RSLYN-0092	WBR	BF	1068	Women's Bathroom	1/7/20	6:49 am
RSLYN-0093	MBR	BF	1069	Men's Bathroom	1/7/20	6:50 am
RSLYN-0095	CR	DW	2001	Room 58	1/7/20	6:55 am
RSLYN-0096	CR	CF	2001	Room 58	1/7/20	6:55 am
RSLYN-0097	CR	DW	2002	Room 57	1/7/20	6:57 am
RSLYN-0098	CR	CF	2002	Room 57	1/7/20	6:57 am

Building Address

East Hills Elementary School

400 Round Hill Road

Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5

Lab Recieved: Michelle Bell

Signature: M. Dea

1/7/20 12:11 PM

Samplers Name: NICHOLAS SALERNO

Samplers Signature: N. Salerno

JCB Project Manager: ANTHONY LOMBARDO

Anthony Lombardo 1/9/20

062000335



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: EHS

Client:

Roslyn UFSD

Turn Around: Normal (1wk) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN-0020	CR	DW	1011	Room 48	1/7/20	5:20 AM
RSLYN-0021	CR	CF	1011	Room 48	1/7/20	5:21 AM
RSLYN-0022	CR	DW	1012	Room 40	1/7/20	5:22 AM
RSLYN-0023	CR	CF	1012	Room 40	1/7/20	5:23 AM
RSLYN-0024	CR	DW	1013	Room 49	1/7/20	5:26 AM
RSLYN-0025	CR	CF	1013	Room 49	1/7/20	5:26 AM
RSLYN-0026	CR	DW	1014	Room 39	1/7/20	5:29 AM
RSLYN-0027	CR	CF	1014	Room 39	1/7/20	5:29 AM
RSLYN-0028	CR	DW	1015	Room 50	1/7/20	5:31 AM
RSLYN-0029	HA	WC	1015	Room 50	1/7/20	5:33 AM
RSLYN-0030	CR	CF	1015	Room 50	1/7/20	5:32 AM
RSLYN-0031	BR	BF	1016	Handicap Bathroom	1/7/20	5:36 AM
RSLYN-0032	BB	BF	1019	Boy's Bathroom	1/7/20	5:37 AM
RSLYN-0033	BB	BF	1019	Boy's Bathroom	1/7/20	5:38 AM
RSLYN-0035	GB	BF	1021	Girl's Bathroom	1/7/20	5:39 AM
RSLYN-0036	GB	BF	1021	Girl's Bathroom	1/7/20	5:40 AM
RSLYN-0037	LI	CF	1024	Room 36 Library	1/7/20	5:41 AM
RSLYN-0038	OF	BF	1026C2	Principal's Office Bathroom	1/7/20	5:42 AM

Building Address

East Hills Elementary School

400 Round Hill Road

Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Michelle DeLo
1/7/20 12:11 PM

Samplers Name: NICHOLAS SALERNO

Samplers Signature:

JCB Project Manager:

N. Salerno
ANTHONY LOMBARDO

20 JAN - 7 PM 12:11
CAMP PIACE VV
ANALYTICAL INC.

062000335



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: EHS

Client:

Roslyn UFSD

Turn Around: Normal (1wk) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN-0039	NO	NS	1031A	Room 5 Health Office	1/7/20	5:45AM
RSLYN-0040	NO	BF	1031B4	Room 5 Health Office Hallway Bathroom	1/7/20	5:44AM
RSLYN-0041	CR	WC	1035	Gymnasium	1/7/20	5:48AM
RSLYN-0042	FBR	BF	1037	Staff Bathroom	1/7/20	5:51AM
RSLYN-0043	FL	BF	1042A	Room 17 Faculty Lounge Bathroom	1/7/20	5:54AM
RSLYN-0044	FL	KC	1042	Room 17 Faculty Lounge	1/7/20	5:53AM
RSLYN-0045	GB	BF	1043	Girl's Bathroom	1/7/20	5:56AM
RSLYN-0046	GB	BF	1043	Girl's Bathroom	1/7/20	5:56AM
RSLYN-0047	BB	BF	1044	Boy's Bathroom	1/7/20	5:57AM
RSLYN-0048	BB	BF	1044	Boy's Bathroom	1/7/20	5:57AM
RSLYN-0049	CR	DW	1046	Room 18	1/7/20	5:59AM
RSLYN-0050	CR	CF	1046	Room 18	1/7/20	5:59AM
RSLYN-0054	CR	DW	1048	Room 20	1/7/20	6:03AM
RSLYN-0055	CR	CF	1048	Room 20	1/7/20	6:03AM
RSLYN-0056	CR	BF	1048B	Room 20 Bathroom	1/7/20	6:04AM
RSLYN-0057	CR	DW	1049	Room 21	1/7/20	6:01AM
RSLYN-0058	CR	CF	1049	Room 21	1/7/20	6:01AM
RSLYN-0059	CR	BF	1049B	Room 21 Bathroom	1/7/20	6:02AM

Building Address

East Hills Elementary School

400 Round Hill Road

Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5

Lab Received:

Signature:

1/7/20 12:11PM

Samplers Name:

Samplers Signature:

JCB Project Manager:

NICHOLAS SALENZO

N. Salenzo

ANTHONY LAMARCA



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: EHS

Client:

Roslyn UFSD

Turn Around: Normal Check Rush

Page 4 of 7

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN-0060	CR	DW	1050	Room 22	1/7/20	6:07 AM
RSLYN-0061	CR	CF	1050	Room 22	1/7/20	6:07 AM
RSLYN-0062	CR	BF	1050	Room 22 Bathroom	1/7/20	6:08 AM
RSLYN-0064	CR	DW	1056	Room 23	1/7/20	6:12 AM
RSLYN-0065	CR	CF	1056	Room 23	1/7/20	6:12 AM
RSLYN-0066	CR	BF	1056A	Room 23 Bathroom	1/7/20	6:13 AM
RSLYN-0067	CR	DW	1057	Room 24	1/7/20	6:15 AM
RSLYN-0068	CR	CF	1057	Room 24	1/7/20	6:15 AM
RSLYN-0069	CR	BF	1057A	Room 24 Bathroom	1/7/20	6:15 AM
RSLYN-0070	0072 CR	DW	1058	Room 25	1/7/20	6:18 AM
RSLYN-0071	CR	BF	1058B	Room 25 Bathroom	1/7/20	6:18 AM
RSLYN-0072	0070 CR	CF	1058	Room 25	1/7/20	6:18 AM
RSLYN-0073	KI	KC	1061A	Cafeteria Kitchen	1/7/20	6:24 AM
RSLYN-0074	KI	KC	1061A	Cafeteria Kitchen	1/7/20	6:24 AM
RSLYN-0075	KI	KC	1061A	Cafeteria Kitchen	1/7/20	6:25 AM
RSLYN-0076	KI	KC	1061A	Cafeteria Kitchen	1/7/20	6:25 AM
RSLYN-0077	KI	KC	1061A	Cafeteria Kitchen	1/7/20	6:25 AM
RSLYN-0078	KI	SN	1061A	Cafeteria Kitchen	1/7/20	6:26 AM

Building Address

East Hills Elementary School

400 Round Hill Road

Roslyn Heights, New York 11577

Analysis Type: ELAP 200.9

Lab Received:

Signature:

Michelle Dewa

1/7/20 12:11 PM

Samplers Name: Nicholas Salerno

Samplers Signature:

JCB Project Manager: Anthony Lombardo

OrderID: 062000335

062000335



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: EHS

Client:

Roslyn UFSD

Turn Around: Normal (twk) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN-0079	KI	SN	1061A	Cafeteria Kitchen	1/7/20	6:27 am
RSLYN-0080	HA	WC	1062	Room 27	1/7/20	6:29 am
RSLYN-0081	HA	WC	1062	Room 27	1/7/20	6:29 am
RSLYN-0082	CR	DW	1062	Room 27	1/7/20	6:34 am
RSLYN-0083	CR	CF	1062	Room 27	1/7/20	6:34 am
RSLYN-0084	CR	DW	1062	Room 28	1/7/20	6:37 am
RSLYN-0085	CR	BF	1062B	Room 27 Bathroom	1/7/20	6:35 am
RSLYN-0086	0087 CR	BF	1062B	Room 28 Bathroom	1/7/20	6:36 am
RSLYN-0087	0086 CR	CF	1063	Room 28	1/7/20	6:37 am
RSLYN-0089	CR	DW	1064	Room 29	1/7/20	6:41 am
RSLYN-0090	CR	CF	1064	Room 29	1/7/20	6:42 am
RSLYN-0091	CR	BF	1064B	Room 29 Bathroom	1/7/20	6:42 am
RSLYN-0092	WBR	BF	1068	Women's Bathroom	1/7/20	6:49 am
RSLYN-0093	MBR	BF	1069	Men's Bathroom	1/7/20	6:50 am
RSLYN-0095	CR	DW	2001	Room 58	1/7/20	6:55 am
RSLYN-0096	CR	CF	2001	Room 58	1/7/20	6:55 am
RSLYN-0097	CR	DW	2002	Room 57	1/7/20	6:57 am
RSLYN-0098	CR	CF	2002	Room 57	1/7/20	6:57 am

Building Address

East Hills Elementary School

400 Round Hill Road

Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5

Lab Rec'd:

Signature:

1/7/20 12:11 PM

Samplers Name: NICHOLAS SALERNO

Samplers Signature:

JCB Project Manager:

ANTHONY LOMBARDI

062000335



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

1/14/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 1/7/2020. The results are tabulated on the attached data pages for the following client designated project:

**Roslyn UFSD, East Hills Elementary School, 400 Round Hill
Road, Roslyn Heights, New York 11577, EHS Building, 19-45006**

The reference number for these samples is EMSL Order #062000335. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000335

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/07/20 12:11 PM
 Collected: 1/7/2020

Project: **Roslyn UFSD, East Hills Elementary School, 400 Round Hill Road, Roslyn Heights, New York 11577, EHS Building, 19-45006**

Analytical Results

Client Sample Description		RSLYN-0002	Collected:		1/7/2020	Lab ID:		062000335-0001
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0	µg/L	1/8/2020	AL	1/8/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RSLYN-0003	Collected:		1/7/2020	Lab ID:		062000335-0002
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.9	3.0	µg/L	1/8/2020	AL	1/8/2020	AL
Client Sample Description		RSLYN-0004	Collected:		1/7/2020	Lab ID:		062000335-0003
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/8/2020	AL	1/8/2020	AL
Client Sample Description		RSLYN-0005	Collected:		1/7/2020	Lab ID:		062000335-0004
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/8/2020	AL	1/8/2020	AL
Client Sample Description		RSLYN-0007	Collected:		1/7/2020	Lab ID:		062000335-0005
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/8/2020	AL	1/8/2020	AL
Client Sample Description		RSLYN-0006	Collected:		1/7/2020	Lab ID:		062000335-0006
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/8/2020	AL	1/8/2020	AL
Client Sample Description		RSLYN-0008	Collected:		1/7/2020	Lab ID:		062000335-0007
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/8/2020	AL	1/8/2020	AL
Client Sample Description		RSLYN-0009	Collected:		1/7/2020	Lab ID:		062000335-0008
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000335

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/07/20 12:11 PM
 Collected: 1/7/2020

Project: Roslyn UFSD, East Hills Elementary School, 400 Round Hill Road, Roslyn Heights, New York 11577, EHS Building, 19-45006

Analytical Results

Client Sample Description RSLYN-0009 **Collected:** 1/7/2020 **Lab ID:** 062000335-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	AL	1/8/2020	AL

Client Sample Description RSLYN-0010 **Collected:** 1/7/2020 **Lab ID:** 062000335-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	AL	1/9/2020	AM

Client Sample Description RSLYN-0011 **Collected:** 1/7/2020 **Lab ID:** 062000335-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	1/8/2020	AL	1/9/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLYN-0012 **Collected:** 1/7/2020 **Lab ID:** 062000335-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	1/8/2020	AL	1/9/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLYN-0013 **Collected:** 1/7/2020 **Lab ID:** 062000335-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	AL	1/9/2020	AM

Client Sample Description RSLYN-0015 **Collected:** 1/7/2020 **Lab ID:** 062000335-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	AL	1/9/2020	AM

Client Sample Description RSLYN-0014 **Collected:** 1/7/2020 **Lab ID:** 062000335-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	1/8/2020	AL	1/9/2020	AM

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000335

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/07/20 12:11 PM
 Collected: 1/7/2020

Project: Roslyn UFSD, East Hills Elementary School, 400 Round Hill Road, Roslyn Heights, New York 11577, EHS Building, 19-45006

Analytical Results

Client Sample Description RSLYN-0016 **Collected:** 1/7/2020 **Lab ID:** 062000335-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	AL	1/9/2020	AM

Client Sample Description RSLYN-0017 **Collected:** 1/7/2020 **Lab ID:** 062000335-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.7	3.0 µg/L	1/8/2020	AL	1/9/2020	AM

Client Sample Description RSLYN-0018 **Collected:** 1/7/2020 **Lab ID:** 062000335-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	1/8/2020	AL	1/9/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLYN-0019 **Collected:** 1/7/2020 **Lab ID:** 062000335-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0 µg/L	1/8/2020	AL	1/9/2020	AM

Client Sample Description RSLYN-0020 **Collected:** 1/7/2020 **Lab ID:** 062000335-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	AL	1/9/2020	AM

Client Sample Description RSLYN-0021 **Collected:** 1/7/2020 **Lab ID:** 062000335-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	AL	1/9/2020	AM

Client Sample Description RSLYN-0022 **Collected:** 1/7/2020 **Lab ID:** 062000335-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	AL	1/9/2020	AM

Client Sample Description RSLYN-0023 **Collected:** 1/7/2020 **Lab ID:** 062000335-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000335

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/07/20 12:11 PM
 Collected: 1/7/2020

Project: **Roslyn UFSD, East Hills Elementary School, 400 Round Hill Road, Roslyn Heights, New York 11577, EHS Building, 19-45006**

Analytical Results

Client Sample Description		RSLYN-0023		Collected:	1/7/2020	Lab ID:	062000335-0022	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/8/2020	AL	1/9/2020	AM
Client Sample Description		RSLYN-0024		Collected:	1/7/2020	Lab ID:	062000335-0023	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/8/2020	AL	1/9/2020	AM
Client Sample Description		RSLYN-0025		Collected:	1/7/2020	Lab ID:	062000335-0024	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/8/2020	AL	1/9/2020	AM
Client Sample Description		RSLYN-0026		Collected:	1/7/2020	Lab ID:	062000335-0025	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/8/2020	AL	1/9/2020	AM
Client Sample Description		RSLYN-0027		Collected:	1/7/2020	Lab ID:	062000335-0026	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/8/2020	AL	1/9/2020	AM
Client Sample Description		RSLYN-0028		Collected:	1/7/2020	Lab ID:	062000335-0027	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0	µg/L	1/8/2020	AL	1/9/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		RSLYN-0029		Collected:	1/7/2020	Lab ID:	062000335-0028	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/8/2020	AL	1/9/2020	AM
Client Sample Description		RSLYN-0030		Collected:	1/7/2020	Lab ID:	062000335-0029	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000335

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/07/20 12:11 PM
 Collected: 1/7/2020

Project: Roslyn UFSD, East Hills Elementary School, 400 Round Hill Road, Roslyn Heights, New York 11577, EHS Building, 19-45006

Analytical Results

Client Sample Description RSLYN-0030 **Collected:** 1/7/2020 **Lab ID:** 062000335-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0031 **Collected:** 1/7/2020 **Lab ID:** 062000335-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0032 **Collected:** 1/7/2020 **Lab ID:** 062000335-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLYN-0033 **Collected:** 1/7/2020 **Lab ID:** 062000335-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLYN-0035 **Collected:** 1/7/2020 **Lab ID:** 062000335-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0036 **Collected:** 1/7/2020 **Lab ID:** 062000335-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0037 **Collected:** 1/7/2020 **Lab ID:** 062000335-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000335

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/07/20 12:11 PM
 Collected: 1/7/2020

Project: Roslyn UFSD, East Hills Elementary School, 400 Round Hill Road, Roslyn Heights, New York 11577, EHS Building, 19-45006

Analytical Results

Client Sample Description RSLYN-0038 **Collected:** 1/7/2020 **Lab ID:** 062000335-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.1	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0039 **Collected:** 1/7/2020 **Lab ID:** 062000335-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLYN-0040 **Collected:** 1/7/2020 **Lab ID:** 062000335-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLYN-0041 **Collected:** 1/7/2020 **Lab ID:** 062000335-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0042 **Collected:** 1/7/2020 **Lab ID:** 062000335-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0043 **Collected:** 1/7/2020 **Lab ID:** 062000335-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0044 **Collected:** 1/7/2020 **Lab ID:** 062000335-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.0	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000335

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/07/20 12:11 PM
 Collected: 1/7/2020

Project: Roslyn UFSD, East Hills Elementary School, 400 Round Hill Road, Roslyn Heights, New York 11577, EHS Building, 19-45006

Analytical Results

Client Sample Description		RSLYN-0045	Collected:	1/7/2020	Lab ID:	062000335-0043		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.6	3.0	µg/L	1/8/2020	DI	1/9/2020	AM
Client Sample Description		RSLYN-0046	Collected:	1/7/2020	Lab ID:	062000335-0044		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0	µg/L	1/8/2020	DI	1/9/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		RSLYN-0047	Collected:	1/7/2020	Lab ID:	062000335-0045		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0	µg/L	1/8/2020	DI	1/9/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		RSLYN-0048	Collected:	1/7/2020	Lab ID:	062000335-0046		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0	µg/L	1/8/2020	DI	1/9/2020	AM
Client Sample Description		RSLYN-0049	Collected:	1/7/2020	Lab ID:	062000335-0047		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/8/2020	DI	1/9/2020	AM
Client Sample Description		RSLYN-0050	Collected:	1/7/2020	Lab ID:	062000335-0048		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/8/2020	DI	1/9/2020	AM
Client Sample Description		RSLYN-0054	Collected:	1/7/2020	Lab ID:	062000335-0049		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0	µg/L	1/8/2020	DI	1/9/2020	AM
Lead MDL: 1.0ug/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000335

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/07/20 12:11 PM
 Collected: 1/7/2020

Project: **Roslyn UFSD, East Hills Elementary School, 400 Round Hill Road, Roslyn Heights, New York 11577, EHS Building, 19-45006**

Analytical Results

Client Sample Description RSLYN-0055 **Collected:** 1/7/2020 **Lab ID:** 062000335-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	1/8/2020	DI	1/9/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLYN-0056 **Collected:** 1/7/2020 **Lab ID:** 062000335-0051

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	10	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0057 **Collected:** 1/7/2020 **Lab ID:** 062000335-0052

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0058 **Collected:** 1/7/2020 **Lab ID:** 062000335-0053

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	1/8/2020	DI	1/9/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLYN-0059 **Collected:** 1/7/2020 **Lab ID:** 062000335-0054

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	1/8/2020	DI	1/9/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLYN-0060 **Collected:** 1/7/2020 **Lab ID:** 062000335-0055

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	1/8/2020	DI	1/9/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLYN-0061 **Collected:** 1/7/2020 **Lab ID:** 062000335-0056

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000335

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/07/20 12:11 PM
 Collected: 1/7/2020

Project: Roslyn UFSD, East Hills Elementary School, 400 Round Hill Road, Roslyn Heights, New York 11577, EHS Building, 19-45006

Analytical Results

Client Sample Description RSLYN-0062 **Collected:** 1/7/2020 **Lab ID:** 062000335-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.0	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0064 **Collected:** 1/7/2020 **Lab ID:** 062000335-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0065 **Collected:** 1/7/2020 **Lab ID:** 062000335-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0066 **Collected:** 1/7/2020 **Lab ID:** 062000335-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.4	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0067 **Collected:** 1/7/2020 **Lab ID:** 062000335-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0068 **Collected:** 1/7/2020 **Lab ID:** 062000335-0062

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0069 **Collected:** 1/7/2020 **Lab ID:** 062000335-0063

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0072 **Collected:** 1/7/2020 **Lab ID:** 062000335-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000335

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/07/20 12:11 PM
 Collected: 1/7/2020

Project: Roslyn UFSD, East Hills Elementary School, 400 Round Hill Road, Roslyn Heights, New York 11577, EHS Building, 19-45006

Analytical Results

Client Sample Description RSLYN-0072 **Collected:** 1/7/2020 **Lab ID:** 062000335-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0071 **Collected:** 1/7/2020 **Lab ID:** 062000335-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.6	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0070 **Collected:** 1/7/2020 **Lab ID:** 062000335-0066

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLYN-0073 **Collected:** 1/7/2020 **Lab ID:** 062000335-0067

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLYN-0074 **Collected:** 1/7/2020 **Lab ID:** 062000335-0068

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0075 **Collected:** 1/7/2020 **Lab ID:** 062000335-0069

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	DI	1/9/2020	DI

Client Sample Description RSLYN-0076 **Collected:** 1/7/2020 **Lab ID:** 062000335-0070

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.1	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000335

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/07/20 12:11 PM
 Collected: 1/7/2020

Project: **Roslyn UFSD, East Hills Elementary School, 400 Round Hill Road, Roslyn Heights, New York 11577, EHS Building, 19-45006**

Analytical Results

Client Sample Description RSLYN-0077 **Collected:** 1/7/2020 **Lab ID:** 062000335-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	1/8/2020	DI	1/9/2020	DI
Lead MDL: 1.0µg/L							

Client Sample Description RSLYN-0078 **Collected:** 1/7/2020 **Lab ID:** 062000335-0072

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	1/8/2020	DI	1/9/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLYN-0079 **Collected:** 1/7/2020 **Lab ID:** 062000335-0073

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.4	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0080 **Collected:** 1/7/2020 **Lab ID:** 062000335-0074

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0081 **Collected:** 1/7/2020 **Lab ID:** 062000335-0075

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0	3.0 µg/L	1/8/2020	DI	1/9/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLYN-0082 **Collected:** 1/7/2020 **Lab ID:** 062000335-0076

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/8/2020	DI	1/9/2020	AM

Client Sample Description RSLYN-0083 **Collected:** 1/7/2020 **Lab ID:** 062000335-0077

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	1/8/2020	DI	1/9/2020	AM
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000335

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/07/20 12:11 PM
 Collected: 1/7/2020

Project: **Roslyn UFSD, East Hills Elementary School, 400 Round Hill Road, Roslyn Heights, New York 11577, EHS Building, 19-45006**

Analytical Results

Client Sample Description		RSLYN-0084	Collected:		1/7/2020	Lab ID:		062000335-0078
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0	µg/L	1/8/2020	DI	1/9/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		RSLYN-0085	Collected:		1/7/2020	Lab ID:		062000335-0079
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0	µg/L	1/8/2020	DI	1/9/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		RSLYN-0087	Collected:		1/7/2020	Lab ID:		062000335-0080
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0	µg/L	1/8/2020	DI	1/9/2020	DI
Lead MDL: 1.0µg/L								
Client Sample Description		RSLYN-0086	Collected:		1/7/2020	Lab ID:		062000335-0081
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0	µg/L	1/8/2020	DI	1/9/2020	DI
Lead MDL: 1.0µg/L								
Client Sample Description		RSLYN-0089	Collected:		1/7/2020	Lab ID:		062000335-0082
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/8/2020	DI	1/9/2020	DI
Client Sample Description		RSLYN-0090	Collected:		1/7/2020	Lab ID:		062000335-0083
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0	µg/L	1/8/2020	DI	1/9/2020	DI
Lead MDL: 1.0µg/L								
Client Sample Description		RSLYN-0091	Collected:		1/7/2020	Lab ID:		062000335-0084
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0	µg/L	1/8/2020	DI	1/9/2020	DI

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000335

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/07/20 12:11 PM
 Collected: 1/7/2020

Project: **Roslyn UFSD, East Hills Elementary School, 400 Round Hill Road, Roslyn Heights, New York 11577, EHS Building, 19-45006**

Analytical Results

Client Sample Description RSLYN-0092 **Collected:** 1/7/2020 **Lab ID:** 062000335-0085

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.0	3.0 µg/L	1/8/2020	DI	1/9/2020	DI

Client Sample Description RSLYN-0093 **Collected:** 1/7/2020 **Lab ID:** 062000335-0086

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	1/8/2020	DI	1/9/2020	DI
Lead MDL: 1.0µg/L							

Client Sample Description RSLYN-0095 **Collected:** 1/7/2020 **Lab ID:** 062000335-0087

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.2	3.0 µg/L	1/8/2020	DI	1/9/2020	DI

Client Sample Description RSLYN-0096 **Collected:** 1/7/2020 **Lab ID:** 062000335-0088

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0 µg/L	1/8/2020	DI	1/9/2020	DI

Client Sample Description RSLYN-0097 **Collected:** 1/7/2020 **Lab ID:** 062000335-0089

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	1/8/2020	DI	1/9/2020	DI
Lead MDL: 1.0µg/L							

Client Sample Description RSLYN-0098 **Collected:** 1/7/2020 **Lab ID:** 062000335-0090

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	1/8/2020	DI	1/9/2020	DI
Lead MDL: 1.0µg/L							

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: EHS

Client:

Roslyn UFSD

Turn Around: Normal (1 Week) Rush _____

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN-0099	BR	BF	2003A	Room 56 Bathroom	1/8/20	5:05
RSLYN-0100	CR	DW	2005	Room 59	1/8/20	5:06
RSLYN-0101	CR	CF	2005	Room 59	1/8/20	5:06
RSLYN-0102	CR	DW	2006	Room 55	1/8/20	5:08
RSLYN-0103	CR	CF	2006	Room 55	1/8/20	5:08
RSLYN-0104	CR	DW	2007	Room 60	1/8/20	5:10
RSLYN-0105	CR	CF	2007	Room 60	1/8/20	5:10
RSLYN-0106	CR	DW	2008	Room 54	1/8/20	5:12
RSLYN-0107	CR	CF	2008	Room 54	1/8/20	5:12
RSLYN-0108	CR	DW	2009	Room 61	1/8/20	5:13
RSLYN-0109	CR	CF	2009	Room 61	1/8/20	5:13
RSLYN-0110	CR	DW	2010	Room 53	1/8/20	5:15
RSLYN-0111	CR	CF	2010	Room 53	1/8/20	5:15
RSLYN-0112	CR	DW	2011	Room 62	1/8/20	5:16
RSLYN-0113	CR	CF	2011	Room 62	1/8/20	5:16
RSLYN-0114	CR	DW	2012	Room 52	1/8/20	5:18
RSLYN-0115	CR	CF	2012	Room 52	1/8/20	5:18
RSLYN-0116	BR GB	BF	2013 2015	Boy's Bathroom Girl's Bathroom	1/8/20	5:19

Building Address

East Hills Elementary School

400 Round Hill Road

Roslyn Heights, New York 11577

Analysis Type: ELAP 2005

Lab Recieved:

Signature:

200.5 Pb - A. Long 01/10/20

Samplers Name: NICHOLAS SALERNO

Samplers Signature:

JCB Project Manager:

via carrier

19-45006 - ANTHONY

LOMBARDO

062000417



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: EHS

Client:
Roslyn UFSDTurn Around: Normal (twk) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN-0117	BB GB	BF	2013 2015	Boy's Bathroom Girls Bathroom	1/8/20	5:20
RSLYN-0119	GB BB	BF	2015 2013	Girls Bathroom Boys Bathroom	1/8/20	5:21
RSLYN-0120	GB BB	BF	2015 2013	Girls Bathroom Boys Bathroom	1/8/20	5:26
RSLYN-0121	HA	WC	2016	Room 51	1/8/20	5:28
RSLYN-0717	HA	we DW	1015	Room 50	1/7/20	8:34 AM
RSLYN-0718	CR HA	we DW	1035	Gymnasium	1/7/20	8:49 AM

20 JAN - 8 PM 12:04
J. C. BRODERICK AND ASSOCIATES, INC.
CARLE PLACE, NY

Building Address

East Hills Elementary School

400 Round Hill Road

Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: NICHOLAS SALERNO


Samplers Signature:

JCB Project Manager:

ANTHONY LOMBARDI

Pb 200.5 - Anthony Lombardi 6/10/2020

062000417



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: EHS

Client:

Roslyn UFSD

Turn Around: Normal (1wk) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN-0117	BB GB	BF	2013 2015	Boys Bathroom Girls Bathroom	1/8/20	5:20
RSLYN-0119	GB BB	BF	2015 2013	Girls Bathroom Boys Bathroom	1/8/20	5:21
RSLYN-0120	GB BB	BF	2015 2013	Girls Bathroom Boys Bathroom	1/8/20	5:26
RSLYN-0121	HA	WC	2016	Room 51	1/8/20	5:28
RSLYN-0717	HA	we DW	1015	Room 50	1/7/20	8:34 AM
RSLYN-0718	CR HA	we DW	1035	Gymnasium	1/7/20	8:49 AM

ANALYTICAL, INC.
CARLE PLACE, NY
20 JAN - 8 PM 12:04

Building Address

East Hills Elementary School

400 Round Hill Road

Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: NICHOLAS SALVANO

Samplers Signature:

JCB Project Manager:

ANTHONY LOMBARDI

062000417



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

1/14/2020

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 1/8/2020. The results are tabulated on the attached data pages for the following client designated project:

Roslyn UFSD, EHS Building, East Hills Elementary School, 400
Round Hill Road, Roslyn Heights, New York 11577, Proj. #:19-
45006

The reference number for these samples is EMSL Order #062000417. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000417

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/08/20 12:04 PM
 Collected: 1/8/2020

Project: Roslyn UFSD, EHS Building, East Hills Elementary School, 400 Round Hill Road, Roslyn Heights, New York 11577, Proj. #:19-45006

Analytical Results

Client Sample Description RSLYN-0099 **Collected:** 1/8/2020 **Lab ID:** 062000417-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/9/2020	AL	1/10/2020	AL

Client Sample Description RSLYN-0100 **Collected:** 1/8/2020 **Lab ID:** 062000417-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/9/2020	AL	1/10/2020	AL

Client Sample Description RSLYN-0101 **Collected:** 1/8/2020 **Lab ID:** 062000417-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	1/9/2020	AL	1/10/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description RSLYN-0102 **Collected:** 1/8/2020 **Lab ID:** 062000417-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/9/2020	AL	1/10/2020	AL

Client Sample Description RSLYN-0103 **Collected:** 1/8/2020 **Lab ID:** 062000417-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/9/2020	AL	1/10/2020	AL

Client Sample Description RSLYN-0104 **Collected:** 1/8/2020 **Lab ID:** 062000417-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/9/2020	AL	1/10/2020	AL

Client Sample Description RSLYN-0105 **Collected:** 1/8/2020 **Lab ID:** 062000417-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/9/2020	AL	1/10/2020	AL

Client Sample Description RSLYN-0106 **Collected:** 1/8/2020 **Lab ID:** 062000417-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000417

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/08/20 12:04 PM
 Collected: 1/8/2020

Project: **Roslyn UFSD, EHS Building, East Hills Elementary School, 400 Round Hill Road, Roslyn Heights, New York 11577, Proj. #:19-45006**

Analytical Results

Client Sample Description RSLYN-0106 **Collected:** 1/8/2020 **Lab ID:** 062000417-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	1/9/2020	AL	1/10/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description RSLYN-0107 **Collected:** 1/8/2020 **Lab ID:** 062000417-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/9/2020	AL	1/10/2020	AL

Client Sample Description RSLYN-0108 **Collected:** 1/8/2020 **Lab ID:** 062000417-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/9/2020	AL	1/10/2020	AL

Client Sample Description RSLYN-0109 **Collected:** 1/8/2020 **Lab ID:** 062000417-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/9/2020	AL	1/10/2020	AL

Client Sample Description RSLYN-0110 **Collected:** 1/8/2020 **Lab ID:** 062000417-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/9/2020	AL	1/10/2020	AL

Client Sample Description RSLYN-0111 **Collected:** 1/8/2020 **Lab ID:** 062000417-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.7	3.0 µg/L	1/9/2020	AL	1/10/2020	AL

Client Sample Description RSLYN-0112 **Collected:** 1/8/2020 **Lab ID:** 062000417-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/9/2020	AL	1/10/2020	AL

Client Sample Description RSLYN-0113 **Collected:** 1/8/2020 **Lab ID:** 062000417-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000417

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/08/20 12:04 PM
 Collected: 1/8/2020

Project: **Roslyn UFSD, EHS Building, East Hills Elementary School, 400 Round Hill Road, Roslyn Heights, New York 11577, Proj. #:19-45006**

Analytical Results

Client Sample Description		RSLYN-0113	Collected:	1/8/2020	Lab ID:	062000417-0015		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0	µg/L	1/9/2020	AL	1/10/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RSLYN-0114	Collected:	1/8/2020	Lab ID:	062000417-0016		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/9/2020	AL	1/10/2020	AL
Client Sample Description		RSLYN-0115	Collected:	1/8/2020	Lab ID:	062000417-0017		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0	µg/L	1/9/2020	AL	1/10/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RSLYN-0116	Collected:	1/8/2020	Lab ID:	062000417-0018		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 J	3.0	µg/L	1/9/2020	AL	1/10/2020	AL
Client Sample Description		RSLYN-0117	Collected:	1/8/2020	Lab ID:	062000417-0019		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0	µg/L	1/9/2020	AL	1/10/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RSLYN-0119	Collected:	1/8/2020	Lab ID:	062000417-0020		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0	µg/L	1/9/2020	AL	1/10/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RSLYN-0120	Collected:	1/8/2020	Lab ID:	062000417-0021		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0	µg/L	1/9/2020	AL	1/10/2020	AL
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000417

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 01/08/20 12:04 PM
Collected: 1/8/2020

Project: **Roslyn UFSD, EHS Building, East Hills Elementary School, 400 Round Hill Road, Roslyn Heights, New York 11577, Proj. #:19-45006**

Analytical Results

Client Sample Description RSLYN-0121 **Collected:** 1/8/2020 **Lab ID:** 062000417-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/9/2020	AL	1/10/2020	AL

Client Sample Description RSLYN-0717 **Collected:** 1/8/2020 **Lab ID:** 062000417-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/9/2020	AL	1/10/2020	AL

Client Sample Description RSLYN-0718 **Collected:** 1/8/2020 **Lab ID:** 062000417-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/9/2020	AL	1/10/2020	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: HHE

Client:

Roslyn UFSD

Turn Around: Normal (twk) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN-0122	FA	CF	1036C	Custodial Office	1/8/20	5:58
RSLYN-0129	HA	WC	1002	Boy's Bathroom	1/8/20	6:05
RSLYN-0133	CR	DW	1003	Room 25	1/8/20	6:07
RSLYN-0134	CR	CF	1003	Room 25	1/8/20	6:07
RSLYN-0135	CR	DW	1004	Room 24	1/8/20	6:09
RSLYN-0136	CR	CF	1004	Room 24	1/8/20	6:09
RSLYN-0137	CR	DW	1005	Room 27	1/8/20	6:13
RSLYN-0138	CR	CF	1005	Room 27	1/8/20	6:13
RSLYN-0139	CR	DW	1006	Room 26	1/8/20	6:14
RSLYN-0140	CR	CF	1006	Room 26	1/8/20	6:14
RSLYN-0141	CR	BF	1006A	Room 26 South Bathroom	1/8/20	6:14
RSLYN-0142	CR	DW	1007	Room 29	1/8/20	6:16
RSLYN-0143	CR	CF	1007	Room 29	1/8/20	6:16
RSLYN-0144	CR	DW	1009	Room 31	1/8/20	6:18
RSLYN-0145	CR	CF	1009	Room 31	1/8/20	6:18
RSLYN-0146	CR	CF	1010	Room 32 Library	1/8/20	6:20
RSLYN-0147	CR	DW	1011	Room 33	1/8/20	6:21
RSLYN-0148	CR	CF	1011	Room 33	1/8/20	6:21

20 JAN - 3 PM 12:05
 JCB/MASTICA
 LAB/ENGLAGE, NY

Building Address

Harbor Hill Elementary School

3 Glen Cove Road

Greenvale, New York 11548

Analysis Type: ELAP 200.5

Lab Received:

Signature:

062000420

Samplers Name: Nicholas SpornioSamplers Signature: [Signature]JCB Project Manager: Anthony Lombardo

Via: Courier



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: HHE

Client:
Roslyn UFSD

Turn Around: Normal (twk) Rush

Page 2 of 6

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN-0153	OF	BF	1017A1	Gym South Office Bathroom	1/8/20	6:50 6:50
RSLYN-0154	OF	BF	1017C1	Gym North Office Bathroom	1/8/20	6:51
RSLYN-0155	GY	we DW	1018	Gym Vestibule	1/8/20	6:45
RSLYN-0157	CR	DW	1021	Room 42 Art Room	1/8/20	NOT AVAILABLE
RSLYN-0161	NO	NS	1029	Nurse's Office	1/8/20	6:57 (NO sticker)
RSLYN-0162	NO	BF	1029C	Nurse's Office Bathroom	1/8/20	6:58
RSLYN-0163	CA	we DW	1030	Cafeteria/Auditorium	1/8/20	6:39
RSLYN-0164	KI	KC	1031A	Kitchen	1/8/20	6:27
RSLYN-0165	KI	KC	1031A	Kitchen	1/8/20	6:27
RSLYN-0166	KI	KC	1031A	Kitchen	1/8/20	6:28
RSLYN-0167	KI	KC	1031A	Kitchen	1/8/20	6:28
RSLYN-0168	KI	KC	1031A	Kitchen	1/8/20	6:28
RSLYN-0169	KI	we SN	1031A	Kitchen	1/8/20	6:29
RSLYN-0170	KI	BF	1031A3	Kitchen Bathroom	1/8/20	6:31
RSLYN-0171	BR	BF	1034	Bathroom	1/8/20	6:33
RSLYN-0175	FA	KC	1041	Faculty Room	1/8/20	6:37
RSLYN-0176	FA	BF	1041A1	Faculty Room Bathroom	1/8/20	6:37
RSLYN-0177	OF	BF	1043B	Principal's Office Bathroom	1/8/20	6:39

Building Address

Harbor Hill Elementary School
3 Glen Cove Road
Greenvale, New York 11548

Analysis Type: ELAP 200.5

Lab Received:

Signature:


Samplers Name: Nicholas Serrano

Samplers Signature: [Signature]

JCB Project Manager: Anthony Lombardo

Via: carrier

062000420



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: HHE

Client:
Roslyn UFSD

Turn Around: Normal (twk) Rush



Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN-0153	OF	BF	1017A1	Gym South Office Bathroom	1/8/20	6:50 6:50
RSLYN-0154	OF	BF	1017C1	Gym North Office Bathroom	1/8/20	6:51
RSLYN-0155	GY	we DW	1018	Gym Vestibule	1/8/20	6:45
RSLYN-0157	CR	DW	1021	Room 42 Art Room	1/8/20	NOT Available
RSLYN-0161	NO	NS	1029	Nurse's Office	1/8/20	6:57 (NO sticker)
RSLYN-0162	NO	BF	1029C	Nurse's Office Bathroom	1/8/20	6:58
RSLYN-0163	CA	we DW	1030	Cafeteria/Auditorium	1/8/20	6:39
RSLYN-0164	KI	KC	1031A	Kitchen	1/8/20	6:27
RSLYN-0165	KI	KC	1031A	Kitchen	1/8/20	6:27
RSLYN-0166	KI	KC	1031A	Kitchen	1/8/20	6:28
RSLYN-0167	KI	KC	1031A	Kitchen	1/8/20	6:28
RSLYN-0168	KI	KC	1031A	Kitchen	1/8/20	6:28
RSLYN-0169	KI	we SN	1031A	Kitchen	1/8/20	6:28
RSLYN-0170	KI	BF	1031A3	Kitchen Bathroom	1/8/20	6:31
RSLYN-0171	BR	BF	1034	Bathroom	1/8/20	6:33
RSLYN-0175	FA	KC	1041	Faculty Room	1/8/20	6:37
RSLYN-0176	FA	BF	1041A1	Faculty Room Bathroom	1/8/20	6:37
RSLYN-0177	OF	BF	1043B	Principal's Office Bathroom	1/8/20	6:39

Building Address

Harbor Hill Elementary School
3 Glen Cove Road
Greenvale, New York 11548

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Handwritten signature

Samplers Name: Nicholas Salameo

Samplers Signature: *Handwritten signature*

JCB Project Manager: Anthony Lombardo

Via: carrier

062000420



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

1/16/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 1/8/2020. The results are tabulated on the attached data pages for the following client designated project:

Roslyn UFSD, HHE Building, Harbor Hill Elementary School, 3
Glen Cove Road, Greenvale, New York 11548, Proj #:19-45006

The reference number for these samples is EMSL Order #062000420. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000420

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/08/20 12:05 PM
 Collected: 1/8/2020

Project: Roslyn UFSD, HHE Building, Harbor Hill Elementary School, 3 Glen Cove Road, Greenvale, New York 11548, Proj #:19-45006

Analytical Results

Client Sample Description RSLYN-0122 **Collected:** 1/8/2020 **Lab ID:** 062000420-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	1/13/2020	AL	1/13/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description RSLYN-0129 **Collected:** 1/8/2020 **Lab ID:** 062000420-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2020	AL	1/13/2020	AL

Client Sample Description RSLYN-0133 **Collected:** 1/8/2020 **Lab ID:** 062000420-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2020	AL	1/13/2020	AL

Client Sample Description RSLYN-0134 **Collected:** 1/8/2020 **Lab ID:** 062000420-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	1/13/2020	AL	1/13/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description RSLYN-0135 **Collected:** 1/8/2020 **Lab ID:** 062000420-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2020	AL	1/13/2020	AL

Client Sample Description RSLYN-0136 **Collected:** 1/8/2020 **Lab ID:** 062000420-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2020	AL	1/13/2020	AL

Client Sample Description RSLYN-0137 **Collected:** 1/8/2020 **Lab ID:** 062000420-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2020	AL	1/13/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000420

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/08/20 12:05 PM
 Collected: 1/8/2020

Project: Roslyn UFSD, HHE Building, Harbor Hill Elementary School, 3 Glen Cove Road, Greenvale, New York 11548, Proj #:19-45006

Analytical Results

Client Sample Description RSLYN-0138 **Collected:** 1/8/2020 **Lab ID:** 062000420-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2020	AL	1/13/2020	AL

Client Sample Description RSLYN-0139 **Collected:** 1/8/2020 **Lab ID:** 062000420-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0 µg/L	1/13/2020	AL	1/13/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description RSLYN-0140 **Collected:** 1/8/2020 **Lab ID:** 062000420-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	180	3.0 µg/L	1/13/2020	AL	1/13/2020	AL

Client Sample Description RSLYN-0141 **Collected:** 1/8/2020 **Lab ID:** 062000420-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	28	3.0 µg/L	1/13/2020	AL	1/13/2020	AL

Client Sample Description RSLYN-0142 **Collected:** 1/8/2020 **Lab ID:** 062000420-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2020	AL	1/13/2020	AL

Client Sample Description RSLYN-0143 **Collected:** 1/8/2020 **Lab ID:** 062000420-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2020	AL	1/13/2020	AL

Client Sample Description RSLYN-0144 **Collected:** 1/8/2020 **Lab ID:** 062000420-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2020	AL	1/13/2020	AL

Client Sample Description RSLYN-0145 **Collected:** 1/8/2020 **Lab ID:** 062000420-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000420

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/08/20 12:05 PM
 Collected: 1/8/2020

Project: Roslyn UFSD, HHE Building, Harbor Hill Elementary School, 3 Glen Cove Road, Greenvale, New York 11548, Proj #:19-45006

Analytical Results

Client Sample Description		RSLYN-0145	Collected:		1/8/2020	Lab ID:		062000420-0015	
Method	Parameter		Result		RL	Units	Prep Date	Analyst	Analysis Date
200.5	Lead		<3.0 ND		3.0	µg/L	1/13/2020	AL	1/13/2020
Client Sample Description		RSLYN-0146	Collected:		1/8/2020	Lab ID:		062000420-0016	
Method	Parameter		Result		RL	Units	Prep Date	Analyst	Analysis Date
200.5	Lead		<3.0 ND		3.0	µg/L	1/13/2020	AL	1/13/2020
Client Sample Description		RSLYN-0147	Collected:		1/8/2020	Lab ID:		062000420-0017	
Method	Parameter		Result		RL	Units	Prep Date	Analyst	Analysis Date
200.5	Lead		1.0 J		3.0	µg/L	1/13/2020	AL	1/13/2020
Lead MDL: 1.0µg/L									
Client Sample Description		RSLYN-0148	Collected:		1/8/2020	Lab ID:		062000420-0018	
Method	Parameter		Result		RL	Units	Prep Date	Analyst	Analysis Date
200.5	Lead		1.1 J		3.0	µg/L	1/13/2020	AL	1/13/2020
Lead MDL: 1.0µg/L									
Client Sample Description		RSLYN-0153	Collected:		1/8/2020	Lab ID:		062000420-0019	
Method	Parameter		Result		RL	Units	Prep Date	Analyst	Analysis Date
200.5	Lead		2.1 J		3.0	µg/L	1/13/2020	AL	1/13/2020
Lead MDL: 1.0µg/L									
Client Sample Description		RSLYN-0154	Collected:		1/8/2020	Lab ID:		062000420-0020	
Method	Parameter		Result		RL	Units	Prep Date	Analyst	Analysis Date
200.5	Lead		28		3.0	µg/L	1/13/2020	AL	1/13/2020
Client Sample Description		RSLYN-0155	Collected:		1/8/2020	Lab ID:		062000420-0021	
Method	Parameter		Result		RL	Units	Prep Date	Analyst	Analysis Date
200.5	Lead		<3.0 ND		3.0	µg/L	1/13/2020	AL	1/13/2020

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000420

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/08/20 12:05 PM
 Collected: 1/8/2020

Project: Roslyn UFSD, HHE Building, Harbor Hill Elementary School, 3 Glen Cove Road, Greenvale, New York 11548, Proj #:19-45006

Analytical Results

Client Sample Description RSLYN-0157 **Collected:** 1/8/2020 **Lab ID:** 062000420-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead		3.0 µg/L				
Sample not submitted.							

Client Sample Description RSLYN-0161 **Collected:** 1/8/2020 **Lab ID:** 062000420-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	1/13/2020	AL	1/13/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description RSLYN-0162 **Collected:** 1/8/2020 **Lab ID:** 062000420-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	1/13/2020	AL	1/13/2020	AL

Client Sample Description RSLYN-0163 **Collected:** 1/8/2020 **Lab ID:** 062000420-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2020	AL	1/13/2020	AL

Client Sample Description RSLYN-0164 **Collected:** 1/8/2020 **Lab ID:** 062000420-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2020	AL	1/13/2020	AL

Client Sample Description RSLYN-0165 **Collected:** 1/8/2020 **Lab ID:** 062000420-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.5	3.0 µg/L	1/13/2020	AL	1/13/2020	AL

Client Sample Description RSLYN-0166 **Collected:** 1/8/2020 **Lab ID:** 062000420-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/13/2020	AL	1/13/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000420

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/08/20 12:05 PM
 Collected: 1/8/2020

Project: **Roslyn UFSD, HHE Building, Harbor Hill Elementary School, 3 Glen Cove Road, Greenvale, New York 11548, Proj #:19-45006**

Analytical Results

Client Sample Description		RSLYN-0167	Collected:	1/8/2020	Lab ID:	062000420-0029		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/13/2020	AL	1/13/2020	AL
Client Sample Description		RSLYN-0168	Collected:	1/8/2020	Lab ID:	062000420-0030		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/13/2020	AL	1/13/2020	AL
Client Sample Description		RSLYN-0169	Collected:	1/8/2020	Lab ID:	062000420-0031		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	430 D	30	µg/L	1/13/2020	AL	1/15/2020	AL
Client Sample Description		RSLYN-0170	Collected:	1/8/2020	Lab ID:	062000420-0032		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0	µg/L	1/13/2020	AL	1/13/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RSLYN-0171	Collected:	1/8/2020	Lab ID:	062000420-0033		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0	µg/L	1/13/2020	AL	1/13/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RSLYN-0175	Collected:	1/8/2020	Lab ID:	062000420-0034		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0	µg/L	1/13/2020	AL	1/13/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RSLYN-0176	Collected:	1/8/2020	Lab ID:	062000420-0035		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0	µg/L	1/13/2020	AL	1/13/2020	AL
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000420

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 01/08/20 12:05 PM
Collected: 1/8/2020

Project: Roslyn UFSD, HHE Building, Harbor Hill Elementary School, 3 Glen Cove Road, Greenvale, New York 11548, Proj #:19-45006

Analytical Results

Client Sample Description RSLYN-0177 **Collected:** 1/8/2020 **Lab ID:** 062000420-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	1/13/2020	AL	1/13/2020	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: HHE

Client:

Roslyn UFSD

Turn Around: Normal (twk) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN-0179	HA	WC	1053	Room 10	1/9/20	4:52 AM
RSLYN-0180	CR	DW	1053	Room 10	1/9/20	4:56 AM
RSLYN-0181	CR	CF	1053	Room 10	1/9/20	4:57 AM
RSLYN-0182	CR	BF	1053A	Room 10 Bathroom	1/9/20	4:57 AM
RSLYN-0183	CR	DW	1054	Room 11	1/9/20	4:59 AM
RSLYN-0184	CR	CF	1054	Room 11	1/9/20	4:59 AM
RSLYN-0185	CR	BF	1054B	Room 11 Bathroom	1/9/20	5:00 AM
RSLYN-0186	CR	DW	1055	Room 12	1/9/20	5:02 AM
RSLYN-0187	CR	CF	1055	Room 12	1/9/20	5:02 AM
RSLYN-0188	CR	BF	1055A	Room 12 Bathroom	1/9/20	5:02 AM
RSLYN-0189	CR	DW	1056	Room 13	1/9/20	5:05 AM
RSLYN-0190	CR	CF	1056	Room 13	1/9/20	5:06 AM
RSLYN-0191	CR	BF	1056B	Room 13 Bathroom	1/9/20	5:06 AM
RSLYN-0192	CR	DW	1057	Room 14	1/9/20	5:07 AM
RSLYN-0193	CR	CF	1057	Room 14	1/9/20	5:09 AM
RSLYN-0194	CR	BF	1057B	Room 14 Bathroom	1/9/20	5:09 AM
RSLYN-0195	CR	DW	1058	Room 15	1/9/20	5:10 AM
RSLYN-0196	CR	CF	1058	Room 15	1/9/20	5:11 AM

Building Address

Harbor Hill Elementary School

3 Glen Cove Road

Greenvale, New York 11548

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Nicholas SalernoSamplers Signature: N. SalernoJCB Project Manager: Anthony Lombardo

Aurora McDonald 1/17/20

154 PM 1/18/20

062000534



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: HHE

Client:

Roslyn UFSD

Turn Around: Normal (4wks) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN-0197	CR	BF	1058A	Room 15 Bathroom	1/9/20	5:11 AM
RSLYN-0198	CR	DW	1060	Room 18	1/9/20	5:13 AM
RSLYN-0199	CR	CF	1060	Room 18	1/9/20	5:13 AM
RSLYN-0200	CR	BF	1060A	Room 18 Bathroom	1/9/20	5:14 AM
RSLYN-0201	CR	DW	1061	Room 17	1/9/20	5:16 AM
RSLYN-0202	CR	CF	1061	Room 17	1/9/20	5:16 AM
RSLYN-0203	CR	BF	1061B	Room 17 Bathroom	1/9/20	5:17 AM
RSLYN-0204	CR	DW	N/A (New Construction)	Room 19	1/9/20	5:20 AM
RSLYN-0205	CR	DW	N/A (New Construction)	Room 20	1/9/20	5:22 AM
RSLYN-0206	CR	DW	N/A (New Construction)	Room 21	1/9/20	5:26 AM
RSLYN-0207	CR	DW	N/A (New Construction)	Room 22	1/9/20	5:27 AM
RSLYN-0208	CR	DW	N/A (New Construction)	Room 23	1/9/20	5:29 AM
RSLYN-0209	CR	CF	N/A (New Construction)	Room 19	1/9/20	5:22 AM
RSLYN-0210	CR	CF	N/A (New Construction)	Room 20	1/9/20	5:23 AM
RSLYN-0211	CR	CF	N/A (New Construction)	Room 21	1/9/20	5:26 AM
RSLYN-0212	CR	CF	N/A (New Construction)	Room 22	1/9/20	5:28 AM
RSLYN-0213	CR	CF	N/A (New Construction)	Room 23	1/9/20	5:30 AM
RSLYN-0219	MBR	CF PW	N/A (New Construction)	Multipurpose Room	1/9/20	5:32 AM

Building Address

Harbor Hill Elementary School

3 Glen Cove Road

Greenvale, New York 11548

Analysis Type: ELAP 200.5


Lab Recieved

Signature: *Michelle DeLo**Allyson McDonald 1/17/20*Samplers Name: *Nikolas Spennio*Samplers Signature: *Nikolas Spennio*

JCB Project Manager:

Anthony Lombardo

062000534



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL. (631) 584-5492 FAX. (631) 584-3395

JCB #: 19-45006

Building: HHE

Client:

Roslyn UFSD

Turn Around: Normal (1wk) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN-0220	MPR	DW CF	N/A (New Construction)	Multipurpose Room	1/9/20	5:34 AM
RSLYN-0221	MPR	CF	N/A (New Construction)	Multipurpose Room	1/9/20	5:35 AM
RSLYN-0222	CR	DW	2000	Room 50 Computer Lab	1/9/20	5:40 AM
RSLYN-0223	CR	CF	2000	Room 50 Computer Lab	1/9/20	5:41 AM
RSLYN-0224	CR	DW	2001	Room 51	1/9/20	5:42 AM
RSLYN-0225	CR	CF	2001	Room 51	1/9/20	5:42 AM
RSLYN-0226	CR	DW	2002	Room 52	1/9/20	5:43 AM
RSLYN-0227	CR	CF	2002	Room 52	1/9/20	5:44 AM
RSLYN-0228	CR	DW	2003	Room 53	1/9/20	5:45 AM
RSLYN-0229	CR	CF	2003	Room 53	1/9/20	5:46 AM
RSLYN-0230	CR	DW	2004	Room 54	1/9/20	5:47 AM
RSLYN-0231	CR	CF	2004	Room 54	1/9/20	5:47 AM
RSLYN-0232	CR	DW	2005	Room 55	1/9/20	5:48 AM
RSLYN-0233	CR	CF	2005	Room 55	1/9/20	5:49 AM
RSLYN-0234	CR	DW	2006	Room 56	1/9/20	5:49 AM
RSLYN-0235	CR	CF	2006	Room 56	1/9/20	5:50 AM
RSLYN-0236	CR	DW	2007	Room 57	1/9/20	5:51 AM
RSLYN-0237	CR	CF	2007	Room 57	1/9/20	5:52 AM

Building Address

Harbor Hill Elementary School

3 Glen Cove Road

Greenvale, New York 11548

Analysis Type: ELAP 200.5

Lab Recieved:

Signature:

Samplers Name: NICHOLAS SALVANO

Samplers Signature:

JCB Project Manager:

Anthony Lombardo

Ampex McDonald 1/17/20

062000534

Via Courier



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: HHE

Client:

Roslyn UFSD

Turn Around: Normal (twk) Rush _____

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN-0238	HA	WE DW	2008	Room 58	1/9/20	5:52 AM
RSLYN-0239	CR	DW	2008	Room 58	1/9/20	5:58 AM
RSLYN-0240	CR	CF	2008	Room 58	1/9/20	5:54 AM
RSLYN-0483	HA	WE DW	1018	Gym Vestibule	1/9/20	6:00 AM
RSLYN-0484	MPR	CF	N/A (New Construction)	Multipurpose Room	1/9/20	6:04 AM
RSLYN-0729	CA	WC	1030	Cafeteria/Auditorium	1/9/20	6:03 AM
RSLYN-0730	HA	WC	1018	GYM VESTIBULE	1/9/20	6:00 AM

062000534

Building Address

Harbor Hill Elementary School

3 Glen Cove Road

Greenvale, New York 11548

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Aupres McDonald 1/17/20

Samplers Name: Nicholas SalernoSamplers Signature: N. SalernoJCB Project Manager: Anthony Lombardo



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

1/18/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 1/9/2020. The results are tabulated on the attached data pages for the following client designated project:

Roslyn UFSD, HHE Building, Harbor Hill Elementary School, 3
Glen Cove Road, Greenvale, New York 11548, Proj #:19-45006

The reference number for these samples is EMSL Order #062000534. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000534

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/09/20 1:54 PM
 Collected: 1/9/2020

Project: **Roslyn UFSD, HHE Building, Harbor Hill Elementary School, 3 Glen Cove Road, Greenvale, New York 11548, Proj #:19-45006**

Analytical Results

Client Sample Description RSLYN-0179 **Collected:** 1/9/2020 **Lab ID:** 062000534-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0180 **Collected:** 1/9/2020 **Lab ID:** 062000534-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0181 **Collected:** 1/9/2020 **Lab ID:** 062000534-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0182 **Collected:** 1/9/2020 **Lab ID:** 062000534-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLYN-0183 **Collected:** 1/9/2020 **Lab ID:** 062000534-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0184 **Collected:** 1/9/2020 **Lab ID:** 062000534-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLYN-0185 **Collected:** 1/9/2020 **Lab ID:** 062000534-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000534

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/09/20 1:54 PM
 Collected: 1/9/2020

Project: Roslyn UFSD, HHE Building, Harbor Hill Elementary School, 3 Glen Cove Road, Greenvale, New York 11548, Proj #:19-45006

Analytical Results

Client Sample Description		RSLYN-0186	Collected:	1/9/2020	Lab ID:	062000534-0008		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/16/2020	AL	1/17/2020	AM
Client Sample Description		RSLYN-0187	Collected:	1/9/2020	Lab ID:	062000534-0009		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/16/2020	AL	1/17/2020	AM
Client Sample Description		RSLYN-0188	Collected:	1/9/2020	Lab ID:	062000534-0010		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0	µg/L	1/16/2020	AL	1/17/2020	AM
		Lead MDL: 1.0µg/L						
Client Sample Description		RSLYN-0189	Collected:	1/9/2020	Lab ID:	062000534-0011		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/16/2020	AL	1/17/2020	AM
Client Sample Description		RSLYN-0190	Collected:	1/9/2020	Lab ID:	062000534-0012		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/16/2020	AL	1/17/2020	AM
Client Sample Description		RSLYN-0191	Collected:	1/9/2020	Lab ID:	062000534-0013		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0	µg/L	1/16/2020	AL	1/17/2020	AM
		Lead MDL: 1.0µg/L						
Client Sample Description		RSLYN-0192	Collected:	1/9/2020	Lab ID:	062000534-0014		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/16/2020	AL	1/17/2020	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000534

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/09/20 1:54 PM
 Collected: 1/9/2020

Project: Roslyn UFSD, HHE Building, Harbor Hill Elementary School, 3 Glen Cove Road, Greenvale, New York 11548, Proj #:19-45006

Analytical Results

Client Sample Description RSLYN-0193 **Collected:** 1/9/2020 **Lab ID:** 062000534-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0194 **Collected:** 1/9/2020 **Lab ID:** 062000534-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	1/16/2020	AL	1/17/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLYN-0195 **Collected:** 1/9/2020 **Lab ID:** 062000534-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	1/16/2020	AL	1/17/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLYN-0196 **Collected:** 1/9/2020 **Lab ID:** 062000534-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	1/16/2020	AL	1/17/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLYN-0197 **Collected:** 1/9/2020 **Lab ID:** 062000534-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	1/16/2020	AL	1/17/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLYN-0198 **Collected:** 1/9/2020 **Lab ID:** 062000534-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0199 **Collected:** 1/9/2020 **Lab ID:** 062000534-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000534

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/09/20 1:54 PM
 Collected: 1/9/2020

Project: Roslyn UFSD, HHE Building, Harbor Hill Elementary School, 3 Glen Cove Road, Greenvale, New York 11548, Proj #:19-45006

Analytical Results

Client Sample Description		RSLYN-0200	Collected:	1/9/2020	Lab ID:	062000534-0022		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0	µg/L	1/16/2020	AL	1/17/2020	AM
Client Sample Description		RSLYN-0201	Collected:	1/9/2020	Lab ID:	062000534-0023		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/16/2020	AL	1/17/2020	AM
Client Sample Description		RSLYN-0202	Collected:	1/9/2020	Lab ID:	062000534-0024		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0	µg/L	1/16/2020	AL	1/17/2020	AM
		Lead MDL: 1.0µg/L						
Client Sample Description		RSLYN-0203	Collected:	1/9/2020	Lab ID:	062000534-0025		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0	µg/L	1/16/2020	AL	1/17/2020	AM
Client Sample Description		RSLYN-0204	Collected:	1/9/2020	Lab ID:	062000534-0026		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0	µg/L	1/16/2020	AL	1/17/2020	AM
		Lead MDL: 1.0µg/L						
Client Sample Description		RSLYN-0205	Collected:	1/9/2020	Lab ID:	062000534-0027		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0	µg/L	1/16/2020	AL	1/17/2020	AM
Client Sample Description		RSLYN-0206	Collected:	1/9/2020	Lab ID:	062000534-0028		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0	µg/L	1/16/2020	AL	1/17/2020	AM
		Lead MDL: 1.0µg/L						

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000534

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/09/20 1:54 PM
 Collected: 1/9/2020

Project: Roslyn UFSD, HHE Building, Harbor Hill Elementary School, 3 Glen Cove Road, Greenvale, New York 11548, Proj #:19-45006

Analytical Results

Client Sample Description RSLYN-0207 **Collected:** 1/9/2020 **Lab ID:** 062000534-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.3	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0208 **Collected:** 1/9/2020 **Lab ID:** 062000534-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLYN-0209 **Collected:** 1/9/2020 **Lab ID:** 062000534-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLYN-0210 **Collected:** 1/9/2020 **Lab ID:** 062000534-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0211 **Collected:** 1/9/2020 **Lab ID:** 062000534-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0212 **Collected:** 1/9/2020 **Lab ID:** 062000534-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0213 **Collected:** 1/9/2020 **Lab ID:** 062000534-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000534

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/09/20 1:54 PM
 Collected: 1/9/2020

Project: Roslyn UFSD, HHE Building, Harbor Hill Elementary School, 3 Glen Cove Road, Greenvale, New York 11548, Proj #:19-45006

Analytical Results

Client Sample Description RSLYN-0219 **Collected:** 1/9/2020 **Lab ID:** 062000534-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0220 **Collected:** 1/9/2020 **Lab ID:** 062000534-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0221 **Collected:** 1/9/2020 **Lab ID:** 062000534-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLYN-0222 **Collected:** 1/9/2020 **Lab ID:** 062000534-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0223 **Collected:** 1/9/2020 **Lab ID:** 062000534-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0224 **Collected:** 1/9/2020 **Lab ID:** 062000534-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0225 **Collected:** 1/9/2020 **Lab ID:** 062000534-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0226 **Collected:** 1/9/2020 **Lab ID:** 062000534-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000534

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/09/20 1:54 PM
 Collected: 1/9/2020

Project: Roslyn UFSD, HHE Building, Harbor Hill Elementary School, 3 Glen Cove Road, Greenvale, New York 11548, Proj #:19-45006

Analytical Results

Client Sample Description		RSLYN-0226		Collected:	1/9/2020	Lab ID:	062000534-0043	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/16/2020	AL	1/17/2020	AM
Client Sample Description		RSLYN-0227		Collected:	1/9/2020	Lab ID:	062000534-0044	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/16/2020	AL	1/17/2020	AM
Client Sample Description		RSLYN-0228		Collected:	1/9/2020	Lab ID:	062000534-0045	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/16/2020	AL	1/17/2020	AM
Client Sample Description		RSLYN-0229		Collected:	1/9/2020	Lab ID:	062000534-0046	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/16/2020	AL	1/17/2020	AM
Client Sample Description		RSLYN-0230		Collected:	1/9/2020	Lab ID:	062000534-0047	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/16/2020	AL	1/17/2020	AM
Client Sample Description		RSLYN-0231		Collected:	1/9/2020	Lab ID:	062000534-0048	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/16/2020	AL	1/17/2020	AM
Client Sample Description		RSLYN-0232		Collected:	1/9/2020	Lab ID:	062000534-0049	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/16/2020	AL	1/17/2020	AM
Client Sample Description		RSLYN-0233		Collected:	1/9/2020	Lab ID:	062000534-0050	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000534

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/09/20 1:54 PM
 Collected: 1/9/2020

Project: **Roslyn UFSD, HHE Building, Harbor Hill Elementary School, 3 Glen Cove Road, Greenvale, New York 11548, Proj #:19-45006**

Analytical Results

Client Sample Description RSLYN-0233 **Collected:** 1/9/2020 **Lab ID:** 062000534-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0234 **Collected:** 1/9/2020 **Lab ID:** 062000534-0051

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0235 **Collected:** 1/9/2020 **Lab ID:** 062000534-0052

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0236 **Collected:** 1/9/2020 **Lab ID:** 062000534-0053

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0237 **Collected:** 1/9/2020 **Lab ID:** 062000534-0054

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0238 **Collected:** 1/9/2020 **Lab ID:** 062000534-0055

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0239 **Collected:** 1/9/2020 **Lab ID:** 062000534-0056

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0240 **Collected:** 1/9/2020 **Lab ID:** 062000534-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000534

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/09/20 1:54 PM
 Collected: 1/9/2020

Project: Roslyn UFSD, HHE Building, Harbor Hill Elementary School, 3 Glen Cove Road, Greenvale, New York 11548, Proj #:19-45006

Analytical Results

Client Sample Description RSLYN-0240 **Collected:** 1/9/2020 **Lab ID:** 062000534-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	1/16/2020	AL	1/17/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLYN-0483 **Collected:** 1/9/2020 **Lab ID:** 062000534-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0484 **Collected:** 1/9/2020 **Lab ID:** 062000534-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	1/16/2020	AL	1/17/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLYN-0729 **Collected:** 1/9/2020 **Lab ID:** 062000534-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLYN-0730 **Collected:** 1/9/2020 **Lab ID:** 062000534-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted

J.C. Broderick Associates
1775 Expressway Dr. N.
Hauppauge, NY 11788
Contact: Ed McGuire
emcguire@jcbroderick.com

Lead In Water Chain of Custody Form



062.00159/

Page 1 of 1
Date: 1/23/20

JCB#: 19-45006

OrderID: 062001591

[illegible]

Client:	Roslyn UFSD		
Building Name and Address	Harbor Hill Elementary 3 Glen Cove Rd, Greenvale, NY		
<u>Sampler's Name:</u>	Anthony Lombardo		
<u>Sampler's Signature:</u>			
<u>Relinquished By:</u>	<u>Received By:</u>	<u>Date:</u>	<u>Time:</u>
		1-28-2020	12:00 PM

Laboratory Name:	EMSL	Date:	Time:	Method of Analysis
Analyzed By:				LEAD ELAP 200.5
QC By:				

Turnaround Time:	Standard 48 hr
Email Report to:	alombardo@jcbroderick.com



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

1/27/2020

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 1/23/2020. The results are tabulated on the attached data pages for the following client designated project:

**#19-45006, Roslyn UFSD, Harbor Hill Elementary, 3 Glen Cove
Rd, Greenvale, NY**

The reference number for these samples is EMSL Order #062001591. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001591

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 01/23/20 12:09 PM
Collected: 1/23/2020

Project: #19-45006, Roslyn UFSD, Harbor Hill Elementary, 3 Glen Cove Rd, Greenvale, NY

Analytical Results

Client Sample Description		RSLYN 0140 Room 26	Collected:	1/23/2020	Lab ID:	062001591-0001		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	300 D	30	µg/L	1/24/2020	AL	1/27/2020	AL
Client Sample Description		RSLYN 0141 Room 26 South Bathroom	Collected:	1/23/2020	Lab ID:	062001591-0002		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	70	3.0	µg/L	1/24/2020	AL	1/27/2020	AL
Client Sample Description		RSLYN 0154 Gym North Office Bathroom	Collected:	1/23/2020	Lab ID:	062001591-0003		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	180	3.0	µg/L	1/24/2020	AL	1/27/2020	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted

OrderID: 062002493

JCB#:19-45006


Page 1 of 1

Date: 2/4/20

20 FEB -4 PM 3:21

9) Wahl in

Page 1 of 1

Client:	Roslyn Union Free School District		
Building Name and Address	Harbor Hill Elementary School 3 Glen Cove Road, Greenvale, New York 11548		
<u>Sampler's Name:</u>	Anthony Lombardo		
<u>Sampler's Signature:</u>			
<u>Relinquished By:</u>	<u>Received By:</u>	<u>Date:</u>	<u>Time:</u>
			

Laboratory Name:	EMSL	Date:	Time:	Method of Analysis
Analyzed By:	Amya McCloud	2/5/20		LEAD
QC By:				ELAP 200.5

am

Turnaround Time:	Standard 2 Day
Email Report to:	alombardo@icbroderick.com



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/6/2020

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 2/4/2020. The results are tabulated on the attached data pages for the following client designated project:

**Harbor Hill Elementary School, 3 Glen Cove Road, Greenvale,
New York 11548, Project # 19-45006**

The reference number for these samples is EMSL Order #062002493. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062002493

CustomerID: JC BR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 02/04/20 3:21 PM
Collected: 2/4/2020

Project: Harbor Hill Elementary School, 3 Glen Cove Road, Greenvale, New York 11548, Project # 19-45006

Analytical Results

Client Sample Description		140 Room 26	Collected:	2/4/2020	Lab ID:	062002493-0001		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	17	3.0	µg/L	2/5/2020	AL	2/5/2020	AM
Client Sample Description		141 Room 26 Bathroom	Collected:	2/4/2020	Lab ID:	062002493-0002		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0	µg/L	2/5/2020	AL	2/5/2020	AM
Client Sample Description		154 Gym North Office Bathroom	Collected:	2/4/2020	Lab ID:	062002493-0003		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/5/2020	AL	2/5/2020	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: Harbor
Hill
School

Client: Roslyn UFSD

Re-test/New Install ☒

Turn Around: Normal (1wk)

Rush

Page 1 of 1

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN - 0140	CR	CF	1006	Room 26	3/10/20	6:52
RSLYN - 0141	CR	CF	1006A	Room 26 Bathroom	3/10/20	6:52
RSLYN - 0161	NO	NS	1029	Nurse's Office	3/10/20	6:57

Final Submission

062005175

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
20 MAR 10 PM 9:48

Building Address

Harbor Hill School

3 Glen Cove Road

Greenvale, NY 11548

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Pb 200.5- *A. Hung* 03/13/20

Samplers Name: *Donilly Bolognini*

Samplers Signature: *Donilly Bolognini*

JCB Project Manager: *Anthony Lombardo*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

3/18/2020

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 3/10/2020. The results are tabulated on the attached data pages for the following client designated project:

**JCB#: 19-45006, Harbor Hill School, Roslyn UFSD, Harbor Hill
School, 3 Glen Cove Road, Greenvale, NY 11548**

The reference number for these samples is EMSL Order #062005175. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062005175

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 03/10/20 9:58 PM
Collected: 3/10/2020

Project: JCB#: 19-45006, Harbor Hill School, Roslyn UFSD, Harbor Hill School, 3 Glen Cove Road, Greenvale, NY 11548

Analytical Results

Client Sample Description RSLYN-0140 **Collected:** 3/10/2020 **Lab ID:** 062005175-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	14	3.0 µg/L	3/12/2020	AL	3/13/2020	AL

Client Sample Description RSLYN-0141 **Collected:** 3/10/2020 **Lab ID:** 062005175-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	41	3.0 µg/L	3/12/2020	AL	3/13/2020	AL

Client Sample Description RSLYN-0161 **Collected:** 3/10/2020 **Lab ID:** 062005175-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	3/12/2020	AL	3/13/2020	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: THS

Client:

Roslyn UFSD

Turn Around:

Normal (1wk)

Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLN-0274	KI	KC	1006A	Cafeteria Kitchen	1/10/20	6:44 AM
RSLN-0275	BR	BF	1006B	Cafeteria Bathroom	1/10/20	6:45 AM
RSLN-0276	HA	WE DW	1013	Principal Office	1/10/20	6:53 AM
RSLN-0279	NO	IM	1016	Nurse's Office	1/10/20	6:50 AM
RSLN-0280	NO	BF	1016A	Nurse's Office Bathroom	1/10/20	6:48 AM
RSLN-0281	CR	DW	1017	Room 15	1/10/20	6:38 AM
RSLN-0282	CR	CF	1017	Room 15	1/10/20	6:39 AM
RSLN-0283	CR	DW	1018	Room 14	1/10/20	6:35 AM
RSLN-0284	CR	CF	1018	Room 14	1/10/20	6:35 AM
RSLN-0285	HA	WE DW	1021	Breezeway o/s Office 41	1/10/20	6:16 AM
RSLN-0286	HA	WE DW	1021	Breezeway o/s Office 41	1/10/20	6:17 AM
RSLN-0287	BR	BF	1021	Handicap Bathroom	1/10/20	6:34 AM
RSLN-0288	CR	DW	1024	Room 32	1/10/20	6:22 AM
RSLN-0289	CR	CF	1024	Room 32	1/10/20	6:22 AM
RSLN-0290	CR	BF	1024A	Room 32 Bathroom	1/10/20	6:26 AM
RSLN-0291	CR	BF	1025B	Room 28 Bathroom	1/10/20	6:29 AM
RSLN-0292	CR	DW	1025	Room 28	1/10/20	6:29 AM
RSLN-0293	CR	DW CF	1025	Room 28	1/10/20	6:30 AM

Building Address

The Heights School

240 Willow Street

Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5

Lab Received:

Katie Gonzalez

Signature:

01/10/20 12:19pm

062000622

Samplers Name: NICHOLAS SANCANO

Samplers Signature:

JCB Project Manager:

Anthony Lombardo

via carrier

Alyssa McDonald 1/17/20



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

1/18/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 1/10/2020. The results are tabulated on the attached data pages for the following client designated project:

**Roslyn UFSD, THS Building, The Heights School 240 Willow
Street Roslyn Heights, New York 11577 Proj #: 19-45006**

The reference number for these samples is EMSL Order #062000622. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000622

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/10/20 12:19 PM
 Collected: 1/10/2020

Project: Roslyn UFSD, THS Building, The Heights School 240 Willow Street Roslyn Heights, New York 11577 Proj #: 19-45006

Analytical Results

Client Sample Description RSLN-0274 **Collected:** 1/10/2020 **Lab ID:** 062000622-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLN-0275 **Collected:** 1/10/2020 **Lab ID:** 062000622-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	1/16/2020	AL	1/17/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0276 **Collected:** 1/10/2020 **Lab ID:** 062000622-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	1/16/2020	AL	1/17/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0279 **Collected:** 1/10/2020 **Lab ID:** 062000622-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLN-0280 **Collected:** 1/10/2020 **Lab ID:** 062000622-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	24	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLN-0281 **Collected:** 1/10/2020 **Lab ID:** 062000622-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	1/16/2020	AL	1/17/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0282 **Collected:** 1/10/2020 **Lab ID:** 062000622-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	1/16/2020	AL	1/17/2020	AM
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000622

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/10/20 12:19 PM
 Collected: 1/10/2020

Project: **Roslyn UFSD, THS Building, The Heights School 240 Willow Street Roslyn Heights, New York 11577 Proj #: 19-45006**

Analytical Results

Client Sample Description RSLN-0283 **Collected:** 1/10/2020 **Lab ID:** 062000622-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLN-0284 **Collected:** 1/10/2020 **Lab ID:** 062000622-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLN-0285 **Collected:** 1/10/2020 **Lab ID:** 062000622-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLN-0286 **Collected:** 1/10/2020 **Lab ID:** 062000622-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLN-0287 **Collected:** 1/10/2020 **Lab ID:** 062000622-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLN-0288 **Collected:** 1/10/2020 **Lab ID:** 062000622-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLN-0289 **Collected:** 1/10/2020 **Lab ID:** 062000622-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000622

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/10/20 12:19 PM
 Collected: 1/10/2020

Project: **Roslyn UFSD, THS Building, The Heights School 240 Willow Street Roslyn Heights, New York 11577 Proj #: 19-45006**

Analytical Results

Client Sample Description RSLN-0290 **Collected:** 1/10/2020 **Lab ID:** 062000622-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	1/16/2020	AL	1/17/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0291 **Collected:** 1/10/2020 **Lab ID:** 062000622-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Client Sample Description RSLN-0292 **Collected:** 1/10/2020 **Lab ID:** 062000622-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	1/16/2020	AL	1/17/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0293 **Collected:** 1/10/2020 **Lab ID:** 062000622-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/16/2020	AL	1/17/2020	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: THS

Client:

Roslyn UFSD

Turn Around: Normal (1wk) Rush _____

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLN-0248	CR	KC	7	Science & Art Room	1/14	5:08
RSLN-0249	CR	KC	7	Science & Art Room	1/14	5:08
RSLN-0251	HA	WC	11	Library	1/14	5:10
RSLN-0254	FA	KC	16	Staff Lounge	1/14	5:13
RSLN-0255	BR	BF	0016A	Staff Lounge Bathroom	1/14	5:14
RSLN-0256	CR	DW	17	Room 2	1/14	5:19
RSLN-0257	CR	CF	17	Room 2	1/14	5:20
RSLN-0258	CR	DW	18	Room 1	1/14	5:17
RSLN-0259	CR	CF	18	Room 1	1/14	5:18
RSLN-0260	CR	DW	1000	Room 11	1/14	5:22
RSLN-0261	CR	CF	1000	Room 11	1/14	5:22
RSLN-0262	CR	DW	1001	Room 12	1/14	5:25
RSLN-0263	CR	CF	1001	Room 12	1/14	5:26
RSLN-0269	HA	WC	1004	Room 13	1/14	5:27
RSLN-0270	CR	DW	1004	Room 13	1/14	5:29
RSLN-0271	CR	CF	1004	Room 13	1/14	5:28
RSLN-0272	KI	KC	1006A	Cafeteria Kitchen	1/14	5:31
RSLN-0273	KI	KC	1006A	Cafeteria Kitchen	1/14	5:30

Building Address

The Heights School

240 Willow Street

Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5 NO 60Lab Received: Michelle DelittoSignature: MD 1/14/20

11:56 AM

Pb-A-Liang 01/21/20

Samplers Name: Alexandria OrlassinoSamplers Signature: A OrlassinoJCB Project Manager: Anthony LombardiVia: Carrier

062000861

20 JAN 14 AM 11:56
CARRIER PLACE IN



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: THS

Client:

Roslyn UFSD

Turn Around: Normal (twk) Rush

Sample ID	Functional Space Type	Outlet Type	AMERA ID	Common Room Name	Sample Date	Sample Time
RSLN-0294	CR	DW	1028	Room 29	1/14	5:48
RSLN-0295	CR	BF	1028A	Room 29 Bathroom	1/14	5:49
RSLN-0296	CR	DW	1030	Room 33	1/14	5:56
RSLN-0297	CR	CF	1030	Room 33	1/14	5:57
RSLN-0298	CR	BF	1030A	Room 33 Bathroom	1/14	5:57
RSLN-0299	CR	DW	1032	Room 34	1/14	6:00
RSLN-0300	CR	CF	1032	Room 34	1/14	6:01
RSLN-0301	CR	BF	1032B	Room 34 Bathroom	1/14	5:59
RSLN-0302	CR	DW	1034	Room 30	1/14	6:04
RSLN-0303	CR	DW CF	1034	Room 30	1/14	6:05
RSLN-0304	CR	BF	1034B	Room 30 Bathroom	1/14	6:06
RSLN-0306	CR	DW	1037	Room 31	1/14	6:08
RSLN-0307	CR	BF	1037A	Room 31 Bathroom	1/14	6:07
RSLN-0308	LI	KC	N/A (New Construction)	Library Storage Room	1/10/20	6:19 AM
RSLN-0309	OF	BF	N/A (New Construction)	Main Office 41 Bathroom	1/10/20	6:20 AM
RSLN-0310	CR	DW	2000	Room 27	1/14	6:13
RSLN-0311	CR	CF	2000	Room 27	1/14	6:13
RSLN-0312	CR	DW	2001	Room 24	1/14	6:15

Building Address

The Heights School

240 Willow Street

Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Alexandria OrlassinoSamplers Signature: A Orlassino

JCB Project Manager:

Anthony Lombardi

062000861

11:56 AM
Pb- A. Lombardi 01/21/20

via carrier



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006
Building: THS

Client:
Roslyn UFSD

Turn Around: Normal (1wk) Rush

Page 4 of 4

OrderID: 062000861

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLN-0313	CR	CF	2001	Room 24	1/14	6:16
RSLN-0317	CR	DW	2006	Room 25	1/14	6:17
RSLN-0318	HA	DW	2006	Room 25	1/14	6:17
RSLN-0319	CR	CF	2006	Room 25	1/14	6:18
RSLN-0320	CR	DW	2009	Room 23	1/14	6:20
RSLN-0321	CR	CF	2009	Room 23	1/14	6:21
RSLN-0326	CR	DW	2014	Room 22	1/14	6:24
RSLN-0327	CR	CF	2014	Room 22	1/14	6:23
RSLN-0328	CR	DW	2015	Room 21	1/14	6:26
RSLN-0329	CR	CF	2015	Room 21	1/14	6:25
RSLN-0719	CR	CF	1037	Room 31	1/14	6:25
RSLN-0720	CR	CF	1028	Room 29	1/14	5:50
RSLN-0721	CR	DW	1025	Room 28	1/14	5:53
RSLN-0722	KI	KC	1006A	Kitchen	1/14	5:40

* RSLN-0719 not included with these samples, will be submitted tomorrow (1/15/20)

Building Address

The Heights School
240 Willow Street

Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5

Lab Received:

Signature:

062000861

Samplers Name: Alexandria Orlassino

Samplers Signature: A Orlassino

JCB Project Manager: Anthony Lombardo

Pb: 1/21/20



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

1/23/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 1/14/2020. The results are tabulated on the attached data pages for the following client designated project:

**Roslyn UFSD, THS Building, The Heights School, 240 Willow
Street, Roslyn Heights, New York 11577, Project #:19-45006**

The reference number for these samples is EMSL Order #062000861. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000861

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/14/20 11:56 AM
 Collected: 1/14/2020

Project: Roslyn UFSD, THS Building, The Heights School, 240 Willow Street, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description RSLN-0248 **Collected:** 1/14/2020 **Lab ID:** 062000861-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/20/2020	AL	1/21/2020	AL

Client Sample Description RSLN-0249 **Collected:** 1/14/2020 **Lab ID:** 062000861-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/20/2020	AL	1/21/2020	AL

Client Sample Description RSLN-0251 **Collected:** 1/14/2020 **Lab ID:** 062000861-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	1/20/2020	AL	1/21/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0254 **Collected:** 1/14/2020 **Lab ID:** 062000861-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/20/2020	AL	1/21/2020	AL

Client Sample Description RSLN-0255 **Collected:** 1/14/2020 **Lab ID:** 062000861-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/20/2020	AL	1/21/2020	AL

Client Sample Description RSLN-0256 **Collected:** 1/14/2020 **Lab ID:** 062000861-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	1/20/2020	AL	1/21/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0257 **Collected:** 1/14/2020 **Lab ID:** 062000861-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	1/20/2020	AL	1/21/2020	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000861

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/14/20 11:56 AM
 Collected: 1/14/2020

Project: **Roslyn UFSD, THS Building, The Heights School, 240 Willow Street, Roslyn Heights, New York 11577, Project #:19-45006**

Analytical Results

Client Sample Description		RSLN-0258	Collected:	1/14/2020	Lab ID:	062000861-0008		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.6	3.0	µg/L	1/20/2020	AL	1/21/2020	AL
Client Sample Description		RSLN-0259	Collected:	1/14/2020	Lab ID:	062000861-0009		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0	µg/L	1/20/2020	AL	1/21/2020	AL
Client Sample Description		RSLN-0260	Collected:	1/14/2020	Lab ID:	062000861-0010		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	AL	1/21/2020	AL
Client Sample Description		RSLN-0261	Collected:	1/14/2020	Lab ID:	062000861-0011		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	AL	1/21/2020	AL
Client Sample Description		RSLN-0262	Collected:	1/14/2020	Lab ID:	062000861-0012		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	AL	1/21/2020	AL
Client Sample Description		RSLN-0263	Collected:	1/14/2020	Lab ID:	062000861-0013		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	AL	1/21/2020	AL
Client Sample Description		RSLN-0269	Collected:	1/14/2020	Lab ID:	062000861-0014		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0	µg/L	1/20/2020	AL	1/21/2020	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		RSLN-0270	Collected:	1/14/2020	Lab ID:	062000861-0015		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000861

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/14/20 11:56 AM
 Collected: 1/14/2020

Project: Roslyn UFSD, THS Building, The Heights School, 240 Willow Street, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description RSLN-0270 **Collected:** 1/14/2020 **Lab ID:** 062000861-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/20/2020	AL	1/21/2020	AL

Client Sample Description RSLN-0271 **Collected:** 1/14/2020 **Lab ID:** 062000861-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/20/2020	AL	1/21/2020	AL

Client Sample Description RSLN-0272 **Collected:** 1/14/2020 **Lab ID:** 062000861-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/20/2020	AL	1/21/2020	AL

Client Sample Description RSLN-0273 **Collected:** 1/14/2020 **Lab ID:** 062000861-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	1/20/2020	AL	1/21/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description RSLN-0294 **Collected:** 1/14/2020 **Lab ID:** 062000861-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	1/20/2020	AL	1/21/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description RSLN-0295 **Collected:** 1/14/2020 **Lab ID:** 062000861-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	1/20/2020	AL	1/21/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description RSLN-0296 **Collected:** 1/14/2020 **Lab ID:** 062000861-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/20/2020	DI	1/21/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000861

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/14/20 11:56 AM
 Collected: 1/14/2020

Project: Roslyn UFSD, THS Building, The Heights School, 240 Willow Street, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description		RSLN-0297		Collected:	1/14/2020	Lab ID:	062000861-0022	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0	µg/L	1/20/2020	DI	1/21/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		RSLN-0298		Collected:	1/14/2020	Lab ID:	062000861-0023	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	DI	1/21/2020	AL
Client Sample Description		RSLN-0299		Collected:	1/14/2020	Lab ID:	062000861-0024	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	DI	1/21/2020	AL
Client Sample Description		RSLN-0300		Collected:	1/14/2020	Lab ID:	062000861-0025	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	DI	1/21/2020	AL
Client Sample Description		RSLN-0301		Collected:	1/14/2020	Lab ID:	062000861-0026	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	DI	1/21/2020	AL
Client Sample Description		RSLN-0302		Collected:	1/14/2020	Lab ID:	062000861-0027	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	DI	1/21/2020	AL
Client Sample Description		RSLN-0303		Collected:	1/14/2020	Lab ID:	062000861-0028	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	DI	1/21/2020	AL
Client Sample Description		RSLN-0304		Collected:	1/14/2020	Lab ID:	062000861-0029	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000861

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/14/20 11:56 AM
 Collected: 1/14/2020

Project: Roslyn UFSD, THS Building, The Heights School, 240 Willow Street, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description		RSLN-0304	Collected:		1/14/2020	Lab ID:		062000861-0029
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	DI	1/21/2020	AL
Client Sample Description		RSLN-0306	Collected:		1/14/2020	Lab ID:		062000861-0030
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	DI	1/21/2020	AL
Client Sample Description		RSLN-0307	Collected:		1/14/2020	Lab ID:		062000861-0031
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	DI	1/21/2020	AL
Client Sample Description		RSLN-0308	Collected:		1/14/2020	Lab ID:		062000861-0032
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	DI	1/21/2020	AL
Client Sample Description		RSLN-0309	Collected:		1/14/2020	Lab ID:		062000861-0033
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	DI	1/21/2020	AL
Client Sample Description		RSLN-0310	Collected:		1/14/2020	Lab ID:		062000861-0034
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	DI	1/21/2020	AL
Client Sample Description		RSLN-0311	Collected:		1/14/2020	Lab ID:		062000861-0035
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	DI	1/21/2020	AL
Client Sample Description		RSLN-0312	Collected:		1/14/2020	Lab ID:		062000861-0036
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000861

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/14/20 11:56 AM
 Collected: 1/14/2020

Project: Roslyn UFSD, THS Building, The Heights School, 240 Willow Street, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description		RSLN-0312		Collected:	1/14/2020	Lab ID:	062000861-0036	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	DI	1/21/2020	AL
Client Sample Description		RSLN-0313		Collected:	1/14/2020	Lab ID:	062000861-0037	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	DI	1/21/2020	AL
Client Sample Description		RSLN-0317		Collected:	1/14/2020	Lab ID:	062000861-0038	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	DI	1/21/2020	AL
Client Sample Description		RSLN-0318		Collected:	1/14/2020	Lab ID:	062000861-0039	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	DI	1/21/2020	AL
Client Sample Description		RSLN-0319		Collected:	1/14/2020	Lab ID:	062000861-0040	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	DI	1/21/2020	AL
Client Sample Description		RSLN-0320		Collected:	1/14/2020	Lab ID:	062000861-0041	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	DI	1/20/2020	AL
Client Sample Description		RSLN-0321		Collected:	1/14/2020	Lab ID:	062000861-0042	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/20/2020	DI	1/20/2020	AL
Client Sample Description		RSLN-0326		Collected:	1/14/2020	Lab ID:	062000861-0043	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000861

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/14/20 11:56 AM
 Collected: 1/14/2020

Project: Roslyn UFSD, THS Building, The Heights School, 240 Willow Street, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description RSLN-0326 **Collected:** 1/14/2020 **Lab ID:** 062000861-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/20/2020	DI	1/20/2020	AL

Client Sample Description RSLN-0327 **Collected:** 1/14/2020 **Lab ID:** 062000861-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/20/2020	DI	1/20/2020	AL

Client Sample Description RSLN-0328 **Collected:** 1/14/2020 **Lab ID:** 062000861-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	1/20/2020	DI	1/20/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0329 **Collected:** 1/14/2020 **Lab ID:** 062000861-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0 µg/L	1/20/2020	DI	1/20/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0720 **Collected:** 1/14/2020 **Lab ID:** 062000861-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	250	3.0 µg/L	1/20/2020	DI	1/20/2020	AL

Client Sample Description RSLN-0721 **Collected:** 1/14/2020 **Lab ID:** 062000861-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	1/20/2020	DI	1/20/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0722 **Collected:** 1/14/2020 **Lab ID:** 062000861-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	1/20/2020	DI	1/20/2020	AL
Lead MDL: 1.0µg/L							



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>

carleplacelab@emsl.com

EMSL Order: 062000861
CustomerID: JCBR50
CustomerPO:
ProjectID:

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: THS

Client:

Roslyn UFSD

Turn Around: Normal (1wk)

Rush

Page 1 of 1

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLN-0719	CR	CF	1037	Room 31	1/16	6:39

ANALYTICAL, INC.
CARLE PLACE, NY
20 JAN 16 AM 11:53

Page 1 of 1

062001045

Building Address

The Heights School

240 Willow Street

Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Alissa McDonald 1/23/20

1/16/20 11:53 AM

Samplers Name:

Samplers Signature:

JCB Project Manager:

Via Corner



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

1/24/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 1/16/2020. The results are tabulated on the attached data pages for the following client designated project:

**Roslyn UFSD, THS Building, The Heights School, 240 Willow
Street, Roslyn Heights, New York 11577, Project #:19-45006**

The reference number for these samples is EMSL Order #062001045. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001045

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 01/16/20 11:53 AM
Collected: 1/16/2020

Project: Roslyn UFSD, THS Building, The Heights School, 240 Willow Street, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description RSLN-0719 **Collected:** 1/16/2020 **Lab ID:** 062001045-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	1/22/2020	AL	1/23/2020	AM
Lead MDL: 1.0µg/L							

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

1/27/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 1/23/2020. The results are tabulated on the attached data pages for the following client designated project:

**#19-45006, Roslyn UFSD, The Heights School, 240 Willow Street,
Roslyn Heights, NY**

The reference number for these samples is EMSL Order #062001590. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001590

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 01/23/20 12:09 PM
Collected: 1/23/2020

Project: #19-45006, Roslyn UFSD, The Heights School, 240 Willow Street, Roslyn Heights, NY

Analytical Results

Client Sample Description RSLYN-0280 **Collected:** 1/23/2020 **Lab ID:** 062001590-0001
Nurse's Office Bathroom

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	28	3.0 µg/L	1/24/2020	AL	1/27/2020	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted

OrderID: 062002479

JCB#:19-45006


Page 1 of 1
Date: 2/4/20

062002429

[illegible]

20 FEB -4 PM 3:21

Page 1 of 1

Client:	Roslyn Union Free School District		
Building Name and Address	The Heights School 240 Willow Street Roslyn Heights, New York 11577		
<u>Sampler's Name:</u>	Anthony Lombardo		
<u>Sampler's Signature:</u>			
<u>Relinquished By:</u>	<u>Received By:</u>	<u>Date:</u>	<u>Time:</u>
	 Uniqua McKoy	2/4/20	3:21pm

Laboratory Name:	EMSL	Date:	Time:	Method of Analysis
Analyzed By:	Alyssa McDonald	2/5/20		LEAD ELAP 200.5
QC By:				

Instructions to Laboratory	
Turnaround Time:	Standard (2 Day)
Email Report to:	alombardo@jcbroderick.com



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

2/6/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 2/4/2020. The results are tabulated on the attached data pages for the following client designated project:

The Heights School, 240 Willow Street, Roslyn Heights, New York 11577, Project # 19-45006

The reference number for these samples is EMSL Order #062002479. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062002479

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 02/04/20 3:21 PM
Collected: 2/4/2020

Project: **The Heights School, 240 Willow Street, Roslyn Heights, New York 11577, Project # 19-45006****Analytical Results**

Client Sample Description 280 **Collected:** 2/4/2020 **Lab ID:** 062002479-0001
Nurse's Office Bathroom

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	2/5/2020	AL	2/5/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description 720 **Collected:** 2/4/2020 **Lab ID:** 062002479-0002
Room 29

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.1	3.0 µg/L	2/5/2020	AL	2/5/2020	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006
Building: RMS

Client:
Roslyn UFSD

Turn Around: Normal (twk) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLN-0332	ST	CF	4	Custodial Storage/Lounge	1/15	5:08
RSLN-0352	CR	BF	1011A	Room 107 Bathroom	1/15	5:11
RSLN-0353	CR	KC	1014	Room 112	1/15	5:14
RSLN-0354	CR	BF	1014A	Room 112 Bathroom	1/15	5:14
RSLN-0362	HA	WC	1021	Corridor (Girls BR-Elevator Vestibule)	1/15	5:15
RSLN-0363	LI	CF	1022	Library	1/15	5:17
RSLN-0366	BR	BF	1027A	Conference Room 118 Bathroom	1/15	5:24
RSLN-0367	HA	WC	1028	Corridor (Library-Room 118)	1/15	5:26
RSLN-0368	HA	WC	1028	Corridor (Library-Room 118)	1/15	5:27
RSLN-0376	CR	EC	1035	Room 611	1/15	5:30
RSLN-0377	CR	EC	1035	Room 611	1/15	5:30
RSLN-0378	CR	EC	1035	Room 611	1/15	5:35
RSLN-0379	CR	EC	1035	Room 611	1/15	5:35
RSLN-0380	GLR	DW	1036	Girls Locker Room	1/15	5:40
RSLN-0381	GLR	DW	1036	Girls Locker Room	1/15	5:41
RSLN-0382	BLR	BF	1042	Boys Locker Room Bathroom	1/15	5:41
RSLN-0383	BLR	BF	1042	Boys Locker Room Bathroom	1/15	5:51
RSLN-0384	BLR	BF	1042	Boys Locker Room Bathroom	1/15	5:51

20 JAN 15 PM 12:02
CARLE PLACE, NY

Building Address

Roslyn Middle School
375 Locust Lane
Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5

Lab Received:

Signature: *Michelle DeLa*

Alexis McDonald

1/23/20

Samplers Name: *Danielle Bolegnini*

Samplers Signature: *Danielle Bolegnini*

JCB Project Manager: *Anthony Lombardo*

062001048



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006
Building: RMS

Client: Roslyn UFSD
Turn Around: Normal (1wk) Rush

Page 2 of 4

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLN-0385	GLR	BF	1036B1	Girls Locker Room Coach's Office Bathroom	1/15	5:38
RSLN-0386	HA	WC	1037	Gymnasium	1/15	5:47
RSLN-0387	HA	WC	1037	Gymnasium	1/15	5:48
RSLN-0388	HA	WC	1038	Corridor (Room 611-Corridor 1031)	1/15	5:33
RSLN-0389	HA	WC	1038	Corridor (Room 611-Corridor 1031)	1/15	5:32
RSLN-0392	KI	KC	1040B2	Cafeteria North Serving Room Kitchen	1/15	6:02
RSLN-0393	KI	KC	1040B2	Kitchen	1/15	6:02
RSLN-0394	KI	KC	1040B2	Kitchen	1/15	6:02
RSLN-0395	KI	KC	1040B2	Kitchen	1/15	6:02
RSLN-0396	KI	KC	1040B2	Kitchen	1/15	6:06
RSLN-0397	KI	BF	1040B2C	Kitchen Locker Room/Bathroom	1/15	6:04
RSLN-0399	CA	WC	1041	Cafeteria South	1/15	5:59
RSLN-0400	GLR	BF	1036A1	Girls Locker Room Bathroom	1/15	5:42
RSLN-0401	GLR	BF	1036A1	Girls Locker Room Bathroom	1/15	5:42
RSLN-0402	GLR	BF	1036A1	Girls Locker Room Bathroom	1/15	5:43
RSLN-0403	BLR	DW	1042A	Boys Locker Room	1/15	5:55
RSLN-0404	BLR	DW	1042A	Boys Locker Room	1/15	Not Functioning
RSLN-0405	BLR	BF	1042A2A	Boys Locker Room Coach's Office Bathroom	1/15	5:56

Building Address

Roslyn Middle School
375 Locust Lane
Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Alyssa McDonald 1/23/20

12:02 PM

Samplers Name: Danielle Belgiovanni

Lab's Signature: [Signature]

JCB Project Manager: Anthony Lombardo

062001048

OrderID: 062001048



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006
Building: RMS

Client:
Roslyn UFSD

Turn Around: Normal (twk) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLN-0407	BR	BF	1046A	Boiler Room Stairwell Bathroom	1/16	5:03
RSLN-0408	BR	BF	1047	Handicap Bathroom	1/16	5:04
RSLN-0409	FR	KC	1048	Faculty Room	1/16	5:06
RSLN-0410	FA	BF	1048A	Faculty Room Men's Bathroom	1/16	5:07
RSLN-0411	FA	BF	1048B	Faculty Room Women's Bathroom	1/16	5:07
RSLN-0414	CC	BF	1056	Custodial Closet	1/16	5:10
RSLN-0417	OF	KC	1060	Tech A PPS	1/16	5:12
RSLN-0418	HA	WC	1061	Corridor (Tech A-Boys Bathroom)	1/16	5:16
RSLN-0419	HA	WC	1068	Corridor (Room 129-Exit)	1/16	5:21
RSLN-0420	NO	IM	1070	Health Office	1/16	5:28
RSLN-0421	NO	NS	1070	Health Office	1/16	5:35
RSLN-0422	NO	NS	1070A	Health Office Exam Room	1/16	5:37
RSLN-0423	NO	BF	1070B	Health Office Bathroom	1/16	5:35
RSLN-0424	CR	IM	N/A (New Construction)	Trainers Room	1/16	5:43
RSLN-0425	CR	CF	N/A (New Construction)	Trainers Room	1/16	5:41
RSLN-0426	OF	BF	N/A (New Construction)	Main Office Bathroom	1/16	5:36
RSLN-0427	BLR	BF	N/A (New Construction)	New Gym Boys Locker Room Bathroom	1/16	5:48
RSLN-0428	BLR	BF	N/A (New Construction)	New Gym Boys Locker Room Bathroom	1/16	5:49

Building Address

Roslyn Middle School
375 Locust Lane
Roslyn Heights New York 11577

Analysis Type: ELAP 2005

Lab Received

Signature:

Alexis McDonald 1/23/20

1/16/20
12:02 PM

Samplers Name: Danielle Bolognini

Samplers Signature: [Signature]

JCB Project Manager: Anthony Lombardi

062001048



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006
Building: RMS

Client: Roslyn UFSD
Turn Around: Normal (twk) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLN-0429	BLR	BF	N/A (New Construction)	New Gym Boys Locker Room Bathroom	1/16	5:49
RSLN-0430	GLR	BF	N/A (New Construction)	New Gym Girls Locker Room Bathroom	1/16	5:45
RSLN-0431	GLR	BF	N/A (New Construction)	New Gym Girls Locker Room Bathroom	1/16	5:46
RSLN-0432	GLR	BF	N/A (New Construction)	New Gym Girls Locker Room Bathroom	1/16	5:46
RSLN-0433	GY	BF	N/A (New Construction)	New Gym PE Office Bathroom	1/16	5:51
RSLN-0457	HA	WC	2003	Custodial Closet	1/15	5:22
RSLN-0481	GY	HB	N/A (New Construction)	Exterior o/s New Gym	1/16	6:02
RSLN-0482	GY	HB	N/A (New Construction)	Exterior o/s New Gym	1/16	6:05
RSLN-0741	HA	WC	1028	Corridor (Library - Room 118)	1/15	5:27
RSLN-0742	CA	WC	1041	Cafeteria South	1/15	6:00
RSLN-0743	OF	WC	1060	Tech APPS	1/16	5:14

20 JAN 16 PM 12:02
JCB PROJECT INC.
SALE PLACE, NY

062001048

Building Address

Roslyn Middle School
375 Locust Lane
Roslyn Heights New York 11577

Analysis Type: ELAP 2005

Lab Received: Michelle DeLuca

Signature: [Signature] 1/16/20 12:02 PM

Anthony McDonald 1/23/20

Samplers Name: Danielle Belongia

Samplers Signature: [Signature]

JCB Project Manager: Anthony Lombardo



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

1/24/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 1/16/2020. The results are tabulated on the attached data pages for the following client designated project:

Roslyn UFSD, RMS Building, Roslyn Middle School, 375 Locust Lane, Roslyn Heights, New York 11577, Project #:19-45006

The reference number for these samples is EMSL Order #062001048. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001048

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/16/20 12:02 PM
 Collected: 1/15/2020

Project: Roslyn UFSD, RMS Building, Roslyn Middle School, 375 Locust Lane, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description RSLN-0332 **Collected:** 1/15/2020 **Lab ID:** 062001048-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	1/21/2020	DI	1/23/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0352 **Collected:** 1/15/2020 **Lab ID:** 062001048-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.2	3.0 µg/L	1/21/2020	DI	1/23/2020	AM

Client Sample Description RSLN-0353 **Collected:** 1/15/2020 **Lab ID:** 062001048-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.8	3.0 µg/L	1/21/2020	DI	1/23/2020	AM

Client Sample Description RSLN-0354 **Collected:** 1/15/2020 **Lab ID:** 062001048-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.7	3.0 µg/L	1/21/2020	DI	1/23/2020	AM

Client Sample Description RSLN-0362 **Collected:** 1/15/2020 **Lab ID:** 062001048-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/21/2020	DI	1/23/2020	AM

Client Sample Description RSLN-0363 **Collected:** 1/15/2020 **Lab ID:** 062001048-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.7	3.0 µg/L	1/21/2020	DI	1/23/2020	AM

Client Sample Description RSLN-0366 **Collected:** 1/15/2020 **Lab ID:** 062001048-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.4	3.0 µg/L	1/21/2020	DI	1/23/2020	AM

Client Sample Description RSLN-0367 **Collected:** 1/15/2020 **Lab ID:** 062001048-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001048

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/16/20 12:02 PM
 Collected: 1/15/2020

Project: **Roslyn UFSD, RMS Building, Roslyn Middle School, 375 Locust Lane, Roslyn Heights, New York 11577, Project #:19-45006**

Analytical Results

Client Sample Description RSLN-0367 **Collected:** 1/15/2020 **Lab ID:** 062001048-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/21/2020	DI	1/23/2020	AM

Client Sample Description RSLN-0368 **Collected:** 1/15/2020 **Lab ID:** 062001048-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/21/2020	DI	1/23/2020	AM

Client Sample Description RSLN-0376 **Collected:** 1/15/2020 **Lab ID:** 062001048-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/21/2020	DI	1/23/2020	AM

Client Sample Description RSLN-0377 **Collected:** 1/15/2020 **Lab ID:** 062001048-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/21/2020	DI	1/23/2020	AM

Client Sample Description RSLN-0378 **Collected:** 1/15/2020 **Lab ID:** 062001048-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/21/2020	DI	1/23/2020	AM

Client Sample Description RSLN-0379 **Collected:** 1/15/2020 **Lab ID:** 062001048-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/21/2020	DI	1/23/2020	AM

Client Sample Description RSLN-0380 **Collected:** 1/15/2020 **Lab ID:** 062001048-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	1/21/2020	DI	1/23/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLN-0381 **Collected:** 1/15/2020 **Lab ID:** 062001048-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001048

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/16/20 12:02 PM
 Collected: 1/15/2020

Project: Roslyn UFSD, RMS Building, Roslyn Middle School, 375 Locust Lane, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description		RSLN-0381		Collected:	1/15/2020	Lab ID:	062001048-0015	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0	µg/L	1/21/2020	DI	1/23/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		RSLN-0382		Collected:	1/15/2020	Lab ID:	062001048-0016	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/21/2020	DI	1/23/2020	AM
Client Sample Description		RSLN-0383		Collected:	1/15/2020	Lab ID:	062001048-0017	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.4	3.0	µg/L	1/21/2020	DI	1/23/2020	AM
Client Sample Description		RSLN-0384		Collected:	1/15/2020	Lab ID:	062001048-0018	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	23	3.0	µg/L	1/21/2020	DI	1/23/2020	AM
Client Sample Description		RSLN-0385		Collected:	1/15/2020	Lab ID:	062001048-0019	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/21/2020	DI	1/23/2020	AM
Client Sample Description		RSLN-0386		Collected:	1/15/2020	Lab ID:	062001048-0020	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/21/2020	DI	1/23/2020	AM
Client Sample Description		RSLN-0387		Collected:	1/15/2020	Lab ID:	062001048-0021	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/22/2020	AL	1/23/2020	AM
Client Sample Description		RSLN-0388		Collected:	1/15/2020	Lab ID:	062001048-0022	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001048

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/16/20 12:02 PM
 Collected: 1/15/2020

Project: Roslyn UFSD, RMS Building, Roslyn Middle School, 375 Locust Lane, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description RSLN-0388 **Collected:** 1/15/2020 **Lab ID:** 062001048-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

Client Sample Description RSLN-0389 **Collected:** 1/15/2020 **Lab ID:** 062001048-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

Client Sample Description RSLN-0392 **Collected:** 1/15/2020 **Lab ID:** 062001048-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLN-0393 **Collected:** 1/15/2020 **Lab ID:** 062001048-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

Client Sample Description RSLN-0394 **Collected:** 1/15/2020 **Lab ID:** 062001048-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

Client Sample Description RSLN-0395 **Collected:** 1/15/2020 **Lab ID:** 062001048-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLN-0396 **Collected:** 1/15/2020 **Lab ID:** 062001048-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001048

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/16/20 12:02 PM
 Collected: 1/15/2020

Project: Roslyn UFSD, RMS Building, Roslyn Middle School, 375 Locust Lane, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description		RSLN-0397	Collected:	1/15/2020	Lab ID:	062001048-0029		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0	µg/L	1/22/2020	AL	1/23/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		RSLN-0399	Collected:	1/15/2020	Lab ID:	062001048-0030		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/22/2020	AL	1/23/2020	AM
Client Sample Description		RSLN-0400	Collected:	1/15/2020	Lab ID:	062001048-0031		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	1/22/2020	AL	1/23/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		RSLN-0401	Collected:	1/15/2020	Lab ID:	062001048-0032		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/22/2020	AL	1/23/2020	AM
Client Sample Description		RSLN-0402	Collected:	1/15/2020	Lab ID:	062001048-0033		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/22/2020	AL	1/23/2020	AM
Client Sample Description		RSLN-0403	Collected:	1/15/2020	Lab ID:	062001048-0034		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0	µg/L	1/22/2020	AL	1/23/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		RSLN-0405	Collected:	1/15/2020	Lab ID:	062001048-0035		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/22/2020	AL	1/23/2020	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001048

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/16/20 12:02 PM
 Collected: 1/15/2020

Project: Roslyn UFSD, RMS Building, Roslyn Middle School, 375 Locust Lane, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description RSLN-0407 **Collected:** 1/15/2020 **Lab ID:** 062001048-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

Client Sample Description RSLN-0408 **Collected:** 1/15/2020 **Lab ID:** 062001048-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLN-0409 **Collected:** 1/15/2020 **Lab ID:** 062001048-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

Client Sample Description RSLN-0410 **Collected:** 1/15/2020 **Lab ID:** 062001048-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

Client Sample Description RSLN-0411 **Collected:** 1/15/2020 **Lab ID:** 062001048-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

Client Sample Description RSLN-0414 **Collected:** 1/15/2020 **Lab ID:** 062001048-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.3	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

Client Sample Description RSLN-0417 **Collected:** 1/15/2020 **Lab ID:** 062001048-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	10	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

Client Sample Description RSLN-0418 **Collected:** 1/15/2020 **Lab ID:** 062001048-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001048

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/16/20 12:02 PM
 Collected: 1/15/2020

Project: Roslyn UFSD, RMS Building, Roslyn Middle School, 375 Locust Lane, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description RSLN-0418 **Collected:** 1/15/2020 **Lab ID:** 062001048-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

Client Sample Description RSLN-0419 **Collected:** 1/15/2020 **Lab ID:** 062001048-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	1/22/2020	AL	1/23/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0420 **Collected:** 1/15/2020 **Lab ID:** 062001048-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

Client Sample Description RSLN-0421 **Collected:** 1/15/2020 **Lab ID:** 062001048-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

Client Sample Description RSLN-0422 **Collected:** 1/15/2020 **Lab ID:** 062001048-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	1/22/2020	AL	1/23/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0423 **Collected:** 1/15/2020 **Lab ID:** 062001048-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

Client Sample Description RSLN-0424 **Collected:** 1/15/2020 **Lab ID:** 062001048-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001048

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/16/20 12:02 PM
 Collected: 1/15/2020

Project: Roslyn UFSD, RMS Building, Roslyn Middle School, 375 Locust Lane, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description		RSLN-0425	Collected:	1/15/2020	Lab ID:	062001048-0050		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0	µg/L	1/22/2020	AL	1/23/2020	AM
Client Sample Description		RSLN-0426	Collected:	1/15/2020	Lab ID:	062001048-0051		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/22/2020	AL	1/23/2020	AM
Client Sample Description		RSLN-0427	Collected:	1/15/2020	Lab ID:	062001048-0052		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/22/2020	AL	1/23/2020	AM
Client Sample Description		RSLN-0428	Collected:	1/15/2020	Lab ID:	062001048-0053		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0	µg/L	1/22/2020	AL	1/23/2020	AM
		Lead MDL: 1.0µg/L						
Client Sample Description		RSLN-0429	Collected:	1/15/2020	Lab ID:	062001048-0054		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/22/2020	AL	1/23/2020	AM
Client Sample Description		RSLN-0430	Collected:	1/15/2020	Lab ID:	062001048-0055		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/22/2020	AL	1/23/2020	AM
Client Sample Description		RSLN-0431	Collected:	1/15/2020	Lab ID:	062001048-0056		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/22/2020	AL	1/23/2020	AM
Client Sample Description		RSLN-0432	Collected:	1/15/2020	Lab ID:	062001048-0057		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001048

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/16/20 12:02 PM
 Collected: 1/15/2020

Project: Roslyn UFSD, RMS Building, Roslyn Middle School, 375 Locust Lane, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description RSLN-0432 **Collected:** 1/15/2020 **Lab ID:** 062001048-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

Client Sample Description RSLN-0433 **Collected:** 1/15/2020 **Lab ID:** 062001048-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLN-0457 **Collected:** 1/15/2020 **Lab ID:** 062001048-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

Client Sample Description RSLN-0481 **Collected:** 1/15/2020 **Lab ID:** 062001048-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.3	3.0 µg/L	1/22/2020	AL	1/23/2020	AM

Client Sample Description RSLN-0482 **Collected:** 1/15/2020 **Lab ID:** 062001048-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0 µg/L	1/21/2020	DI	1/23/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLN-0741 **Collected:** 1/15/2020 **Lab ID:** 062001048-0062

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/21/2020	DI	1/23/2020	AM

Client Sample Description RSLN-0742 **Collected:** 1/15/2020 **Lab ID:** 062001048-0063

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/21/2020	DI	1/23/2020	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001048

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 01/16/20 12:02 PM
Collected: 1/15/2020

Project: Roslyn UFSD, RMS Building, Roslyn Middle School, 375 Locust Lane, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description RSLN-0743 **Collected:** 1/15/2020 **Lab ID:** 062001048-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/21/2020	DI	1/23/2020	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: RMB

Client: Roslyn UFSD

Re-test/New Install ☒

Turn Around: Normal (1wk)

Rush _____

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN - 0739	ST	BF	N/A (New Construction)	Bus Garage Bathroom	3/10/20	7:25

062005155

* Final Submit *

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY

20 MAR 10 PM 9:50

Building Address

Roslyn Maintenance Building

3 Parp Drive

Greenvale, NY 11548

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Pb 200.5 - A. J. [Signature] 03/13/20

Samplers Name:

Samplers Signature:

JCB Project Manager:

Rev.13020



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

3/18/2020

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 3/10/2020. The results are tabulated on the attached data pages for the following client designated project:

JCB#: 19-45006, Building: RMB, Roslyn UFSD, Roslyn
Maintenance Building, 3 Parp Drive, Greenvale, NY 11548

The reference number for these samples is EMSL Order #062005155. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062005155

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 03/10/20 9:50 PM
Collected: 3/10/2020

Project: JCB#: 19-45006, Building: RMB, Roslyn UFSD, Roslyn Maintenance Building, 3 Parp Drive, Greenvale, NY 11548

Analytical Results

Client Sample Description RSLYN-0739 **Collected:** 3/10/2020 **Lab ID:** 062005155-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	3/12/2020	AL	3/13/2020	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in ater: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006
Building: Roslyn
Middle
School

Client: Roslyn UFSD

Re-test/New Install ☒
Turn Around: Normal (1wk)

Rush _____

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN - 0384	BR	BF	1042	Boys Locker Room Bathroom	3/10/20	6:34

Final Submit

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
20 MAR 10 PM 9:49

062005173

Building Address
Roslyn Middle School
375 Locust Lane
Roslyn Heights, NY 11577

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Pb 200.5 - A. Lang 03/13/20

Samplers Name: *Dejick Belognini*

Samplers Signature: *Dejick Belognini*

JCB Project Manager: *Anthony Lombardo*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

3/18/2020

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 3/10/2020. The results are tabulated on the attached data pages for the following client designated project:

JCB#: 19-45006, Roslyn UFSD, Roslyn Middle School, 375 Locust Lane, Roslyn Heights, NY 11577

The reference number for these samples is EMSL Order #062005173. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062005173

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 03/10/20 9:49 PM
Collected: 3/10/2020

Project: JCB#: 19-45006, Roslyn UFSD, Roslyn Middle School, 375 Locust Lane, Roslyn Heights, NY 11577

Analytical Results**Client Sample Description** RSLYN-0384**Collected:** 3/10/2020**Lab ID:** 062005173-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	3/12/2020	AL	3/13/2020	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: RHS

Client:

Roslyn UFSD

Turn Around: Normal (10K) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLN-0557	GB	BF	1040	Women's Bathroom	1/11/20	5:15
RSLN-0558	GB	BF	1040	Women's Bathroom	1/11/20	5:15
RSLN-0559	BB	BF	1041	Men's Bathroom	1/11/20	5:17
RSLN-0560	BB	BF	1041	Men's Bathroom	1/11/20	5:17
RSLN-0562	GLR	BF	1048A	Girls Coach's Locker Room Bathroom	1/11/20	5:31
RSLN-0563	GLR	WC	1048B	Girls Locker Room	1/11/20	NOT FUNCTIONING
RSLN-0564	GLR	BF	1048B1	Girls Locker Room Bathroom/Shower	1/11/20	5:28
RSLN-0565	GLR	BF	1048B1	Girls Locker Room Bathroom/Shower	1/11/20	5:28
RSLN-0566	GLR	BF	1048B1	Girls Locker Room Bathroom/Shower	1/11/20	5:29
RSLN-0567	BLR	WC	1051	Men's Locker Room	1/11/20	5:34
RSLN-0579	HA	WC	1062	Men's Bathroom	1/11/20	5:38
RSLN-0583	WBR	BF	1064	Faculty Women's Bathroom	1/11/20	5:40
RSLN-0586	CR	KC	1071B	English Prep Room Kitchen	1/11/20	5:43
RSLN-0587	CR	CF	1083	Room 112 Computer Room	1/11/20	5:43 DNE
RSLN-0588	CR	KC	1083A	Room 112 Computer Room Storage	1/11/20	5:46
RSLN-0591	OF	BW	1088	Guidance Reception	1/11/20	5:54
RSLN-0596	HA	WC	1092	Nurse's Office	1/11/20	5:58
RSLN-0597	NO	NS	1092	Nurse's Office	1/11/20	5:59

Building Address

Roslyn High School

475 Round Hill Road

Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5 MD ADLab Received: Michelle DeVitoSignature: NUSSEN ADSamplers Name: Alexandria OrlassiniSamplers Signature: Alexandria OrlassiniJCB Project Manager: Anthony Lombardo

062000800

Pb 200.5 - A. Lumb 01/20/20

20 JAN 13 PM 2:30
 RECEIVED
 NYS
 STATE



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: RHS

Client:
Roslyn UFSD

Turn Around: Normal (1wk) Rush _____

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLN-0598	NO	NS	1092C	Nurse's Office Bathroom	1/11/20	6:00
RSLN-0599	FA	BF	1093A	Faculty Lounge Bathroom	1/11/20	6:13
RSLN-0600	FA	BF	1093C1	Faculty Lounge Vestibule Bathroom	1/11/20	6:13
RSLN-0601	FA	KC	1093	Faculty Lounge	1/11/20	6:14
RSLN-0603	OF	BF	1099G	Main Office Men's Bathroom	1/11/20	6:06
RSLN-0604	OF	BF	1099J	Main Office Women's Bathroom	1/11/20	6:07
RSLN-0605	OF	CF	1099K	Main Office Conference Room	1/11/20	6:08
RSLN-0606	OF	WC	1099M	Main Office Hallway	1/11/20	6:09
RSLN-0607	CR	we DW	1101	Cafeteria	1/11/20	6:20
RSLN-0608	CR	WC	1101	Cafeteria	1/11/20	6:21
RSLN-0609	KI	KC	1102	Kitchen	1/11/20	6:23
RSLN-0610	KI	KC	1102	Kitchen	1/11/20	6:22
RSLN-0611	KI	KC	1102	Kitchen	1/11/20	6:21
RSLN-0612	KI	KC	1102	kitchen	1/11/20	6:26
RSLN-0613	KI	KC	1102	Kitchen	1/11/20	6:22
RSLN-0614	KI	KC	1102	Kitchen	1/11/20	6:23
RSLN-0615	KI	KC	1102	Kitchen	1/11/20	6:24
RSLN-0616	KI	KC	1102A	Kitchen Sevring Line	1/11/20	6:21

20 JAN 13 PM 2:32
LABELED BY: [Signature]

Building Address

Roslyn High School
475 Round Hill Road
Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5 WAL

Lab Received: Michelle DeWitt

Signature: MDW

Samplers Name: Alexandria Orlassino

Samplers Signature: Alexandria Orlassino

JCB Project Manager: Anthony Lombardo

062000800

Pb 200.5 - A. Lombardo 01/29/20



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

1/21/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 1/13/2020. The results are tabulated on the attached data pages for the following client designated project:

**Roslyn UFSD, RHS Building, Roslyn High School, 475 Round Hill
Road, Roslyn Heights, New York 11577, Project #:19-45006**

The reference number for these samples is EMSL Order #062000800. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000800

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/13/20 2:32 PM
 Collected: 1/11/2020

Project: Roslyn UFSD, RHS Building, Roslyn High School, 475 Round Hill Road, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description RSLN-0557 **Collected:** 1/11/2020 **Lab ID:** 062000800-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/18/2020	AL	1/20/2020	AL

Client Sample Description RSLN-0558 **Collected:** 1/11/2020 **Lab ID:** 062000800-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/18/2020	AL	1/20/2020	AL

Client Sample Description RSLN-0559 **Collected:** 1/11/2020 **Lab ID:** 062000800-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	1/18/2020	AL	1/20/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description RSLN-0560 **Collected:** 1/11/2020 **Lab ID:** 062000800-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0	3.0 µg/L	1/18/2020	AL	1/20/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description RSLN-0562 **Collected:** 1/11/2020 **Lab ID:** 062000800-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/18/2020	AL	1/20/2020	AL

Client Sample Description RSLN-0564 **Collected:** 1/11/2020 **Lab ID:** 062000800-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	1/18/2020	AL	1/20/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description RSLN-0565 **Collected:** 1/11/2020 **Lab ID:** 062000800-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	1/18/2020	AL	1/20/2020	AL

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000800

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/13/20 2:32 PM
 Collected: 1/11/2020

Project: Roslyn UFSD, RHS Building, Roslyn High School, 475 Round Hill Road, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description RSLN-0566 **Collected:** 1/11/2020 **Lab ID:** 062000800-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.6	3.0 µg/L	1/18/2020	AL	1/20/2020	AL

Client Sample Description RSLN-0567 **Collected:** 1/11/2020 **Lab ID:** 062000800-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/18/2020	AL	1/20/2020	AL

Client Sample Description RSLN-0579 **Collected:** 1/11/2020 **Lab ID:** 062000800-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/18/2020	AL	1/20/2020	AL

Client Sample Description RSLN-0583 **Collected:** 1/11/2020 **Lab ID:** 062000800-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	1/18/2020	AL	1/20/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description RSLN-0586 **Collected:** 1/11/2020 **Lab ID:** 062000800-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	1/18/2020	AL	1/20/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description RSLN-0588 **Collected:** 1/11/2020 **Lab ID:** 062000800-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	1/18/2020	AL	1/20/2020	AL

Client Sample Description RSLN-0591 **Collected:** 1/11/2020 **Lab ID:** 062000800-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/18/2020	AL	1/20/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000800

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/13/20 2:32 PM
 Collected: 1/11/2020

Project: Roslyn UFSD, RHS Building, Roslyn High School, 475 Round Hill Road, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description RSLN-0596 **Collected:** 1/11/2020 **Lab ID:** 062000800-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/18/2020	AL	1/20/2020	AL

Client Sample Description RSLN-0597 **Collected:** 1/11/2020 **Lab ID:** 062000800-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	1/18/2020	AL	1/20/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description RSLN-0598 **Collected:** 1/11/2020 **Lab ID:** 062000800-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/18/2020	AL	1/20/2020	AL

Client Sample Description RSLN-0599 **Collected:** 1/11/2020 **Lab ID:** 062000800-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/18/2020	AL	1/20/2020	AL

Client Sample Description RSLN-0600 **Collected:** 1/11/2020 **Lab ID:** 062000800-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/18/2020	AL	1/20/2020	AL

Client Sample Description RSLN-0601 **Collected:** 1/11/2020 **Lab ID:** 062000800-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/18/2020	AL	1/20/2020	AL

Client Sample Description RSLN-0603 **Collected:** 1/11/2020 **Lab ID:** 062000800-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	1/18/2020	AL	1/18/2020	AL

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000800

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/13/20 2:32 PM
 Collected: 1/11/2020

Project: Roslyn UFSD, RHS Building, Roslyn High School, 475 Round Hill Road, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description RSLN-0604 **Collected:** 1/11/2020 **Lab ID:** 062000800-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0 µg/L	1/18/2020	AL	1/18/2020	AL

Client Sample Description RSLN-0605 **Collected:** 1/11/2020 **Lab ID:** 062000800-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	1/18/2020	AL	1/18/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0606 **Collected:** 1/11/2020 **Lab ID:** 062000800-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	1/18/2020	AL	1/18/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0607 **Collected:** 1/11/2020 **Lab ID:** 062000800-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	1/18/2020	AL	1/18/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0608 **Collected:** 1/11/2020 **Lab ID:** 062000800-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	1/18/2020	AL	1/18/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0609 **Collected:** 1/11/2020 **Lab ID:** 062000800-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	1/18/2020	AL	1/18/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0610 **Collected:** 1/11/2020 **Lab ID:** 062000800-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	1/18/2020	AL	1/18/2020	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062000800

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/13/20 2:32 PM
 Collected: 1/11/2020

Project: **Roslyn UFSD, RHS Building, Roslyn High School, 475 Round Hill Road, Roslyn Heights, New York 11577, Project #:19-45006**

Analytical Results

Client Sample Description RSLN-0611 **Collected:** 1/11/2020 **Lab ID:** 062000800-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0 µg/L	1/18/2020	AL	1/18/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0612 **Collected:** 1/11/2020 **Lab ID:** 062000800-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	1/18/2020	AL	1/18/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0613 **Collected:** 1/11/2020 **Lab ID:** 062000800-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0 µg/L	1/18/2020	AL	1/18/2020	AL

Client Sample Description RSLN-0614 **Collected:** 1/11/2020 **Lab ID:** 062000800-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 J	3.0 µg/L	1/18/2020	AL	1/18/2020	AL

Client Sample Description RSLN-0615 **Collected:** 1/11/2020 **Lab ID:** 062000800-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	1/18/2020	AL	1/18/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0616 **Collected:** 1/11/2020 **Lab ID:** 062000800-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0 µg/L	1/18/2020	AL	1/18/2020	AL

Definitions:


MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: RHS

Client:

Roslyn UFSD

Turn Around: Normal (TWK) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLN-0485	HA	WC	4	Girls Bathroom	1/17	5:03
RSLN-0486	GB	BF	4	Girls Bathroom	1/17	5:05
RSLN-0487	GB	BF	4	Girls Bathroom	1/17	5:04
RSLN-0489	BB	BF	6	Boys Bathroom	1/17	5:07
RSLN-0490	BB	BF	6	Boys Bathroom	1/17	5:07
RSLN-0492	BR	BF	16	Bathroom	1/17	5:11
RSLN-0493	HA	WC	1000	Men's Bathroom	1/17	5:29
RSLN-0494	HA	WC	1000	Men's Bathroom	1/17	5:30
RSLN-0498	WBR	BF	1002	Women's Faculty Bathroom	1/17	5:31
RSLN-0501	CR	CF	1006	Room 138	1/17	5:32
RSLN-0502	CR	BW	1016	Foreign Language Study Center	1/17	5:30
RSLN-0503	CR	CF	1016	Foreign Language Study Center	1/17	5:34
RSLN-0551	HA	WC	1030	Men's Bathroom	1/17	5:38
RSLN-0552	CR	CF	1031	Room 125 & 124 Science Offices	1/17	5:40
RSLN-0553	CR	CF	1032	Room 123	1/17	5:42
RSLN-0554	LI	KC	1037B	Librarian Office	1/17	5:44
RSLN-0555	HA	WC	1040	Women's Bathroom	1/17	5:46
RSLN-0556	KI	KC	1102	Kitchen	1/17	5:21

Building Address

Roslyn High School

475 Round Hill Road

Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Danielle Brignani

Samplers Signature: Danielle Brignani

JCB Project Manager: Anthony Lombardo

Alexis McDonald 1/24/20

062001159 1/17/20 12:04 PM



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: RHS

Client:

Roslyn UFSD

Turn Around: Normal (Hwk) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLN-0617	KI	KC	1102A	Kitchen Sevring Line	1/17	5:20
RSLN-0618	KI	KC	1102A	Kitchen Sevring Line	1/17	5:20
RSLN-0619	KI	KC	1102A	Kitchen Sevring Line	1/17	5:22
RSLN-0621	KI	BF	1102H	Kitchen Women's Bathroom	1/17	5:24
RSLN-0622	BR	BF	1104	Unisex Bathroom	1/17	5:56
RSLN-0623	BR	BF	1105	Unisex Bathroom	1/17	5:55
RSLN-0624	HA	WC	N/A (New Construction)	North Gym	1/17	6:03
RSLN-0625	HA	WC	N/A (New Construction)	North Gym	1/17	6:04
RSLN-0626	BR	BF	N/A (New Construction)	North Gym Bathroom	1/17	6:05
RSLN-0627	HA	WC	1048B	Girl's Locker Room	1/17	6:06
RSLN-0628	HA	WC	2001	Men's Bathroom	1/17	6:10
RSLN-0632	BR	BF	2004	Staff Bathroom	1/17	6:18
RSLN-0635	CR	CF	2008	Social Studies Offices	1/17	6:19
RSLN-0636	LR	BF	2023	Team Locker Room	1/17	6:21
RSLN-0637	LR	BF	2023	Team Locker Room	1/17	6:22
RSLN-0638	CR	IM	2024B	Training Vestibule	1/17	6:24
RSLN-0639	LR	BF	2024	Training Vestibule	1/17	6:31
RSLN-0640	LR	BF	2024	Training Vestibule	1/17	6:31

Building Address

Roslyn High School

475 Round Hill Road

Roslyn Heights, New York 11577

Analysis Type: ELAP 2005

Lab Received: Nichelle BologniniSignature: Nichelle BologniniSamplers Name: Danielle BologniniSamplers Signature: Danielle BologniniJCB Project Manager: Anthony Lombardo

* RSLN-0632 not submitted

Alyson McDonald
1/24/20

062001159

1/17/20 12:04 PM



Lead in Water: Chain of Custody for

J C. BRODERICK AND ASSOCIATES, INC

1775 Expressway North Hauppauge, NY 11788

TEL. (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: RHS

Client:

Roslyn UFSD

Turn Around: Normal (twk) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLN-0641	LR	BF	2024	Training Vestibule	1/17	6:32
RSLN-0643	HA	WC	2026	Physical Education & Athletics Room	1/17	6:26
RSLN-0648	HA	WC	2032	Women's Bathroom	1/17	6:33
RSLN-0689	OF	CF	2046	Math Offices	1/17	6:35
RSLN-0690	OF	BW	2046	Math Offices	1/17	6:36
RSLN-0691	CR	DW	2057	Room 242	1/17	6:38
RSLN-0696	BB	BF	2067	Men's Bathroom	1/17	6:40
RSLN-0697	BB	BF	2067	Men's Bathroom	1/17	6:40
RSLN-0698	CR	WC	2068	Corridor	1/17	6:39
RSLN-0728	GLR	BF	1048B1	Girls Locker Room Bathroom/Shower	1/17	6:11
RSLN-0744	HA	WC	1040	Women's Bathroom	1/17	5:47
RSLN-0745	HA	WC	N/A (New Construction)	North Gym	1/17	6:04
RSLN-0746	HA	WC	2001	Men's Bathroom	1/17	6:16
RSLN-0747	HA	WC	2032	Women's Bathroom	1/17	6:33

LABORATORY, INC.
LABORATORY, NY
1/17/20 12:04 PM

062001159

Building Address

Roslyn High School

475 Round Hill Road

Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Angela McDonald 1/24/20

Samplers Name: Danielle Bolognino

Samplers Signature: *Danielle Bolognino*JCB Project Manager: *Anthony Lombardo*

1/17/20 12:04 PM



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

1/27/2020

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 1/17/2020. The results are tabulated on the attached data pages for the following client designated project:

**Roslyn UFSD, RHS Building, Roslyn High School, 475 Round Hill
Road, Roslyn Heights, New York 11577, Project #:19-45006**

The reference number for these samples is EMSL Order #062001159. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001159

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/17/20 12:04 PM
 Collected: 1/17/2020

Project: Roslyn UFSD, RHS Building, Roslyn High School, 475 Round Hill Road, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description RSLN-0485 **Collected:** 1/17/2020 **Lab ID:** 062001159-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 J	3.0 µg/L	1/23/2020	AL	1/24/2020	AM

Client Sample Description RSLN-0486 **Collected:** 1/17/2020 **Lab ID:** 062001159-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	19	3.0 µg/L	1/23/2020	AL	1/24/2020	AM

Client Sample Description RSLN-0487 **Collected:** 1/17/2020 **Lab ID:** 062001159-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0489 **Collected:** 1/17/2020 **Lab ID:** 062001159-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	17	3.0 µg/L	1/23/2020	AL	1/24/2020	AM

Client Sample Description RSLN-0490 **Collected:** 1/17/2020 **Lab ID:** 062001159-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0492 **Collected:** 1/17/2020 **Lab ID:** 062001159-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0493 **Collected:** 1/17/2020 **Lab ID:** 062001159-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/23/2020	AL	1/24/2020	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001159

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/17/20 12:04 PM
 Collected: 1/17/2020

Project: **Roslyn UFSD, RHS Building, Roslyn High School, 475 Round Hill Road, Roslyn Heights, New York 11577, Project #:19-45006**

Analytical Results

Client Sample Description		RSLN-0494	Collected:	1/17/2020	Lab ID:	062001159-0008		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0	µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		RSLN-0498	Collected:	1/17/2020	Lab ID:	062001159-0009		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/23/2020	AL	1/24/2020	AM
Client Sample Description		RSLN-0501	Collected:	1/17/2020	Lab ID:	062001159-0010		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/23/2020	AL	1/24/2020	AM
Client Sample Description		RSLN-0502	Collected:	1/17/2020	Lab ID:	062001159-0011		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0	µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		RSLN-0503	Collected:	1/17/2020	Lab ID:	062001159-0012		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0	µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		RSLN-0551	Collected:	1/17/2020	Lab ID:	062001159-0013		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0	µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		RSLN-0552	Collected:	1/17/2020	Lab ID:	062001159-0014		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0	µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001159

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/17/20 12:04 PM
 Collected: 1/17/2020

Project: Roslyn UFSD, RHS Building, Roslyn High School, 475 Round Hill Road, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description RSLN-0553 **Collected:** 1/17/2020 **Lab ID:** 062001159-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0554 **Collected:** 1/17/2020 **Lab ID:** 062001159-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0555 **Collected:** 1/17/2020 **Lab ID:** 062001159-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0556 **Collected:** 1/17/2020 **Lab ID:** 062001159-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/23/2020	AL	1/24/2020	AM

Client Sample Description RSLN-0617 **Collected:** 1/17/2020 **Lab ID:** 062001159-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/23/2020	AL	1/24/2020	AM

Client Sample Description RSLN-0618 **Collected:** 1/17/2020 **Lab ID:** 062001159-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0619 **Collected:** 1/17/2020 **Lab ID:** 062001159-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001159

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/17/20 12:04 PM
 Collected: 1/17/2020

Project: Roslyn UFSD, RHS Building, Roslyn High School, 475 Round Hill Road, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description RSLN-0621 **Collected:** 1/17/2020 **Lab ID:** 062001159-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0622 **Collected:** 1/17/2020 **Lab ID:** 062001159-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0 µg/L	1/23/2020	AL	1/24/2020	AM

Client Sample Description RSLN-0623 **Collected:** 1/17/2020 **Lab ID:** 062001159-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	14	3.0 µg/L	1/23/2020	AL	1/24/2020	AM

Client Sample Description RSLN-0624 **Collected:** 1/17/2020 **Lab ID:** 062001159-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/23/2020	AL	1/24/2020	AM

Client Sample Description RSLN-0625 **Collected:** 1/17/2020 **Lab ID:** 062001159-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/23/2020	AL	1/24/2020	AM

Client Sample Description RSLN-0626 **Collected:** 1/17/2020 **Lab ID:** 062001159-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	32	3.0 µg/L	1/23/2020	AL	1/24/2020	AM

Client Sample Description RSLN-0627 **Collected:** 1/17/2020 **Lab ID:** 062001159-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/23/2020	AL	1/24/2020	AM

Client Sample Description RSLN-0628 **Collected:** 1/17/2020 **Lab ID:** 062001159-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001159

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/17/20 12:04 PM
 Collected: 1/17/2020

Project: Roslyn UFSD, RHS Building, Roslyn High School, 475 Round Hill Road, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description RSLN-0628 **Collected:** 1/17/2020 **Lab ID:** 062001159-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/23/2020	AL	1/24/2020	AM

Client Sample Description RSLN-0635 **Collected:** 1/17/2020 **Lab ID:** 062001159-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	1/23/2020	AL	1/24/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLN-0636 **Collected:** 1/17/2020 **Lab ID:** 062001159-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	1/23/2020	AL	1/24/2020	AM

Client Sample Description RSLN-0637 **Collected:** 1/17/2020 **Lab ID:** 062001159-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.1	3.0 µg/L	1/23/2020	AL	1/24/2020	AM

Client Sample Description RSLN-0638 **Collected:** 1/17/2020 **Lab ID:** 062001159-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/23/2020	AL	1/24/2020	AM

Client Sample Description RSLN-0639 **Collected:** 1/17/2020 **Lab ID:** 062001159-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	1/23/2020	AL	1/24/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLN-0640 **Collected:** 1/17/2020 **Lab ID:** 062001159-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.8	3.0 µg/L	1/23/2020	AL	1/24/2020	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001159

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/17/20 12:04 PM
 Collected: 1/17/2020

Project: Roslyn UFSD, RHS Building, Roslyn High School, 475 Round Hill Road, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description RSLN-0641 **Collected:** 1/17/2020 **Lab ID:** 062001159-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/23/2020	AL	1/24/2020	AM

Client Sample Description RSLN-0643 **Collected:** 1/17/2020 **Lab ID:** 062001159-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0648 **Collected:** 1/17/2020 **Lab ID:** 062001159-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0689 **Collected:** 1/17/2020 **Lab ID:** 062001159-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0690 **Collected:** 1/17/2020 **Lab ID:** 062001159-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/23/2020	AL	1/24/2020	AM

Client Sample Description RSLN-0691 **Collected:** 1/17/2020 **Lab ID:** 062001159-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0 µg/L	1/23/2020	AL	1/24/2020	AM

Client Sample Description RSLN-0696 **Collected:** 1/17/2020 **Lab ID:** 062001159-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001159

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/17/20 12:04 PM
 Collected: 1/17/2020

Project: Roslyn UFSD, RHS Building, Roslyn High School, 475 Round Hill Road, Roslyn Heights, New York 11577, Project #:19-45006

Analytical Results

Client Sample Description		RSLN-0697	Collected:	1/17/2020	Lab ID:	062001159-0043		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0	µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		RSLN-0698	Collected:	1/17/2020	Lab ID:	062001159-0044		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0	µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		RSLN-0728	Collected:	1/17/2020	Lab ID:	062001159-0045		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.7	3.0	µg/L	1/23/2020	AL	1/24/2020	AM
Client Sample Description		RSLN-0744	Collected:	1/17/2020	Lab ID:	062001159-0046		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/23/2020	AL	1/24/2020	AM
Client Sample Description		RSLN-0745	Collected:	1/17/2020	Lab ID:	062001159-0047		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/23/2020	AL	1/24/2020	AM
Client Sample Description		RSLN-0746	Collected:	1/17/2020	Lab ID:	062001159-0048		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/23/2020	AL	1/24/2020	AM
Client Sample Description		RSLN-0747	Collected:	1/17/2020	Lab ID:	062001159-0049		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0	µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0ug/L								



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>

carleplacelab@emsl.com

EMSL Order:	062001159
CustomerID:	JCBR50
CustomerPO:	
ProjectID:	

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted

062001358



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: RHS

Client:

Roslyn UFSD

Turn Around: Normal (twk) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLN-0632	BR	BF	2004	Staff Bathroom	1/18	7:47
RSLN-0750	FH	IM	N/A	Field House	1/18	7:31
RSLN-0751	FH	KC	N/A	Field House	1/18	7:34

20 JAN 20 PM 12:20
 CARLE PLACE, NY
 JCB PROJECT, INC.
 Carter

Building Address

Roslyn High School

475 Round Hill Road

Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Sampler's Name:

Sampler's Signature:

JCB Project Manager:

1/20/2020
 1/22/20



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

1/23/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 1/20/2020. The results are tabulated on the attached data pages for the following client designated project:

Roslyn High School, 475 Round Hill Road, Roslyn Heights, New York 11577 #19-45006

The reference number for these samples is EMSL Order #062001358. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001358

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 01/20/20 12:20 PM
Collected: 1/18/2020

Project: Roslyn High School, 475 Round Hill Road, Roslyn Heights, New York 11577 #19-45006

Analytical Results

Client Sample Description RSLN-0632 **Collected:** 1/18/2020 **Lab ID:** 062001358-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	1/21/2020	DI	1/22/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0750 **Collected:** 1/18/2020 **Lab ID:** 062001358-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/21/2020	DI	1/22/2020	AM

Client Sample Description RSLN-0751 **Collected:** 1/18/2020 **Lab ID:** 062001358-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.9	3.0 µg/L	1/21/2020	DI	1/22/2020	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: Roslyn
High
School

Client: Roslyn UFSD

Re-test/New Install ☒

Turn Around: Normal (1wk)

Rush _____

Page 1 of 1

OrderID: 062005157

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN - 0486	BR	BF	0004	Girls Bathroom	3/10/20	6:03
RSLYN - 0489	BR	BF	0006	Boys Bathroom	3/10/20	6:05

* Final Submit *

062005157

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
20 MAR 10 PM 9:49

Building Address

Roslyn High School

475 Round Hill Road

Roslyn Heights, NY 11577

Analysis Type: ELAP 200.5

Lab Received: _____

Signature: _____

Pb(200.5) - A. J. J. 03/12/20

Samplers Name: Danielle Bolognini

Samplers Signature: [Signature]

JCB Project Manager: Anthony Lombardo

Rev.13020



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

3/17/2020

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 3/10/2020. The results are tabulated on the attached data pages for the following client designated project:

**JCB #19-45006, Roslyn UFSD, Roslyn High School, 475 Round
Hill Road, Roslyn Heights, NY 11577**

The reference number for these samples is EMSL Order #062005157. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062005157

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 03/10/20 9:59 PM
Collected: 3/10/2020

Project: JCB #19-45006, Roslyn UFSD, Roslyn High School, 475 Round Hill Road, Roslyn Heights, NY 11577

Analytical Results

Client Sample Description RSLYN-0486 **Collected:** 3/10/2020 **Lab ID:** 062005157-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	3/11/2020	DI	3/13/2020	AL

Client Sample Description RSLYN-0489 **Collected:** 3/10/2020 **Lab ID:** 062005157-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	3/11/2020	DI	3/13/2020	AL

Definitions:


MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: HTA

Client:

Roslyn UFSD

Turn Around: Normal (twk) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLN-0701	CR	CF	1002	Classroom	1/17	6:58
RSLN-0702	CR	CF	1002	Classroom	1/17	6:59
RSLN-0703	MBR	BF	1003A	East Stairwell Men's Bathroom	1/17	6:57
RSLN-0704	WBR	BF	2000	Women's Bathroom in Stairwell	1/17	6:59
RSLN-0705	CR	WC	2001	2nd Floor Common Area	1/17	7:00
RSLN-0746	CR	WC	2001	2nd Floor Common Area	1/17	7:01

20 JAN 17 PM 12:04
CARLE PLACE, NY

062001225
~~062001159~~ ND

Building Address

Hilltop Academy

475 Round Hill Road

Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Danielle Babin

Samplers Signature: [Signature]

JCB Project Manager:

Quinn McDonald 1/24/20

12:04 PM



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

1/27/2020

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 1/17/2020. The results are tabulated on the attached data pages for the following client designated project:

**Roslyn UFSD, HTA Building, Hilltop Academy, 475 Round Hill
Road, Roslyn Heights, New York 11577, Project #:19-45006**

The reference number for these samples is EMSL Order #062001225. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001225

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/17/20 12:04 PM
 Collected: 1/17/2020

Project: **Roslyn UFSD, HTA Building, Hilltop Academy, 475 Round Hill Road, Roslyn Heights, New York 11577, Project #:19-45006**

Analytical Results

Client Sample Description		RSLN-0701	Collected:	1/17/2020	Lab ID:	062001225-0001		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0	µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		RSLN-0702	Collected:	1/17/2020	Lab ID:	062001225-0002		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.8	3.0	µg/L	1/23/2020	AL	1/24/2020	AM
Client Sample Description		RSLN-0703	Collected:	1/17/2020	Lab ID:	062001225-0003		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.0	3.0	µg/L	1/23/2020	AL	1/24/2020	AM
Client Sample Description		RSLN-0704	Collected:	1/17/2020	Lab ID:	062001225-0004		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0	µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		RSLN-0705	Collected:	1/17/2020	Lab ID:	062001225-0005		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0	µg/L	1/23/2020	AL	1/24/2020	AM
Lead MDL: 1.0µg/L								
Client Sample Description		RSLN-0748	Collected:	1/17/2020	Lab ID:	062001225-0006		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	1/23/2020	AL	1/24/2020	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: RAB

Client:

Roslyn UFSD

Turn Around: Normal (1wk) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLN-0706	WBR	BF	1006	Women's Bathroom	1/18	7:24
RSLN-0707	OF	BW	1007	Break & Print Room	1/18	7:22
RSLN-0708	OF	KC	1007	Break & Print Room	1/18	7:22
RSLN-0709	MBR	BF	1008	Men's Bathroom	1/18	7:21
RSLN-0711	WBR	BF	2000	Women's Bathroom	1/18	7:12
RSLN-0712	WBR	BF	2000	Women's Bathroom	1/18	7:12
RSLN-0713	OF	BF	2001A2	Superintendent Office Bathroom	1/18	7:14
RSLN-0714	HA	BW	2004	Assist. Superintendent of Curriculum	1/18	7:16
RSLN-0715	OF	CF	2006	Kitchen	1/18	7:19
RSLN-0716	KI	BF	2006B	Kitchen Bathroom	1/18	7:18
RSLN-0749	OF	KC	2001	Superintendent Office	1/18	7:16

RECEIVED
JCB, INC.
LABORATORY
PLACEMENT, NY
JAN 19 2012
12:26 PM

062001370

Building Address

Roslyn Administration Building

300 Harbor Hill Road

Roslyn Heights, New York 11577

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Sampler's Name: Danielle Bolognini

Sampler's Signature: [Signature]JCB Project Manager: Anthony Lombardo

Aupres McDonald 1/27/20

12:26 PM



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

1/28/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 1/20/2020. The results are tabulated on the attached data pages for the following client designated project:

Roslyn UFSD, RAB Building, Roslyn Administration Building, 300
Harbor Hill Road, Roslyn Heights, New York 11577, Project #:19-
45006

The reference number for these samples is EMSL Order #062001370. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001370

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 01/20/20 12:26 PM
 Collected: 1/18/2020

Project: Roslyn UFSD, RAB Building, Roslyn Administration Building, 300 Harbor Hill Road, Roslyn Heights, New York 11577, Project #:19-

Analytical Results

Client Sample Description RSLN-0706 **Collected:** 1/18/2020 **Lab ID:** 062001370-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	30	3.0 µg/L	1/24/2020	AL	1/27/2020	AM

Client Sample Description RSLN-0707 **Collected:** 1/18/2020 **Lab ID:** 062001370-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	1/24/2020	AL	1/27/2020	AM

Lead MDL: 1.0µg/L

Client Sample Description RSLN-0708 **Collected:** 1/18/2020 **Lab ID:** 062001370-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.0	3.0 µg/L	1/24/2020	AL	1/27/2020	AM

Client Sample Description RSLN-0709 **Collected:** 1/18/2020 **Lab ID:** 062001370-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.0	3.0 µg/L	1/24/2020	AL	1/27/2020	AM

Client Sample Description RSLN-0711 **Collected:** 1/18/2020 **Lab ID:** 062001370-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0 µg/L	1/24/2020	AL	1/27/2020	AM

Client Sample Description RSLN-0712 **Collected:** 1/18/2020 **Lab ID:** 062001370-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.8	3.0 µg/L	1/24/2020	AL	1/27/2020	AM

Client Sample Description RSLN-0713 **Collected:** 1/18/2020 **Lab ID:** 062001370-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	27	3.0 µg/L	1/24/2020	AL	1/27/2020	AM

Client Sample Description RSLN-0714 **Collected:** 1/18/2020 **Lab ID:** 062001370-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001370

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 01/20/20 12:26 PM
Collected: 1/18/2020

Project: Roslyn UFSD, RAB Building, Roslyn Administration Building, 300 Harbor Hill Road, Roslyn Heights, New York 11577, Project #:19-

Analytical Results

Client Sample Description RSLN-0714 **Collected:** 1/18/2020 **Lab ID:** 062001370-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	1/24/2020	AL	1/27/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0715 **Collected:** 1/18/2020 **Lab ID:** 062001370-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0 µg/L	1/24/2020	AL	1/27/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0716 **Collected:** 1/18/2020 **Lab ID:** 062001370-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	1/24/2020	AL	1/27/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0749 **Collected:** 1/18/2020 **Lab ID:** 062001370-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	1/24/2020	AL	1/27/2020	AM
Lead MDL: 1.0µg/L							

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: Roslyn
Admin
Building

Client: Roslyn UFSD

Re-test/New Install ☒
Turn Around: Normal (1wk)

Rush

Page 1 of 1

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLYN - 0706	BR	BF	1006	Women's Bathroom	3/10/20	6:12
RSLYN - 0713	BR	BF	2001A2	Superintendent Office Bathroom	3/10/20	6:18

A Final Submittal

062.005156

RECEIVED
EMSL ANALYTICAL, INC.
CARLE PLACE, NY
20 MAR 10 PM 9:50

Building Address

Roslyn Administration Building
300 Harbor Hill Road
Roslyn Heights, NY 11577

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Pb 200.5

A. Jung 03/12/20

Samplers Name:

Samplers Signature:

JCB Project Manager:

Rev.13020



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

3/17/2020

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 3/10/2020. The results are tabulated on the attached data pages for the following client designated project:

JCB#: 19-45006, Roslyn Admin Building, Roslyn UFSD, Roslyn
Administration Building, 300 Harbor Hill Road, Roslyn Heights,
NY 11577

The reference number for these samples is EMSL Order #062005156. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062005156

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 03/10/20 9:50 PM
Collected: 3/10/2020

Project: JCB#: 19-45006, Roslyn Admin Building, Roslyn UFSD, Roslyn Administration Building, 300 Harbor Hill Road, Roslyn Heights, NY

Analytical Results

Client Sample Description RSLYN-0706 **Collected:** 3/10/2020 **Lab ID:** 062005156-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.9	3.0 µg/L	3/11/2020	DI	3/13/2020	AL

Client Sample Description RSLYN-0713 **Collected:** 3/10/2020 **Lab ID:** 062005156-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	24	3.0 µg/L	3/11/2020	DI	3/13/2020	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-45006

Building: RMB

Client:

Roslyn UFSD

Turn Around: Normal (1wk) Rush _____

Page 1 of 1

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
RSLN-0732	OF	WC	1011	Shop Room	1/18	8:02
RSLN-0733	BR	BF	1013A	Bathroom	1/18	8:03
RSLN-0734	BR	BF	1013A	Bathroom	1/18	8:04
RSLN-0735	KI	KC	1014	Lounge	1/18	8:07
RSLN-0736	BR	BF	1015C	Main Office Bathroom	1/18	8:06
RSLN-0737	ST	KC	N/A (New Construction)	Bus Garage	1/18	8:10
RSLN-0738	ST	KC	N/A (New Construction)	Bus Garage	1/18	8:11
RSLN-0739	ST	BF	N/A (New Construction)	Bus Garage Bathroom	1/18	8:09

062001371

20 JAN 20 PM 12:24
CARLE PLACE, NY
ANALYTICAL INC.

Building Address

Roslyn Maintenance Building

3 Parp Drive

Greenvale, New York 11548

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Danielle Bolognini

Samplers Signature: Danielle Bolognini

JCB Project Manager: Anthony Lombardo

Via: Carrier

1/20/20 10:24 PM
Ampex McDonald 1/27/20



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

Anthony Lombardo
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

1/28/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 1/20/2020. The results are tabulated on the attached data pages for the following client designated project:

Roslyn UFSD, RMB Building, Roslyn Maintenance Building, 3
Parp Drive, Greenvale, New York 11548, Project #:19-45006

The reference number for these samples is EMSL Order #062001371. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001371

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 01/20/20 12:24 PM
Collected: 1/18/2020

Project: Roslyn UFSD, RMB Building, Roslyn Maintenance Building, 3 Parp Drive, Greenvale, New York 11548, Project #:19-45006

Analytical Results

Client Sample Description RSLN-0732 **Collected:** 1/18/2020 **Lab ID:** 062001371-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	1/24/2020	AL	1/27/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0733 **Collected:** 1/18/2020 **Lab ID:** 062001371-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	1/24/2020	AL	1/27/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0734 **Collected:** 1/18/2020 **Lab ID:** 062001371-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	1/24/2020	AL	1/27/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0735 **Collected:** 1/18/2020 **Lab ID:** 062001371-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	1/24/2020	AL	1/27/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0736 **Collected:** 1/18/2020 **Lab ID:** 062001371-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	1/24/2020	AL	1/27/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0737 **Collected:** 1/18/2020 **Lab ID:** 062001371-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	1/24/2020	AL	1/27/2020	AM
Lead MDL: 1.0µg/L							

Client Sample Description RSLN-0738 **Collected:** 1/18/2020 **Lab ID:** 062001371-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	1/24/2020	AL	1/27/2020	AM

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062001371

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Anthony Lombardo**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 01/20/20 12:24 PM
Collected: 1/18/2020

Project: Roslyn UFSD, RMB Building, Roslyn Maintenance Building, 3 Parp Drive, Greenvale, New York 11548, Project #:19-45006

Analytical Results**Client Sample Description** RSLN-0739**Collected:** 1/18/2020**Lab ID:** 062001371-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	26	3.0 µg/L	1/24/2020	AL	1/27/2020	AM

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted

Attachment 3:

Laboratory Certifications


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

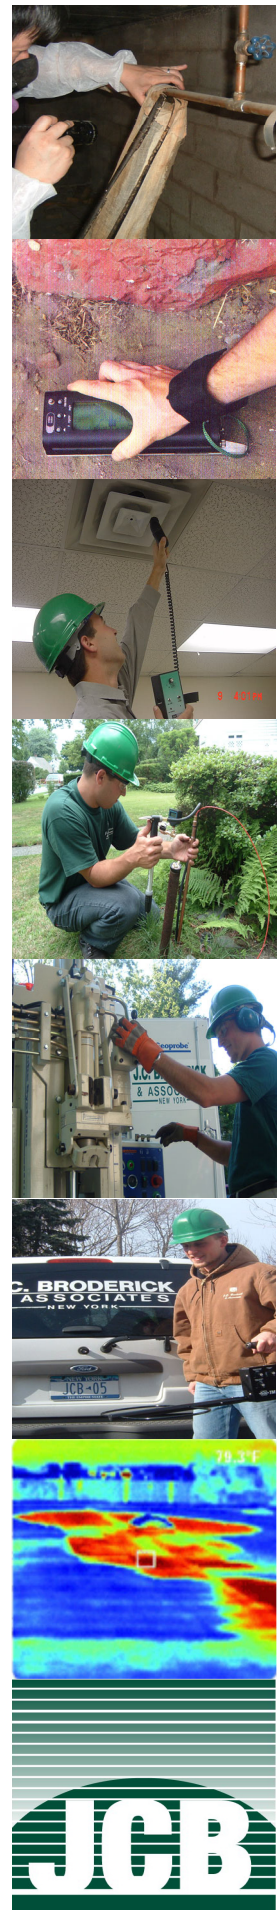

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2020
Issued April 01, 2019
Revised October 18, 2019

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MR. DANIEL CLARKE
EMSL ANALYTICAL, INC.
528 MINEOLA AVE.
CARLE PLACE, NY 11514

NY Lab Id No: 11469

*is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2003) for the category
ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:*

Bacteriology

Coliform, Total / E. coli (Qualitative)	SM 21, 23 9222A,B,C SM 20, 21-23 9223B (-04) (Colilert)
E. coli (Enumeration)	SM 21, 23 9222A,B,C
Enterococci	SM 20, 23 9230C (Budnick 1996)
Heterotrophic Plate Count	SimPlate SM 20, 21-23 9215B (-04)

Metals I

Lead, Total	EPA 200.5
-------------	-----------

Miscellaneous

Asbestos	EPA 100.2
----------	-----------

Serial No.: 60618

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.

